

FUKUOKA, JA	Station ID = ICAO_RJFF
Latitude = 33.59 N	Elevation = 32 Feet
Longitude = 130.45 E	Average Pressure = 29.91 inches Hg
Period of Record = 1988 To 2017	

Design Criteria Data

	Mean Coincident (Average) Values				
Dry Bulb Temperature (T)	Design Value (°F)	Wet Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Median of Extreme Highs	95	78	119	11.1	VRB
0.4% Occurrence	93	78	122	10.9	VRB
1.0% Occurrence	91	78	122	10.4	NW
2.0% Occurrence	90	78	122	10.4	NW
Mean Daily Range	13	-	-	-	SSE
97.5% Occurrence	36	33	22	7.5	SSE
99.0% Occurrence	34	31	21	7	SSE
99.6% Occurrence	32	29	19	7	SSE
Median of Extreme Lows	28	25	15	10.7	SSE

	Design Value (°F)	Dry Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Wet Bulb Temperature (T _{wb})					
Median of Extreme Highs	81	89	143	9.5	VRB
0.4% Occurrence	80	88	138	9.6	VRB
1.0% Occurrence	79	87	135	9.3	VRB
2.0% Occurrence	78	86	131	8.9	VRB

	Design Value (gr/lb)	Dry Bulb Temperature (°F)	Vapor Pressure (in. Hg)	Wind Speed (mph)	Prevailing Direction (NSEW)
Humidity Ratio (HR)					
Median of Extreme Highs	151	86	0.99	8.3	VRB
0.4% Occurrence	142	84	0.94	8.6	SSE
1.0% Occurrence	141	84	0.94	8.2	SSE
2.0% Occurrence	134	83	0.88	8.5	SSE

Air Conditioning/ Humid Area Criteria	Threshold	T ≥ 93 °F	T ≥ 80 °F	Twb ≥ 73 °F	Twb ≥ 67 °F
	# of Hours	47	1291	1532	2531


Other Site Data

Weather Region	Rain Rate 100 Year Recurrence (in./hr)	Basic Wind Speed 3 sec gust @ 33 ft 50 Year Recurrence (mph)	Ventilation Cooling Load Index (Ton-hr/cfm/yr) Base 75°F-RH 60% Latent + Sensible
8	N/A	N/A	5.2 + 1.3
Ground Water Temperature (°F) 50 Foot Depth*	Frost Depth 50 Year Recurrence (in)	Ground Snow Load 50 Year Recurrence (lb/ft²)	Average Annual Freeze-Thaw Cycles (#)
65.1	N/A	N/A	5


*Note: Temperatures at greater depths can be estimated by adding 1.5°F per 100 feet additional depth.




Average Annual Climate

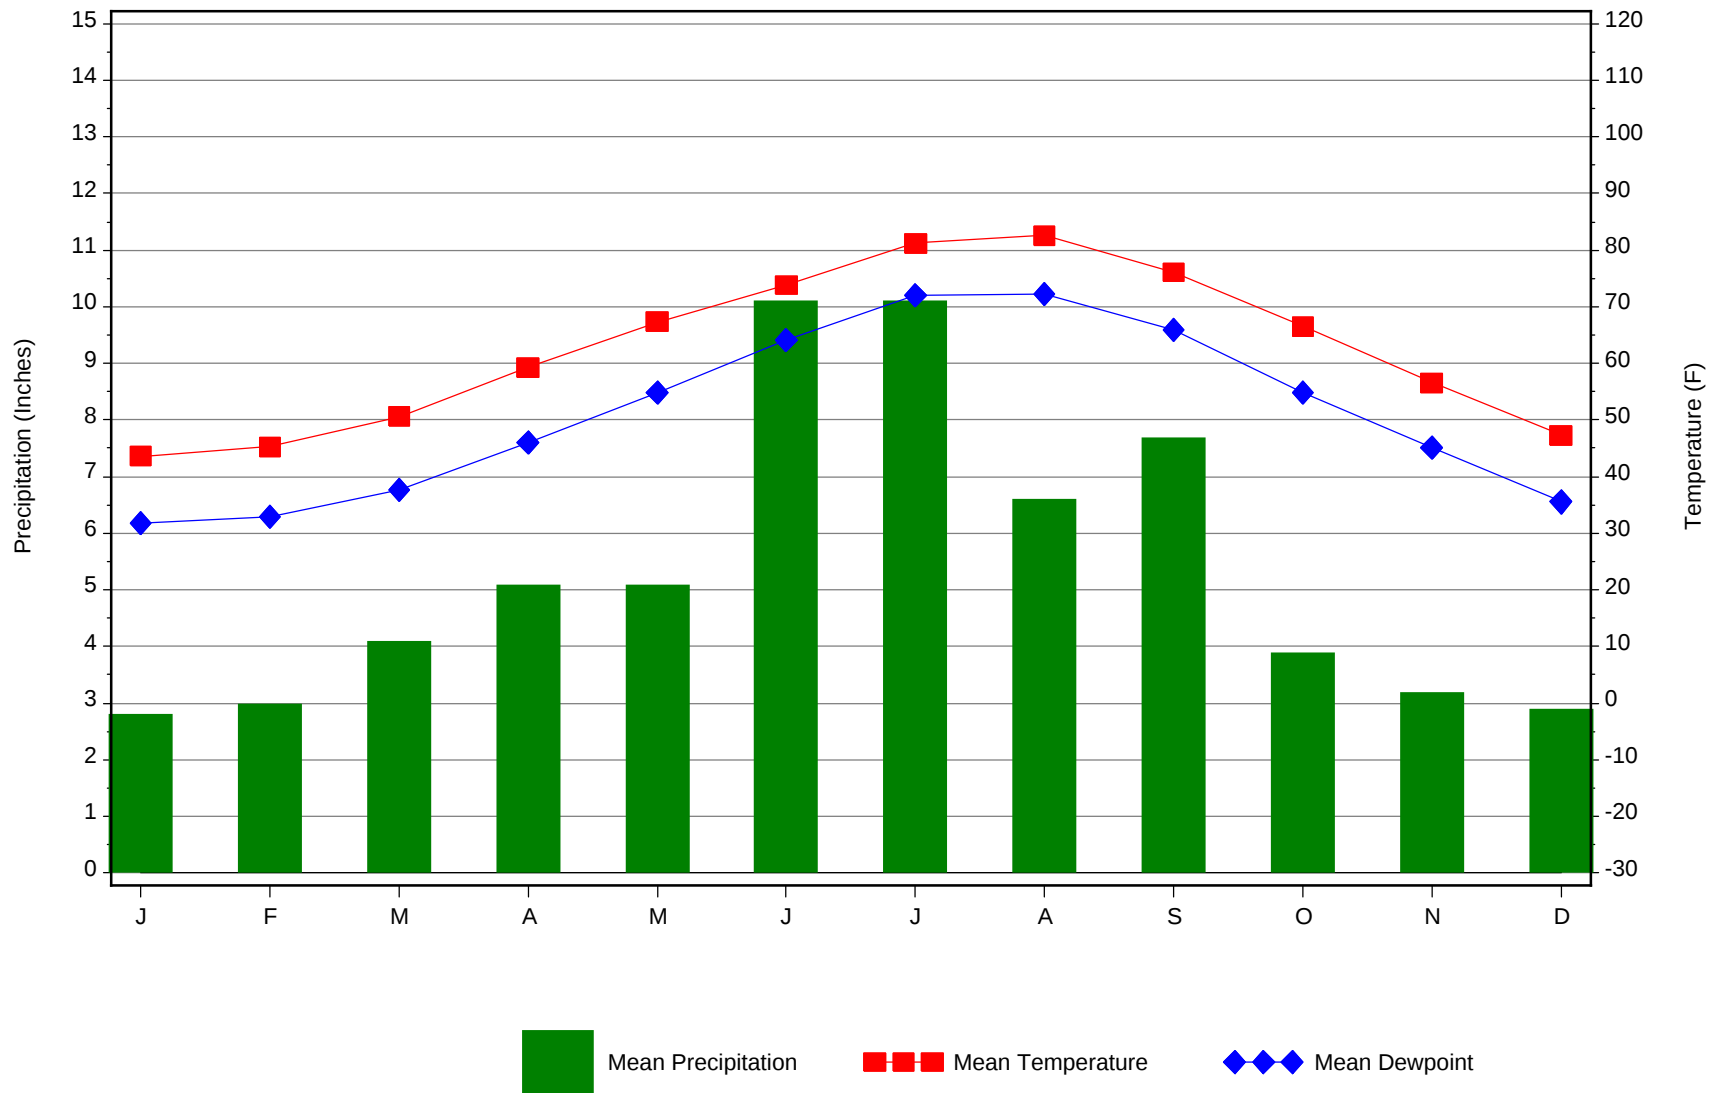

Long Term Psychrometric Summary

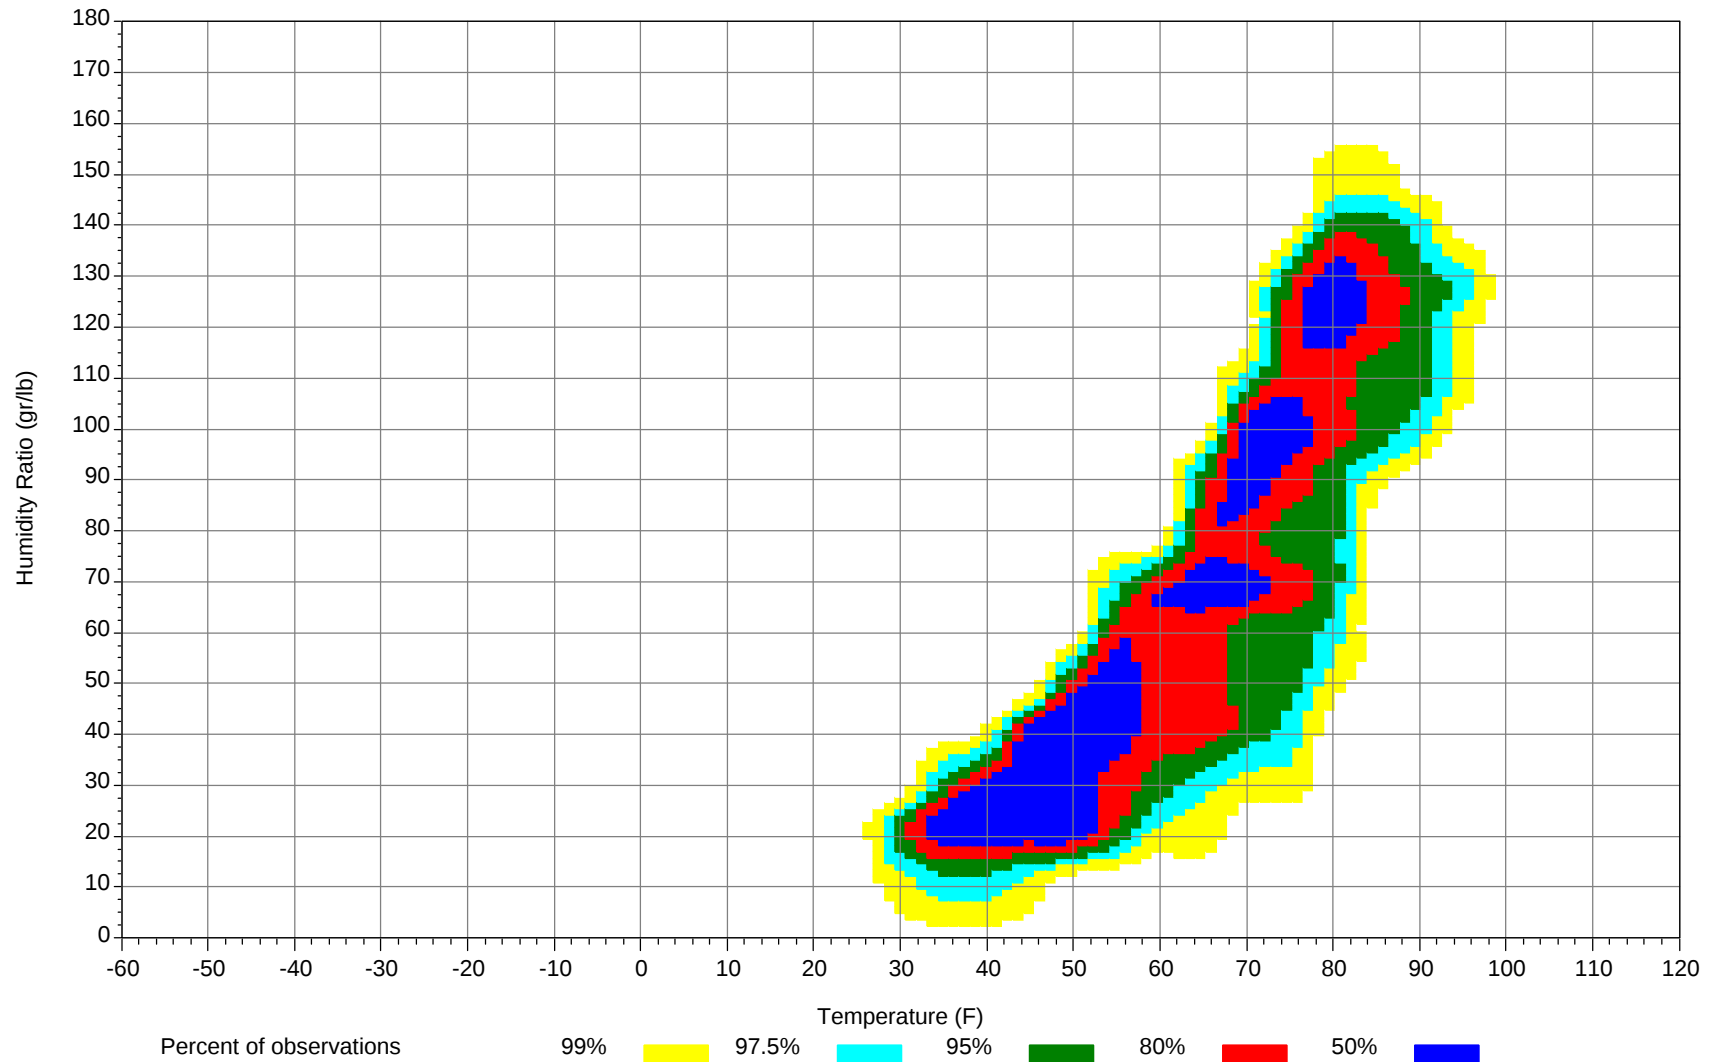

Psychrometric Summary of Peak Design Values

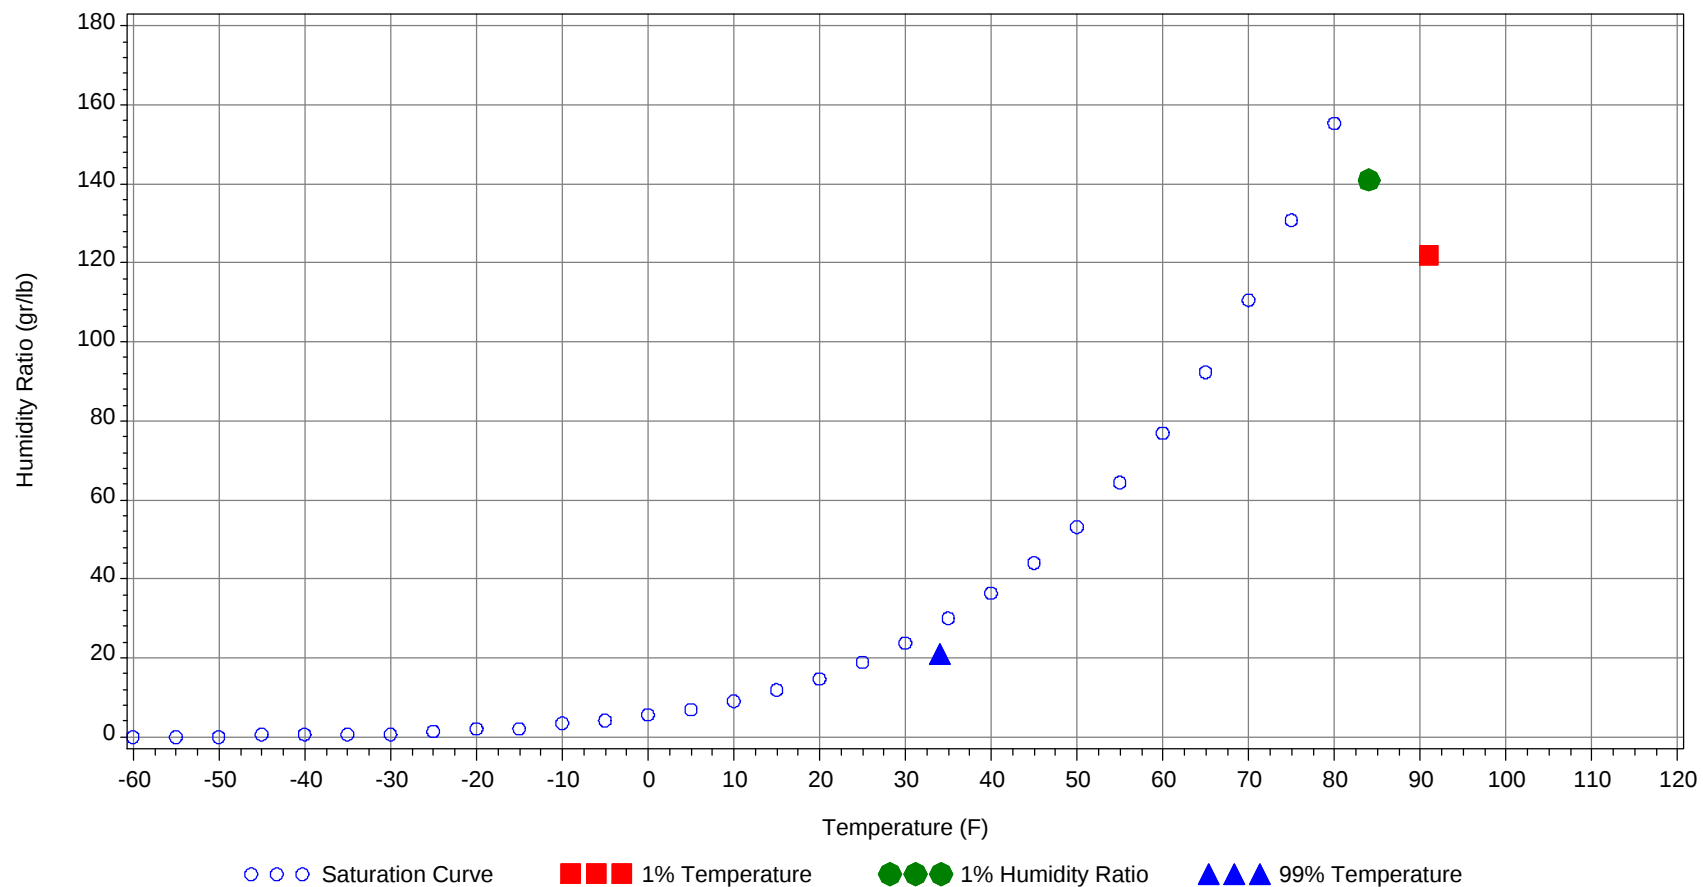

	(°F) / (gr/lb)	MCDB (°F)	MCWB (°F)	MCDP (°F)	MCHR (gr/lb)	Enthalpy (btu/lb)
1.0% Dry Bulb	91.0		78		122.0	41.1
99.0% Dry Bulb	34.0				21.0	11.3
1.0% Humidity Ratio	141.0	84.0	78.8	77.0		42.4

Dry-Bulb Temperature Hours For An Average Year

	January					February					March				
Temperature Range (° F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (° F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (° F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (° F)
100/104															
95/ 99															
90/ 94															
85/ 89															
80/ 84															
75/ 79												0	0	0	62.6
70/ 74							1	0	1	58.5	0	6	1	7	58
65/ 69		0	0	0	60.4	0	3	2	5	58.2	0	8	4	12	55.9
60/ 64	1	4	1	6	55.7	2	8	5	15	54.9	8	35	18	61	53.6
55/ 59	3	18	8	29	50.5	8	28	14	50	50.1	21	66	48	135	50
50/ 54	15	61	36	112	45.6	19	58	43	120	45.5	50	79	78	207	45.8
45/ 49	48	83	78	209	40.9	44	71	69	184	40.7	76	40	64	180	41.5
40/ 44	57	45	61	163	36.9	50	34	48	132	36.9	50	9	23	82	37.5
35/ 39	86	33	53	172	33.5	70	17	37	124	33.5	37	4	10	51	34.2
30/ 34	37	5	11	53	29.8	28	3	6	37	29.8	5	0	1	6	30.3
25/ 29	3	0	1	4	25.2	2	0	0	2	25.3	0			0	27
20/ 24								0	0	20					

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Dry-Bulb Temperature Hours For An Average Year

	April					May					June				
Temperature Range (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)
100/104															
95/ 99												0	0	0	76
90/ 94							0		0	67.5		4	0	4	76
85/ 89							1	0	1	65.7	0	15	4	19	73.7
80/ 84		2	0	2	65.3		20	3	23	65.4	9	55	24	88	71.6
75/ 79	0	11	2	13	61.9	3	63	20	86	63.8	36	93	71	200	69.5
70/ 74	3	37	14	54	59.6	25	84	68	177	62.5	98	61	102	261	66.8
65/ 69	8	45	26	79	57.4	54	45	67	166	60.8	66	9	32	107	63.7
60/ 64	39	78	72	189	55.3	99	30	71	200	57.9	29	1	7	37	59.7
55/ 59	77	47	75	199	51.7	53	4	17	74	53.6	2	0	0	2	55.9
50/ 54	61	16	36	113	46.8	14		2	16	48.8					
45/ 49	38	3	12	53	42.6	1			1	44.8					
40/ 44	11	0	2	13	38.5										
35/ 39	3		0	3	35										
30/ 34	0			0	32										
25/ 29															
20/ 24															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Dry-Bulb Temperature Hours For An Average Year

	July					August					September				
Temperature Range (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)
100/104							0		0	77					
95/ 99		3	0	3	78.7		10	1	11	78.2		1	0	1	76.7
90/ 94		65	11	76	77.9	0	82	17	99	77.7		13	1	14	76.8
85/ 89	5	67	44	116	77	6	65	51	122	76.9	0	31	8	39	75.1
80/ 84	87	59	102	248	75.6	102	65	111	278	75.6	14	80	46	140	72.8
75/ 79	108	44	65	217	73.1	116	24	62	202	73.4	73	79	95	247	70.5
70/ 74	40	10	24	74	69.2	22	2	6	30	69.3	91	31	71	193	66.8
65/ 69	8	1	2	11	65.8	2	0	0	2	64.7	39	4	16	59	63.2
60/ 64	0		0	0	62.7	0			0	62.7	21	0	3	24	59.5
55/ 59											2		0	2	55.2
50/ 54															
45/ 49															
40/ 44															
35/ 39															
30/ 34															
25/ 29															
20/ 24															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Dry-Bulb Temperature Hours For An Average Year

	October					November					December				
Temperature Range (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)
100/104															
95/ 99															
90/ 94		0		0	71.7										
85/ 89		1		1	74										
80/ 84	0	13	2	15	69.9										
75/ 79	5	55	17	77	66		4	0	4	63.9					
70/ 74	25	97	64	186	62.9	1	23	5	29	61.5		0		0	62.7
65/ 69	46	48	67	161	60.4	7	39	19	65	59.3	0	1	0	1	56.4
60/ 64	80	29	65	174	57.2	30	71	53	154	55.6	1	19	4	24	53.5
55/ 59	64	5	27	96	53.1	53	58	69	180	51.1	11	54	30	95	50.2
50/ 54	25	1	5	31	49.2	70	34	60	164	46.7	35	69	61	165	45.9
45/ 49	4		1	5	44.8	57	9	28	94	42.9	71	64	83	218	41.2
40/ 44	0		0	0	40.1	18	1	5	24	39.2	60	28	42	130	37.4
35/ 39						5	0	1	6	36.1	56	13	25	94	34
30/ 34						0			0	32	14	0	3	17	30.4
25/ 29											0		0	0	26.3
20/ 24											0			0	22


Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Dry-Bulb Temperature Hours For An Average Year


	Annual				
Temperature Range (°F)	01 To 08 LST	09 To 16 LST	17 to 00 LST	Total Obs	M C W B (°F)
100/104		0		0	77
95/ 99		14	1	15	78.2
90/ 94	0	164	30	194	77.6
85/ 89	12	180	106	298	76.4
80/ 84	211	295	289	795	74.2
75/ 79	342	374	333	1049	70.4
70/ 74	306	353	356	1015	65
65/ 69	230	205	235	670	60.8
60/ 64	309	277	299	885	56.5
55/ 59	292	279	289	860	51.3
50/ 54	289	318	320	927	46.2
45/ 49	339	270	336	945	41.3
40/ 44	245	117	181	543	37.3
35/ 39	257	66	125	448	33.7
30/ 34	84	9	20	113	29.9
25/ 29	5	1	1	7	25.3
20/ 24	0		0	0	21

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Annual Summary of Temperatures

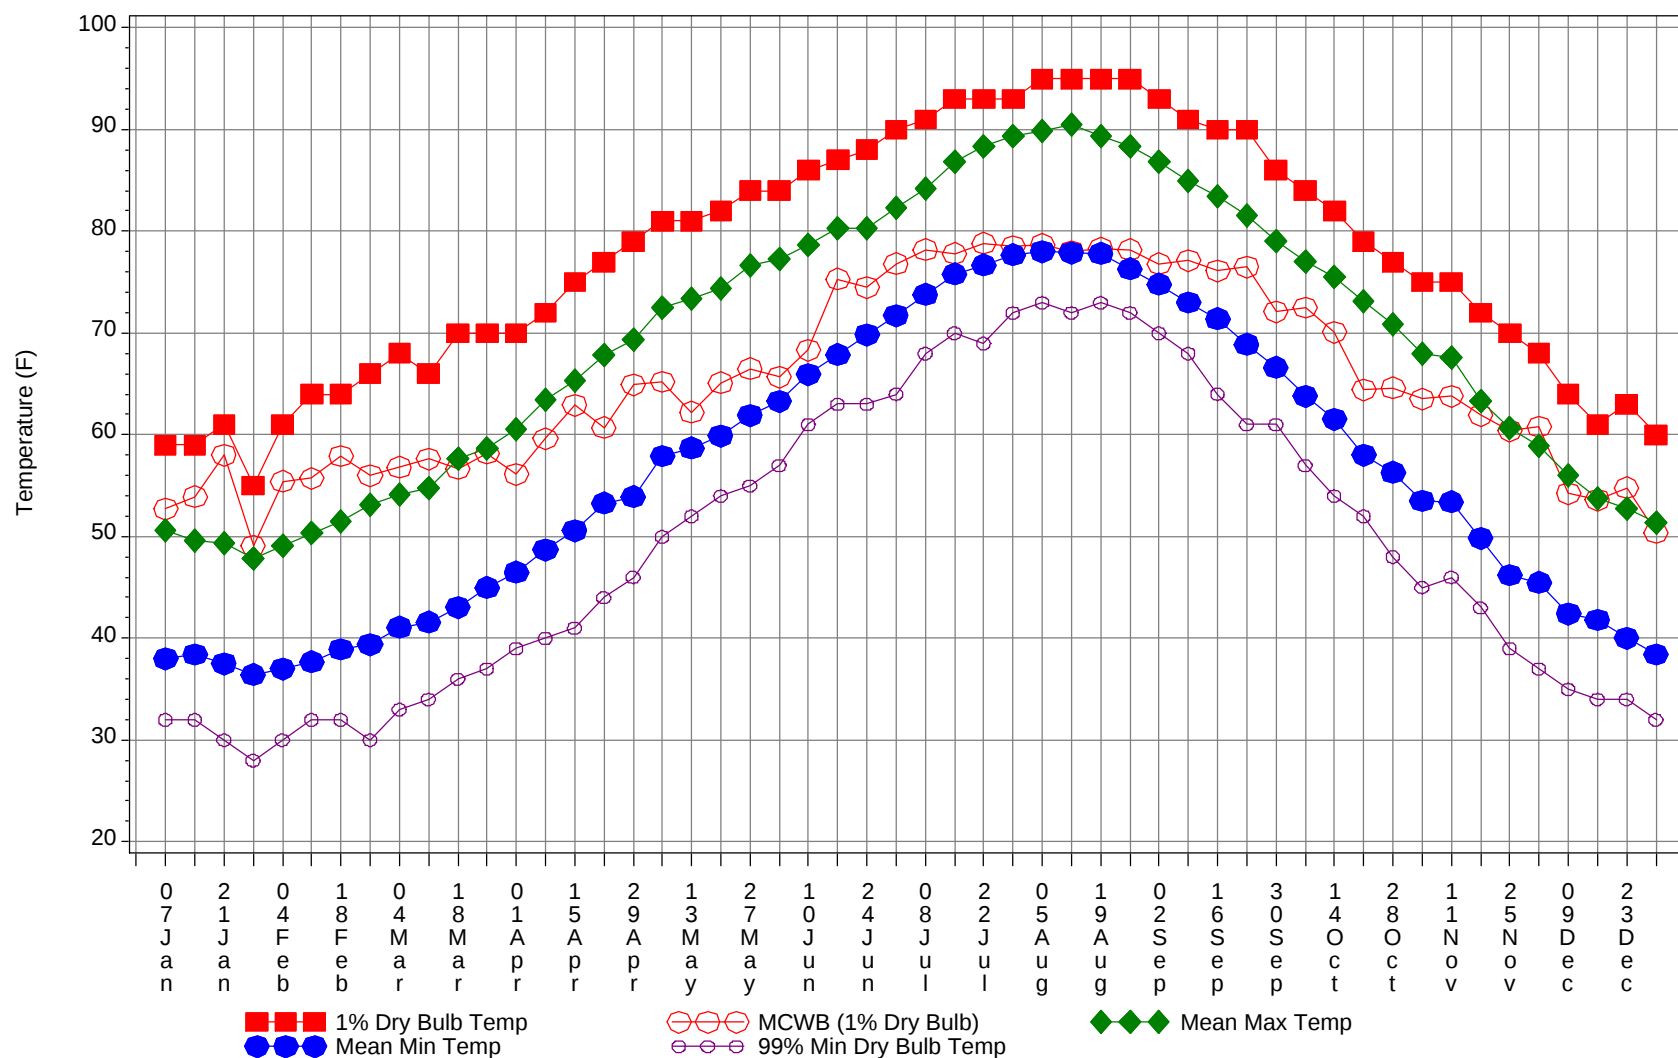


Long Term Humidity and Dry Bulb Temperature Summary

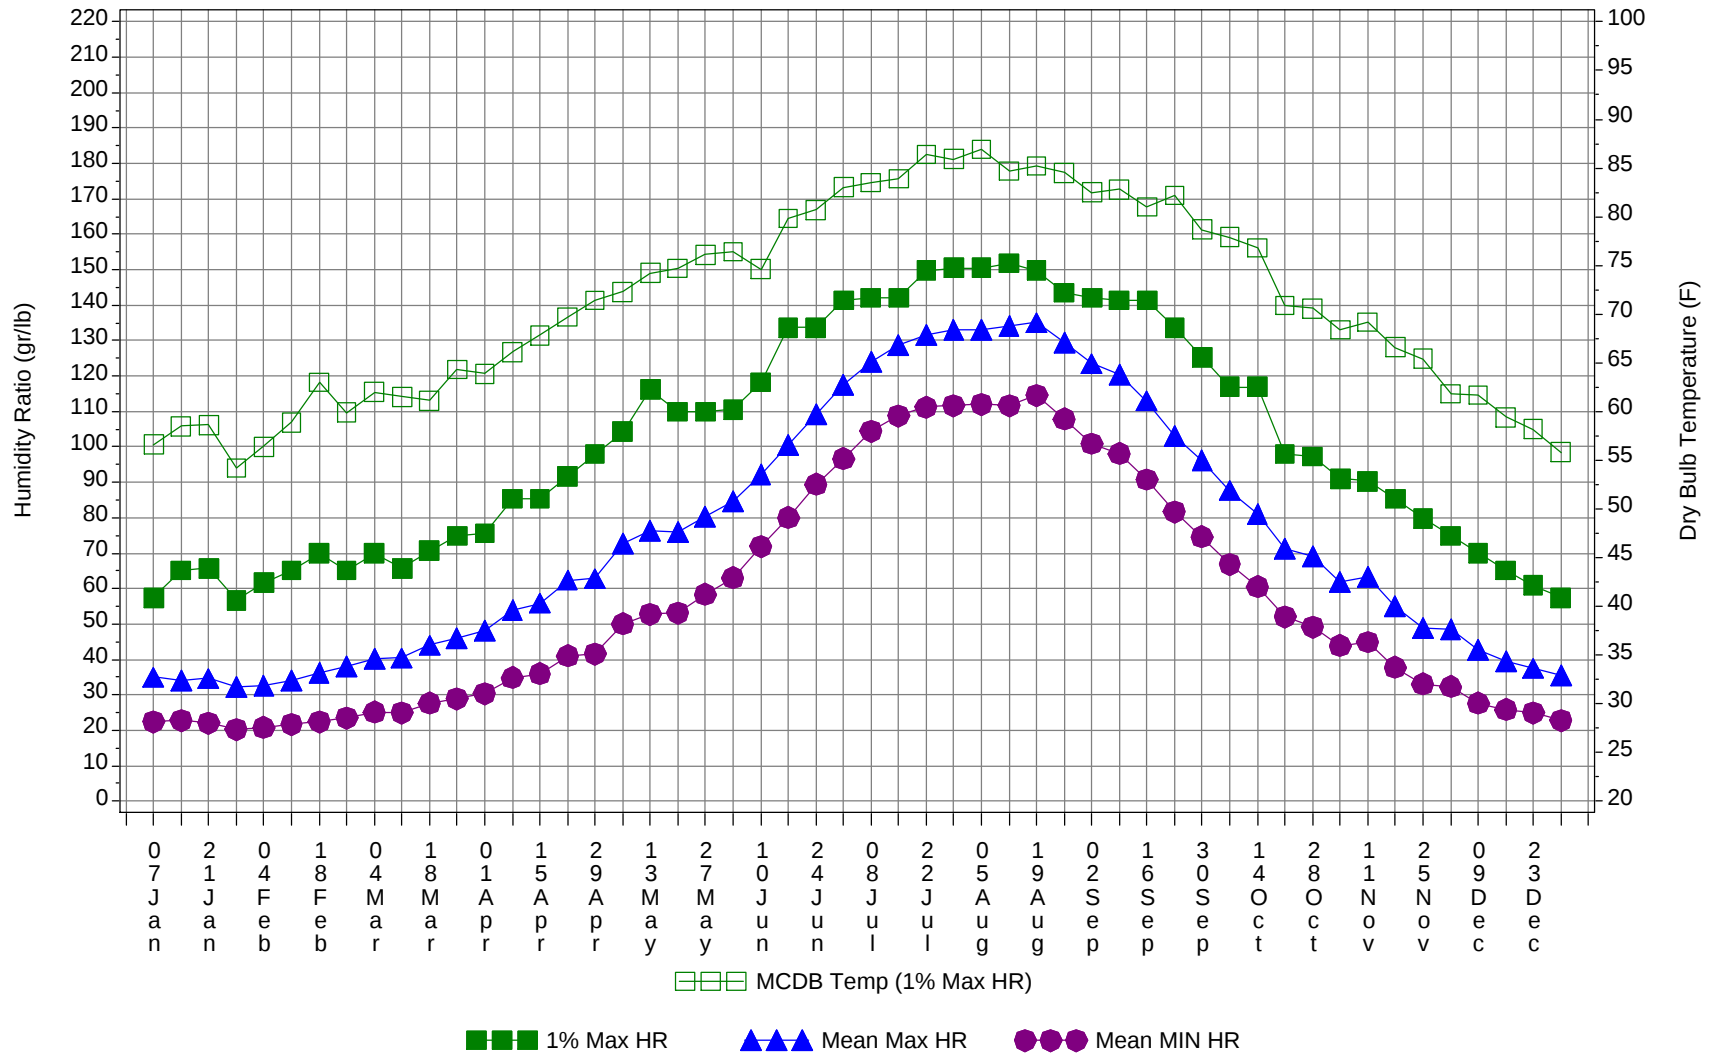

Long Term Humidity and Dry Bulb Temperature Summary


Week Ending	1.0% Temp (° F)	MCWB@ 1% Temp (° F)	Mean Max Temp (° F)	Mean Min Temp (° F)	99% Temp (° F)	1.0% HR (gr/lb)	MCDB@ 1% HR (° F)	Mean Max HR (gr/lb)	Mean Min HR (gr/lb)
7-Jan	59	52.7	50.6	38	32	57.4	56.6	35	22.4
14-Jan	59	53.9	49.6	38.4	32	65.1	58.5	34.2	22.7
21-Jan	61	58	49.4	37.5	30	65.8	58.6	34.6	22
28-Jan	55	49.1	47.8	36.4	28	56.7	54.2	32.2	20.2
4-Feb	61	55.4	49.1	37	30	61.6	56.4	32.6	20.8
11-Feb	64	55.7	50.3	37.7	32	65.1	58.9	34.2	21.7
18-Feb	64	57.9	51.5	38.9	32	70	63	36.3	22.4
25-Feb	66	56	53.1	39.4	30	65.1	59.9	37.9	23.5
4-Mar	68	56.8	54.1	41.1	33	70	62	40.3	25.1
11-Mar	66	57.6	54.8	41.6	34	65.8	61.5	40.4	24.9
18-Mar	70	56.7	57.7	43	36	70.7	61.1	44	27.6
25-Mar	70	58.2	58.7	45	37	74.9	64.3	45.9	28.9
1-Apr	70	56.1	60.5	46.5	39	75.6	63.9	48.2	30.3
8-Apr	72	59.6	63.4	48.7	40	85.4	66.1	53.9	34.9
15-Apr	75	62.9	65.3	50.6	41	85.4	67.8	55.9	36
22-Apr	77	60.7	67.9	53.3	44	91.7	69.7	62.4	41
29-Apr	79	64.9	69.4	53.9	46	98	71.4	62.8	41.5
6-May	81	65.2	72.5	57.9	50	104.3	72.3	72.6	50.1
13-May	81	62.2	73.4	58.7	52	116.2	74.2	76.3	52.8
20-May	82	65.1	74.4	59.9	54	109.9	74.7	75.9	53.2
27-May	84	66.5	76.6	61.9	55	109.9	76.1	80.4	58.4
4-Jun	84	65.7	77.3	63.3	57	110.6	76.4	84.7	63.1
10-Jun	86	68.3	78.7	65.9	61	118.3	74.6	92.1	71.9
17-Jun	87	75.3	80.3	67.9	63	133.7	79.8	100.5	80
24-Jun	88	74.5	80.3	69.8	63	133.7	80.7	109.2	89.4
1-Jul	90	76.8	82.3	71.7	64	141.4	83	117.4	96.7
8-Jul	91	78.2	84.2	73.8	68	142.1	83.5	124.1	104.5
15-Jul	93	77.8	86.8	75.8	70	142.1	83.9	128.8	108.7
22-Jul	93	78.8	88.3	76.7	69	149.8	86.4	131.6	111.2
29-Jul	93	78.5	89.3	77.7	72	150.5	85.9	133.2	111.6
5-Aug	95	78.7	89.8	78	73	150.5	86.9	133.1	112.1
12-Aug	95	78	90.5	77.9	72	151.9	84.7	134.3	111.6
19-Aug	95	78.3	89.3	77.8	73	149.8	85.2	135.1	114.6
26-Aug	95	78.2	88.3	76.3	72	143.5	84.5	129.5	107.9
2-Sep	93	76.8	86.9	74.8	70	142.1	82.5	123.5	100.9
9-Sep	91	77.1	84.9	73	68	141.4	82.8	120.3	98.1
16-Sep	90	76.1	83.5	71.4	64	141.4	81	113	90.8
23-Sep	90	76.5	81.5	68.9	61	133.7	82.2	103.1	81.7
30-Sep	86	72.1	79	66.6	61	125.3	78.7	96.2	74.6
7-Oct	84	72.5	77	63.8	57	116.9	77.9	87.7	66.9
14-Oct	82	70.1	75.5	61.5	54	116.9	76.8	81.1	60.6
21-Oct	79	64.4	73.1	58	52	98	70.9	71.2	52
28-Oct	77	64.6	70.8	56.3	48	97.3	70.6	69.1	49.2
4-Nov	75	63.5	68	53.5	45	91	68.4	61.8	43.9
11-Nov	75	63.8	67.6	53.4	46	90.3	69.2	63.4	44.9
18-Nov	72	61.9	63.3	49.8	43	85.4	66.6	55.1	37.7
25-Nov	70	60.4	60.7	46.2	39	79.8	65.4	49	33.1
2-Dec	68	60.8	58.9	45.5	37	74.9	61.8	48.4	32.4
9-Dec	64	54.2	56	42.4	35	70	61.7	42.8	27.6
16-Dec	61	53.6	53.7	41.8	34	65.1	59.4	39.6	25.8
23-Dec	63	54.8	52.7	40	34	60.9	58.2	37.5	24.9
31-Dec	60	50.4	51.3	38.4	32	57.4	55.8	35.4	22.7

Degree Days, Heating and Cooling (Base 65 F) & Cooling (Base 50F)

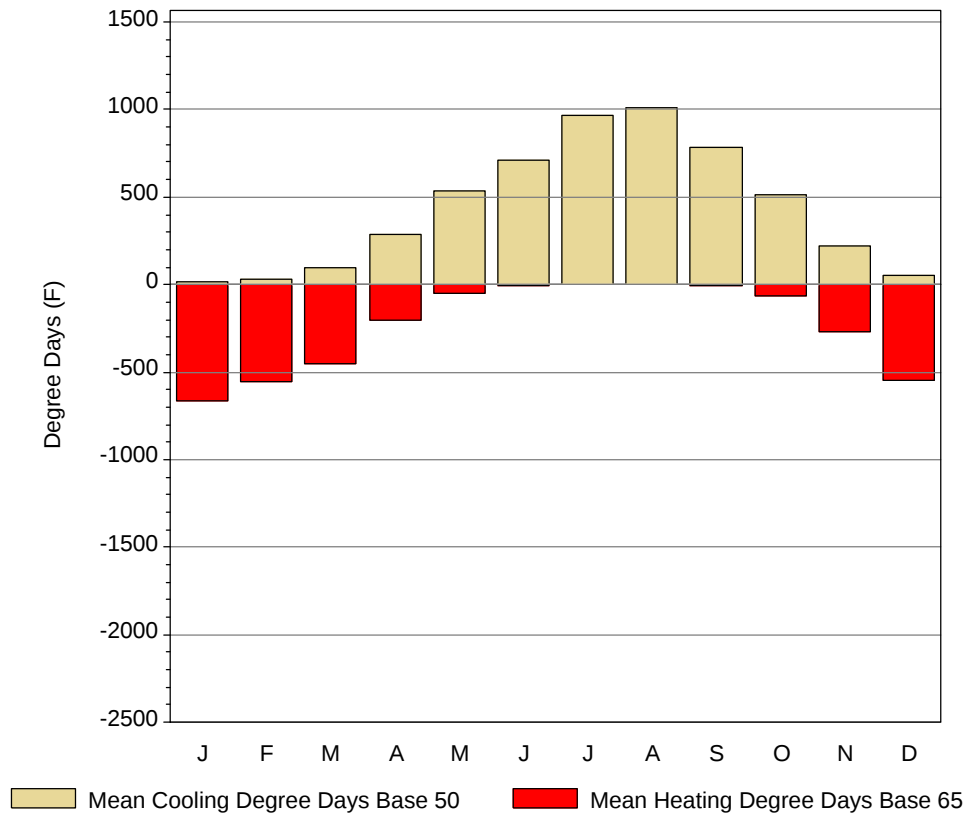

Month	Mean Cooling Degree Days (°F) Base 50	Mean Cooling Degree Days (°F) Base 65	Mean Heating Degree Days (°F) Base 65
JAN	17.6	0	662.2
FEB	33.6	0.6	557.8
MAR	99.9	3	450.6
APR	289.8	28.3	201
MAY	536.5	121.1	49.7
JUN	712.4	265.8	3.4
JUL	966.6	501.6	0
AUG	1010.4	545.4	0
SEP	783.7	336	2.3
OCT	511.3	111.6	65.8
NOV	222.1	14.4	265.4
DEC	51.3	0.1	547.8
ANN	5235.2	1927.9	2806

Average Ventilation and Infiltration Loads (Outside Air vs 75F, 60% RH summer; 68F, 30% RH winter)

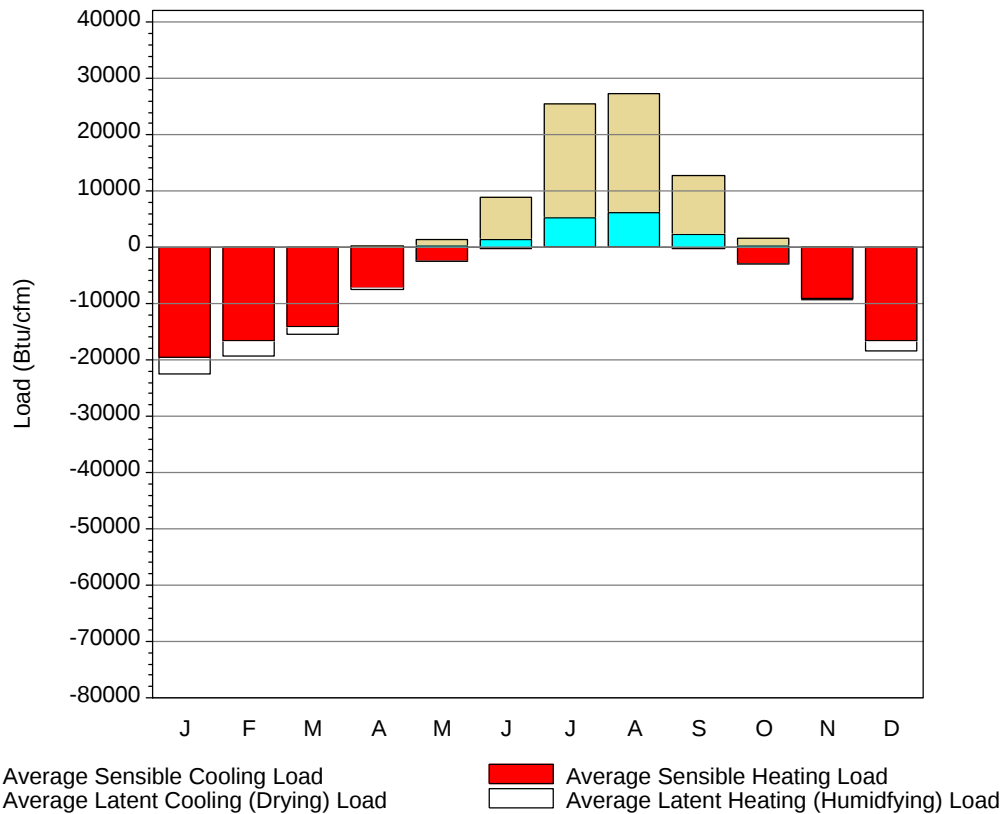

Month	Average Sensible Cooling Load (Btu/cfm)	Average Sensible Heating Load (Btu/cfm)	Average Latent Cooling Load (Btu/cfm)	Average Latent Heating Load (Btu/cfm)
JAN	0	-19575	0	-2936
FEB	0	-16643	1	-2556
MAR	0	-14042	7	-1488
APR	34	-7151	164	-364
MAY	329	-2399	1148	-29
JUN	1369	-299	7590	0
JUL	5277	-6	20230	0
AUG	6200	-1	21129	0
SEP	2339	-192	10391	0
OCT	242	-2858	1412	-9
NOV	5	-8971	124	-285
DEC	0	-16608	1	-1831
ANN	15795	-88745	62197	-9498

Station Information		Shading Geometry in Dimensionless Units	
City, State, WBAN	N/A	N/A	N/A
Lat, Lon, Elev	N/A	N/A	N/A
Press Stn Type	N/A	N/A	N/A

AVERAGE INCIDENT SOLAR RADIATION (Btu/sq.ft./day), Percentage Uncertainty = 9														
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ.	Global													
	Std.Dev.													
	Minimum													
	Maximum													
	Diffuse													
Clear Day	Global													
NORTH	Global													
	Diffuse													
Clear Day	Global													
EAST	Global													
	Diffuse													
Clear Day	Global													
SOUTH	Global													
	Diffuse													
Clear Day	Global													
WEST	Global													
	Diffuse													
Clear Day	Global													


Average Annual Solar Radiation - Nearest Available Site Source: National Renewable Energy Laboratory, Golden CO, 1995

AVERAGE TRANSMITTED SOLAR RADIATION (Btu/sq.ft./day) FOR DOUBLE GLAZING, Percentage Uncertainty = 9														
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ.	Unshaded													
NORTH	Unshaded													
	Shaded													
EAST	Unshaded													
	Shaded													
SOUTH	Unshaded													
	Shaded													
WEST	Unshaded													
	Shaded													


AVERAGE INCIDENT ILLUMINANCE (klux-hr) FOR MOSTLY CLEAR AND MOSTLY CLOUDY CONDITIONS, Percentage Uncertainty = 9												
				March						June		
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm	
HORIZ.	M.Clear											
	M.Cloudy											
NORTH	M.Clear											
	M.Cloudy											
EAST	M.Clear											
	M.Cloudy											
SOUTH	M.Clear											
	M.Cloudy											
WEST	M.Clear											
	M.Cloudy											
M.Clear	(% hrs)											

				Sept						Dec		
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm	
HORIZ.	M.Clear											
	M.Cloudy											
NORTH	M.Clear											
	M.Cloudy											
EAST	M.Clear											
	M.Cloudy											
SOUTH	M.Clear											
	M.Cloudy											
WEST	M.Clear											
	M.Cloudy											
M.Clear	(% hrs)											


Wind Summary - December, January, and February

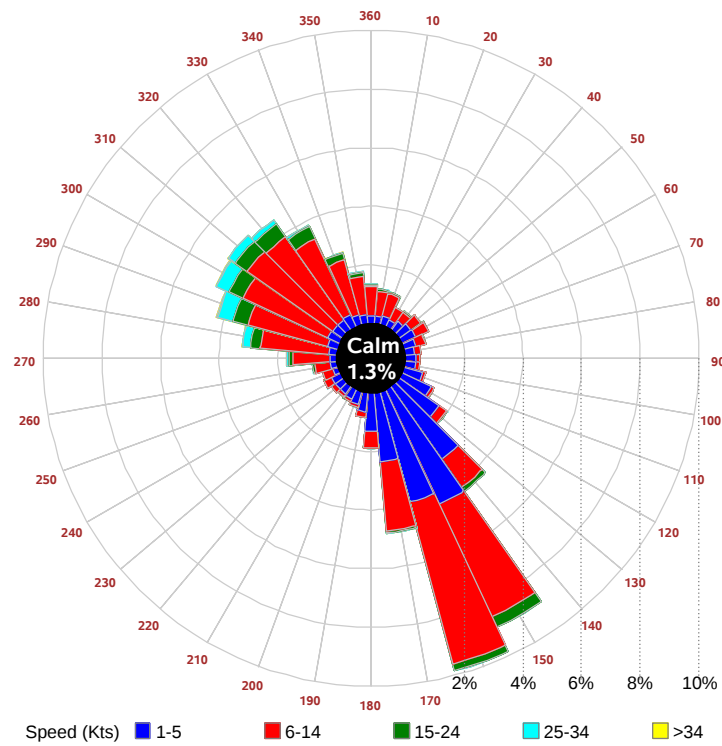

Wind Summary - March, April, and May

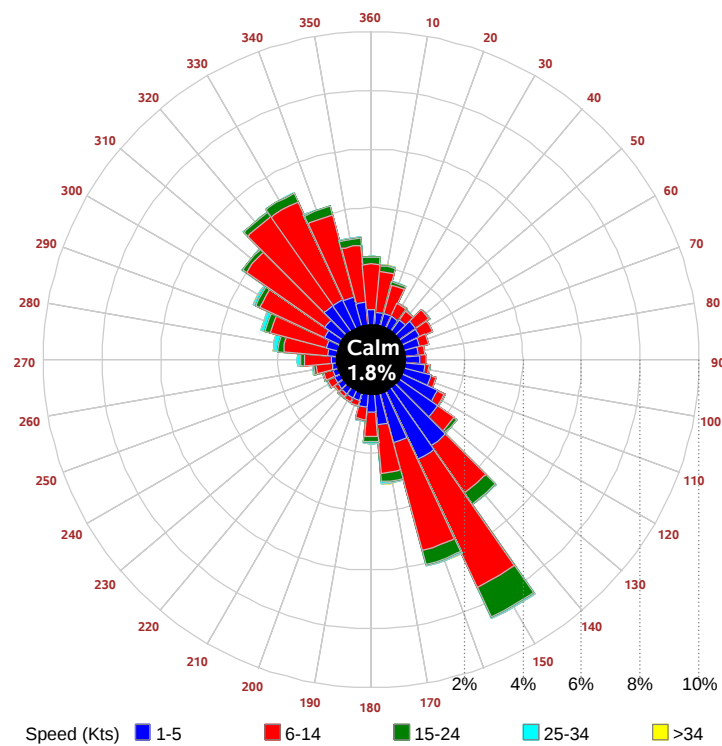

Wind Summary - June, July, and August

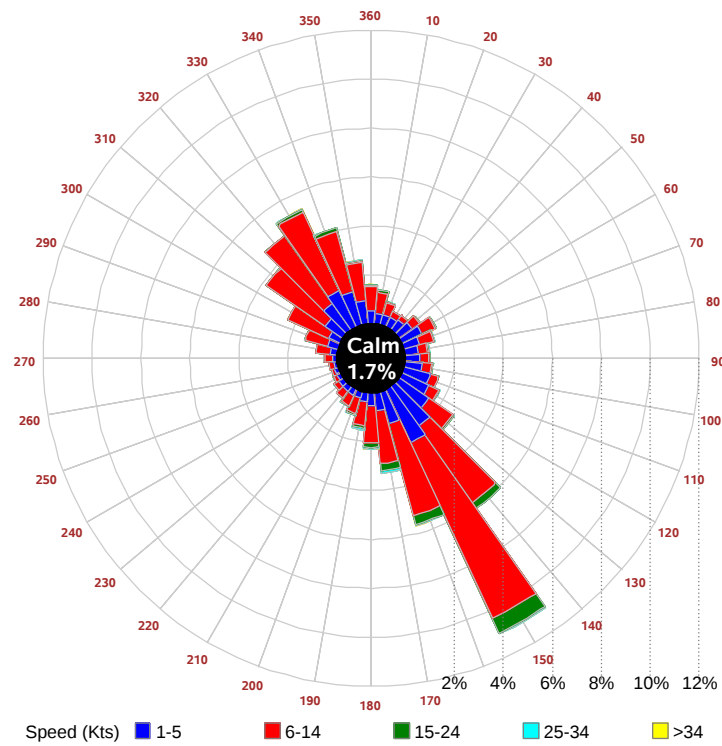

Wind Summary - September, October, and November

