

HOMESTEAD AFB	FL	
Latitude = 25.48 N		WMO No. 722026
Longitude = 80.38 W		Elevation = 7 feet
Period of Record = 1967 to 1996		Average Pressure = 29.99 inches Hg

Design Criteria Data

	Design Value	Mean Coincident (Average) Values			
		Wet Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Dry Bulb Temperature (T)	(°F)				
Median of Extreme Highs	93	79	124	6.9	SW
0.4% Occurrence	91	79	129	7.1	E
1.0% Occurrence	90	79	130	7.3	E
2.0% Occurrence	89	78	128	7.7	E
Mean Daily Range	13	-	-	-	-
97.5% Occurrence	55	50	46	5.4	N
99.0% Occurrence	50	45	37	6.0	N
99.6% Occurrence	46	42	31	6.2	NNW
Median of Extreme Lows	41	36	24	7.0	N
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Wet Bulb Temperature (T_{wb})	(°F)				
Median of Extreme Highs	83	90	159	7.5	E
0.4% Occurrence	81	88	147	6.8	E
1.0% Occurrence	80	88	142	7.0	E
2.0% Occurrence	79	87	136	6.8	E
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Vapor Pressure (in. Hg)	Wind Speed (mph)	Prevailing Direction (NSEW)
Humidity Ratio (HR)	(gr/lb)				
Median of Extreme Highs	160	87	1.05	6.0	E
0.4% Occurrence	151	86	1.00	5.9	E
1.0% Occurrence	146	86	0.97	5.5	E
2.0% Occurrence	141	84	0.94	5.4	E
Air Conditioning/ Humid Area Criteria	# of Hours	T ≥ 93°F	T ≥ 80°F	T _{wb} ≥ 73°F	T _{wb} ≥ 67°F
		14	3088	3741	6319

Other Site Data

Weather Region	Rain Rate 100 Year Recurrence (in./hr)	Basic Wind Speed 3 sec gust @ 33 ft 50 Year Recurrence (mph)	Ventilation Cooling Load Index (Ton-hr/cfm/yr) Base 75°F-RH 60% Latent + Sensible
10	4.5	150	10.8 + 2.8
Ground Water Temperature (°F) 50 Foot Depth *	Frost Depth 50 Year Recurrence (in.)	Ground Snow Load 50 Year Recurrence (lb/ft ²)	Average Annual Freeze-Thaw Cycles (#)
78.3	0	0	0


*Note: Temperatures at greater depths can be estimated by adding 1.5°F per 100 feet additional depth.

HOMESTEAD AFB

FL

WMO No. 722026

Average Annual Climate

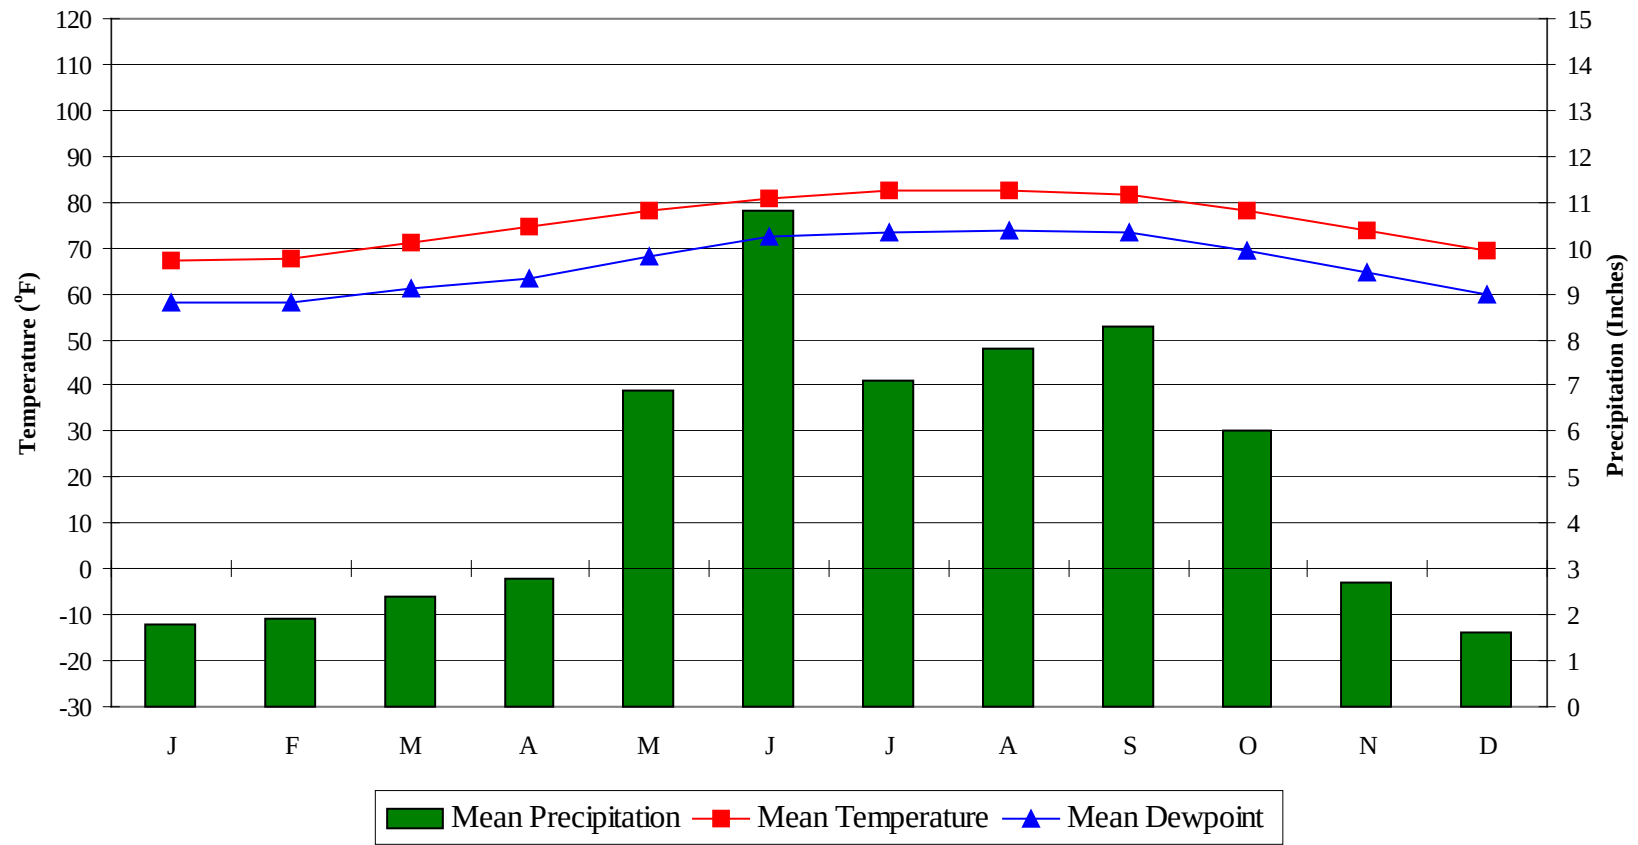


HOMESTEAD AFB

FL

WMO No. 722026

Long Term Psychrometric Summary

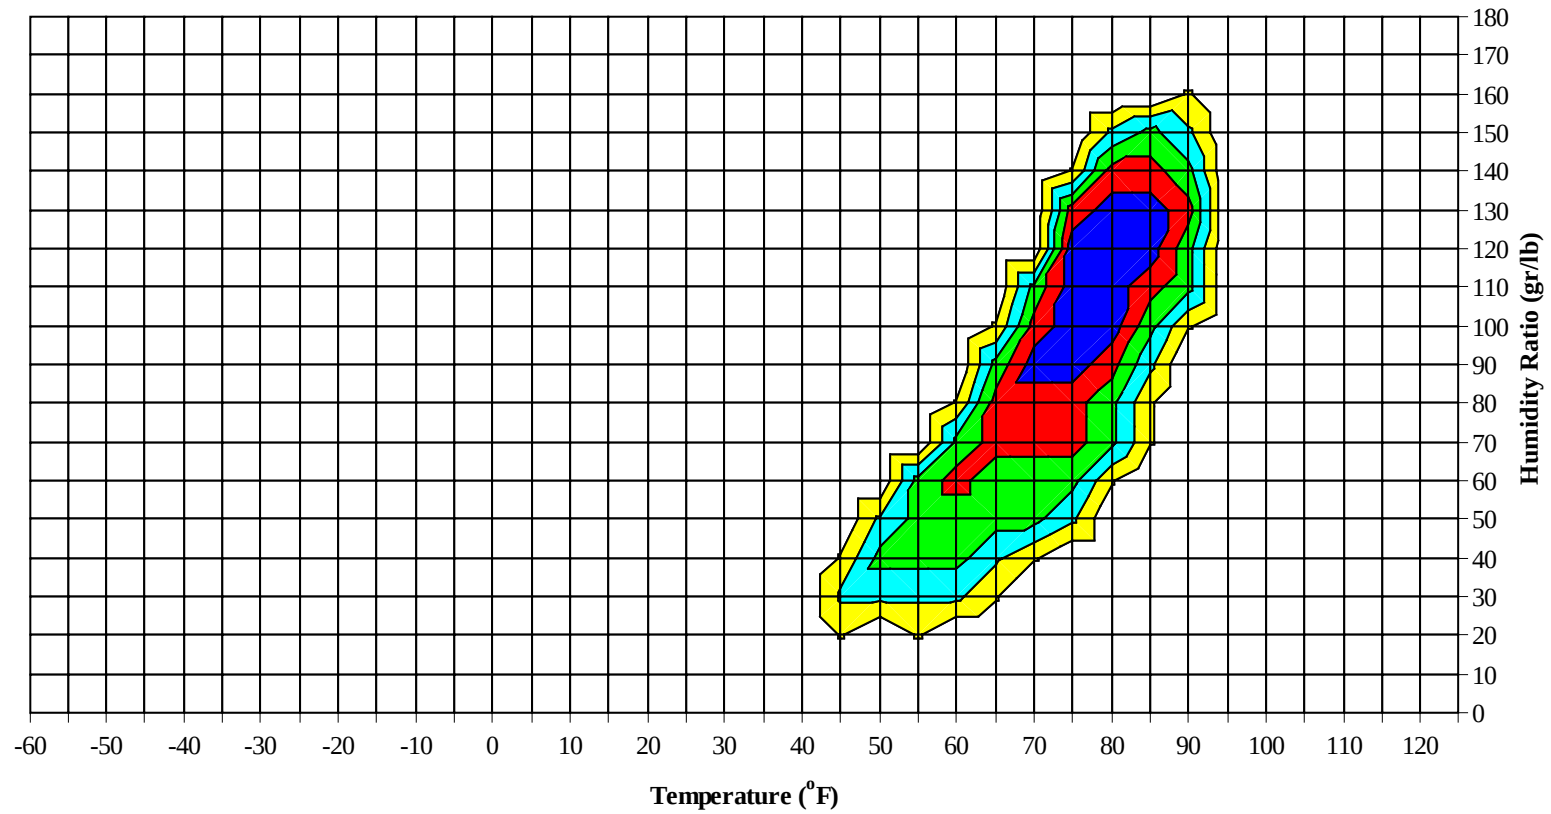


- 50% of all observations
- 80% of all observations
- 95% of all observations
- 97.5% of all observations
- 99% of all observations

HOMESTEAD AFB

FL

WMO No. 722026

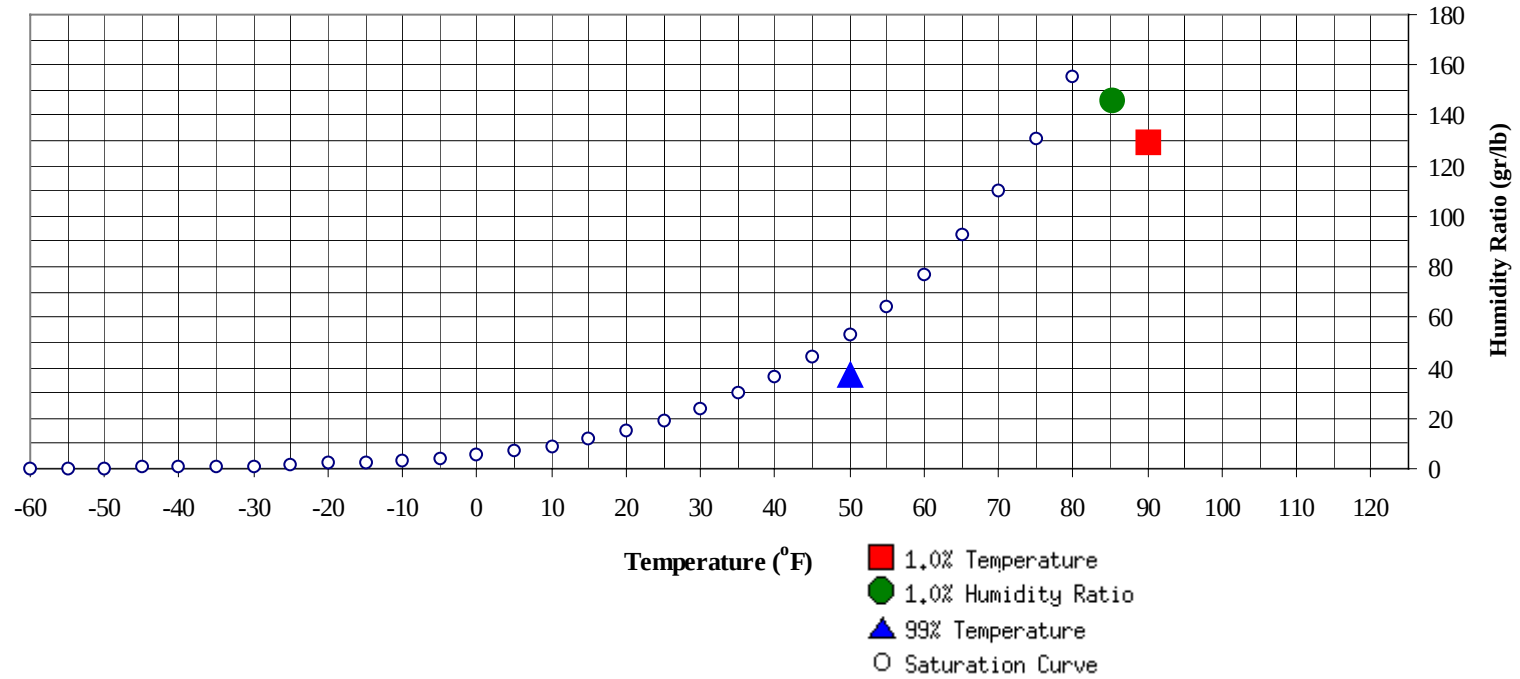Psychrometric Summary of Peak Design Values

	(°F)	MCHR	Enthalpy	1.0% Humidity	(gr/lb)	MCDB	MCWB	MC Dewpt	Enthalpy
		(gr/lb)	(btu/lb)			(°F)	(°F)	(°F)	(btu/lb)
99% Dry Bulb	50	37	17.7	Ratio	145.6	85.3	79.9	78	43.3

	(°F)	MCHR	MCWB	Enthalpy
		(gr/lb)	(°F)	(btu/lb)
1.0% Dry Bulb	90	129.6	78.7	42.0

HOMESTEAD AFB FL

WMO No. 722026

Dry-Bulb Temperature Hours For An Average Year (Sheet 1 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	January					February					March				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
95 / 99															
90 / 94															
85 / 89		1		1	74.4		1	0	1	74.7			0	0	70.5
80 / 84		26	1	27	72.2		28	2	30	72.1	1	57	10	69	73.5
75 / 79	7	87	26	121	69.5	5	74	27	106	69.0	23	101	54	177	72.0
70 / 74	56	57	83	196	66.5	49	56	71	176	66.0	88	51	106	244	69.2
65 / 69	60	35	65	160	62.2	54	34	59	147	61.8	64	17	47	128	66.3
60 / 64	42	22	36	100	57.1	43	17	39	98	57.3	32	10	20	62	62.0
55 / 59	33	11	21	66	52.4	35	10	17	62	52.4	23	4	8	35	57.4
50 / 54	26	6	11	43	47.3	23	3	7	33	47.5	12	1	2	15	52.4
45 / 49	15	2	3	20	42.7	11	1	2	14	42.6	4	0	0	4	48.1
40 / 44	5	1	1	7	37.6	3	0	0	3	38.5	1	0	0	1	43.8
35 / 39	2	0	0	2	34.3	1			1	34.3	0	0		0	38.4
30 / 34	1			1	30.1										34.8
25 / 29	0			0	28.0										

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

HOMESTEAD AFB FL

WMO No. 722026

Dry-Bulb Temperature Hours For An Average Year (Sheet 2 of 5)**Period of Record = 1967 to 1996**

Temperature Range (°F)	April					May					June				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
95 / 99						0			0		0			0	78.0
90 / 94		1	0	1	73.9	4	0		4	76.4	15	1		16	78.8
85 / 89		20	2	22	73.5	0	62	7	69	75.2	5	116	23	143	77.2
80 / 84	3	96	21	119	71.7	25	133	69	227	73.3	67	80	114	262	75.4
75 / 79	47	98	95	241	68.9	111	42	126	280	71.2	138	24	87	249	73.4
70 / 74	107	19	96	223	66.3	88	7	43	138	68.2	29	5	15	49	70.5
65 / 69	54	5	21	79	62.2	21	0	3	24	63.7	1	0	0	1	64.6
60 / 64	20	1	4	25	57.1	3		0	3	58.8					
55 / 59	7	0	1	8	52.8	0			0	54.4					
50 / 54	1			1	47.4										
45 / 49															
40 / 44															
35 / 39															
30 / 34															
25 / 29															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

HOMESTEAD AFB FL

WMO No. 722026

Dry-Bulb Temperature Hours For An Average Year (Sheet 3 of 5)**Period of Record = 1967 to 1996**

Temperature Range (°F)	July					August					September				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
95 / 99		1	0	1	77.2		2		2	80.4		0		0	81.0
90 / 94	0	34	3	37	78.9	0	38	2	40	79.0	0	17	1	19	78.8
85 / 89	10	156	48	214	77.6	13	150	49	212	78.0	6	140	27	173	77.6
80 / 84	112	42	136	290	75.8	115	42	135	292	76.1	85	62	132	279	75.9
75 / 79	114	13	56	183	73.6	111	14	58	183	74.0	132	17	74	224	73.8
70 / 74	11	2	5	18	70.4	9	2	3	14	71.4	16	3	6	25	71.1
65 / 69	0			0	68.0	0		0	0	67.2	0		0	0	66.9
60 / 64													0	0	64.0
55 / 59															
50 / 54															
45 / 49															
40 / 44															
35 / 39															
30 / 34															
25 / 29															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

HOMESTEAD AFB FL

WMO No. 722026

Dry-Bulb Temperature Hours For An Average Year (Sheet 4 of 5)**Period of Record = 1967 to 1996**

Temperature Range (°F)	October					November					December				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
95 / 99															
90 / 94		3	0	3	77.6										
85 / 89	1	66	6	73	76.8		10	0	10	75.9		1	0	1	76.2
80 / 84	31	128	73	232	74.3	5	93	17	116	73.5	0	46	2	48	72.6
75 / 79	115	40	126	281	72.1	57	87	91	235	70.7	22	95	46	163	69.7
70 / 74	75	10	38	123	68.4	80	31	86	198	67.1	71	53	95	219	66.4
65 / 69	20	1	4	25	63.2	49	11	28	88	62.5	59	25	51	135	62.2
60 / 64	5	0	1	6	57.1	28	5	12	45	57.3	38	15	27	81	56.9
55 / 59	1	0	0	1	52.9	14	1	5	20	51.9	23	8	15	46	52.1
50 / 54	0			0	47.3	5	1	1	7	47.8	21	4	8	33	47.2
45 / 49						1	0	0	1	44.5	10	1	2	13	42.6
40 / 44											3	0	1	4	38.0
35 / 39											1	0	0	1	32.9
30 / 34											0			0	30.2
25 / 29															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

HOMESTEAD AFB FL

WMO No. 722026


Dry-Bulb Temperature Hours For An Average Year (Sheet 5 of 5)

Period of Record = 1967 to 1996


Annual Totals					
Temperature Range (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00		
95 / 99		3	0	3	79.1
90 / 94	0	112	7	119	78.7
85 / 89	37	731	164	932	77.2
80 / 84	449	834	711	1993	74.6
75 / 79	886	692	867	2445	71.4
70 / 74	679	295	649	1623	67.0
65 / 69	381	129	277	787	62.2
60 / 64	210	69	139	418	57.2
55 / 59	136	34	67	236	52.3
50 / 54	87	14	29	131	47.4
45 / 49	40	4	7	51	42.8
40 / 44	11	2	2	15	38.0
35 / 39	3	1	0	4	34.0
30 / 34	1			1	30.1
25 / 29	0			0	28.0

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Annual Summary of Temperatures

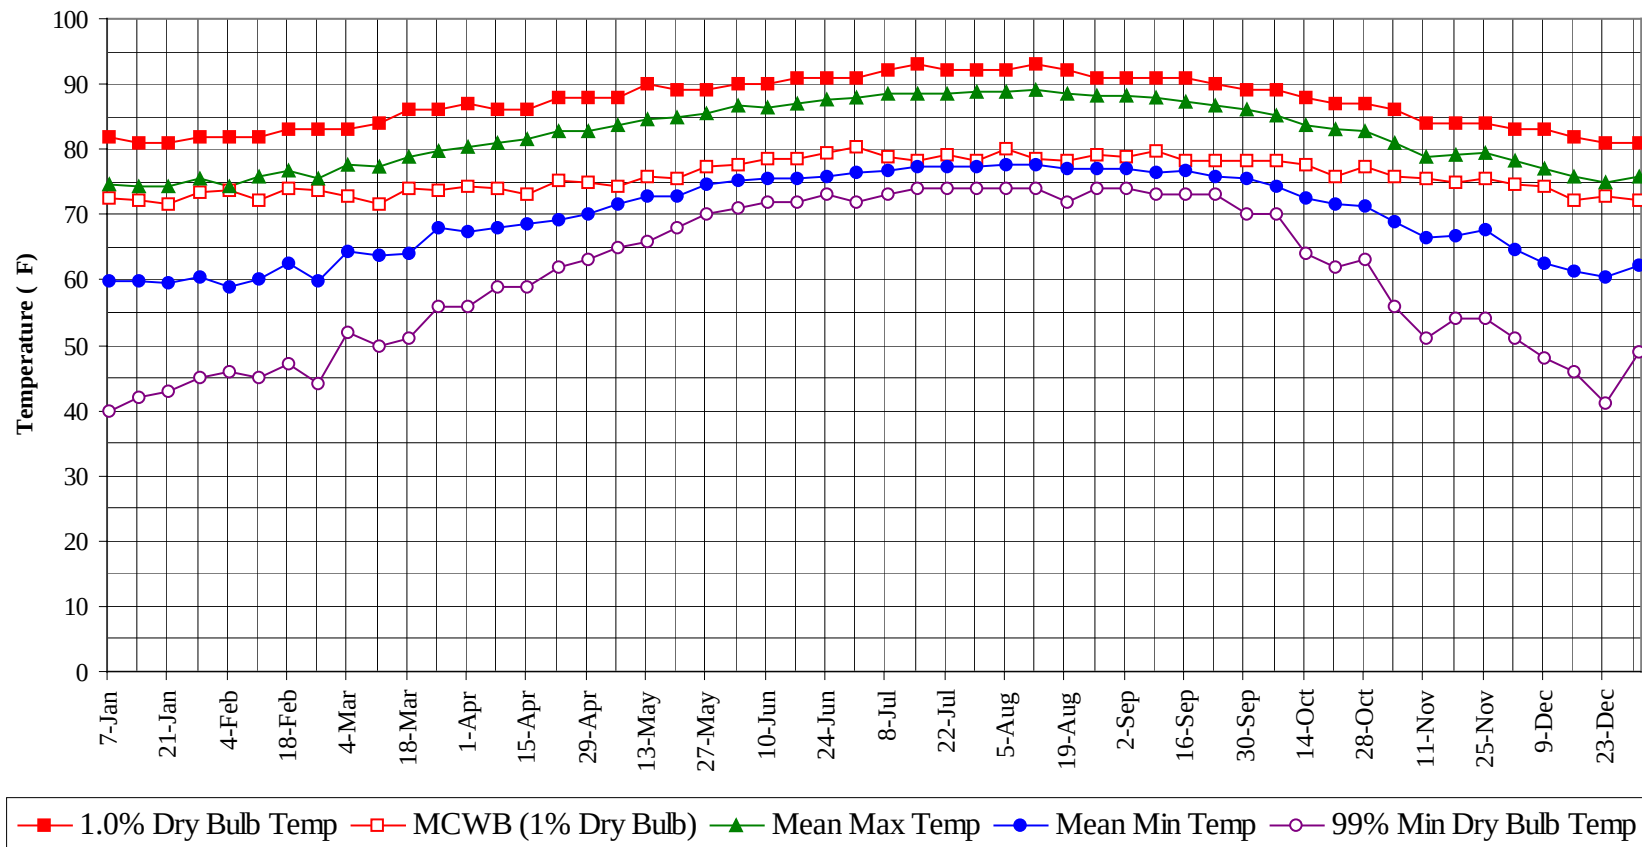

Long Term Humidity and Dry Bulb Temperature Summary

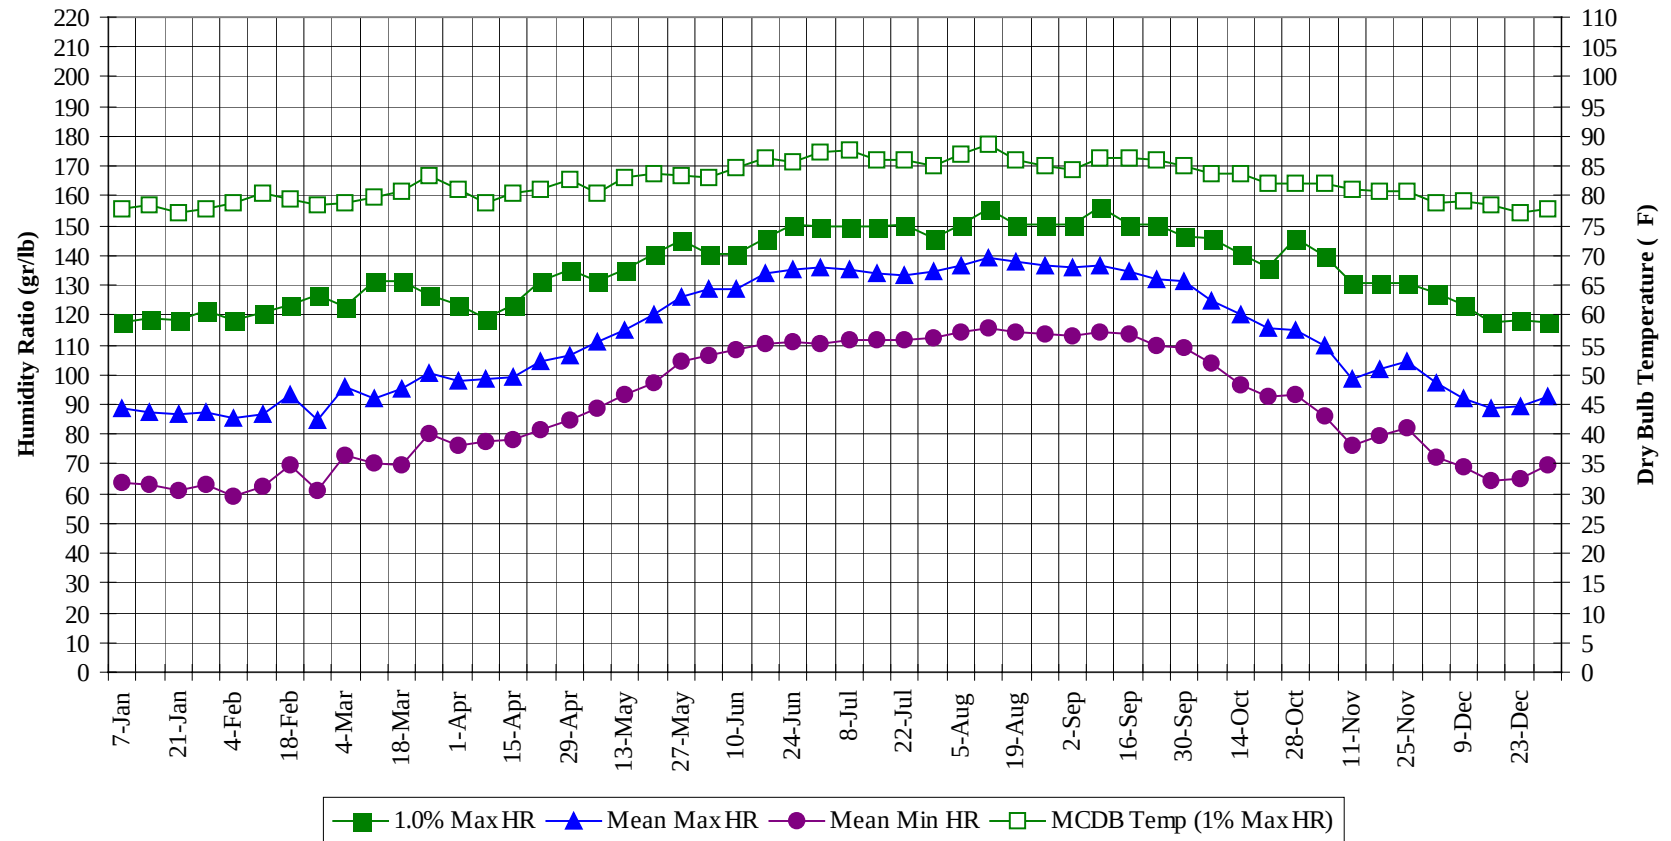

HOMESTEAD AFB**FL****WMO No. 722026****Long Term Dry Bulb Temperature and Humidity Summary**


Week Ending	1.0% Temp (°F)	MCWB @ 1% Temp (°F)	Mean Max Temp (°F)	Mean Min Temp (°F)	99% Temp (°F)	1.0% HR (gr/lb)	MCDB @ 1% HR (°F)	Mean Max HR (gr/lb)	Mean Min HR (gr/lb)
7-Jan	82.0	72.6	74.8	59.9	40.0	117.6	77.8	88.9	63.7
14-Jan	81.0	72.3	74.5	59.9	42.0	119.0	78.6	87.6	63.2
21-Jan	81.0	71.6	74.4	59.5	43.0	118.3	77.3	87.0	61.3
28-Jan	82.0	73.3	75.5	60.3	45.0	121.8	77.9	87.3	63.1
4-Feb	82.0	73.7	74.4	58.9	46.0	118.3	78.9	85.6	59.2
11-Feb	82.0	72.3	75.7	60.1	45.0	121.1	80.5	86.9	62.6
18-Feb	83.0	74.0	76.6	62.5	47.0	123.2	79.5	93.1	69.4
25-Feb	83.0	73.6	75.5	59.8	44.0	126.7	78.4	85.0	61.3
4-Mar	83.0	72.8	77.7	64.3	52.0	122.5	78.7	95.6	72.7
11-Mar	84.0	71.6	77.4	63.7	50.0	131.6	79.8	92.1	70.0
18-Mar	86.0	74.0	78.8	64.1	51.0	131.6	80.9	95.3	69.7
25-Mar	86.0	73.6	79.9	68.0	56.0	126.7	83.2	100.2	79.9
1-Apr	87.0	74.4	80.4	67.2	56.0	123.2	81.2	98.0	76.2
8-Apr	86.0	73.9	80.9	67.9	59.0	119.0	78.7	98.4	77.4
15-Apr	86.0	73.2	81.5	68.6	59.0	123.2	80.4	99.2	77.9
22-Apr	88.0	75.4	82.7	69.2	62.0	131.6	81.2	104.7	81.7
29-Apr	88.0	74.8	82.8	70.1	63.0	135.1	82.6	106.5	84.7
6-May	88.0	74.4	83.8	71.6	65.0	131.6	80.3	110.9	88.8
13-May	90.0	75.9	84.5	72.8	66.0	135.1	83.0	115.1	93.4
20-May	89.0	75.6	85.0	72.9	68.0	140.7	83.6	120.3	97.2
27-May	89.0	77.2	85.6	74.7	70.0	144.9	83.4	126.4	104.4
3-Jun	90.0	77.8	86.6	75.2	71.0	140.7	83.1	128.4	106.4
10-Jun	90.0	78.6	86.3	75.7	72.0	140.7	84.8	128.9	108.5
17-Jun	91.0	78.6	87.0	75.6	72.0	145.6	86.5	133.8	110.6
24-Jun	91.0	79.5	87.5	75.9	73.0	150.5	85.8	135.2	111.2
1-Jul	91.0	80.2	87.9	76.3	72.0	149.8	87.3	135.7	110.2
8-Jul	92.0	78.8	88.4	76.9	73.0	149.8	87.8	135.5	111.9
15-Jul	93.0	78.2	88.6	77.3	74.0	149.8	86.0	134.2	111.9
22-Jul	92.0	79.0	88.4	77.4	74.0	150.5	86.2	133.6	111.7
29-Jul	92.0	78.3	88.7	77.3	74.0	145.6	84.9	134.5	112.2
5-Aug	92.0	80.0	88.8	77.7	74.0	150.5	87.1	136.8	114.1
12-Aug	93.0	78.6	89.0	77.6	74.0	155.4	88.5	139.2	115.4
19-Aug	92.0	78.4	88.6	77.0	72.0	150.5	86.0	138.2	114.4
26-Aug	91.0	79.1	88.1	77.2	74.0	150.5	85.1	136.6	113.7
2-Sep	91.0	78.8	88.1	77.1	74.0	150.5	84.3	135.7	113.2
9-Sep	91.0	79.8	87.8	76.6	73.0	156.1	86.4	136.3	114.1
16-Sep	91.0	78.4	87.5	76.7	73.0	150.5	86.4	134.7	113.9
23-Sep	90.0	78.4	86.6	75.7	73.0	150.5	86.1	131.9	110.0
30-Sep	89.0	78.4	86.0	75.4	70.0	146.3	84.9	131.4	108.8
7-Oct	89.0	78.4	85.2	74.2	70.0	145.6	83.8	124.8	103.6
14-Oct	88.0	77.6	83.6	72.6	64.0	140.7	83.7	120.2	96.6
21-Oct	87.0	75.9	83.1	71.6	62.0	135.8	82.1	115.8	92.9
28-Oct	87.0	77.2	82.7	71.3	63.0	145.6	82.0	115.2	93.1
4-Nov	86.0	75.9	81.0	68.8	56.0	140.0	82.1	109.7	85.8
11-Nov	84.0	75.4	79.0	66.4	51.0	130.9	81.0	98.8	76.4
18-Nov	84.0	74.9	79.3	66.9	54.0	130.9	80.8	101.5	79.3
25-Nov	84.0	75.6	79.4	67.5	54.0	130.9	80.6	104.4	82.0
2-Dec	83.0	74.6	78.2	64.7	51.0	127.4	78.7	96.9	72.3
9-Dec	83.0	74.3	77.1	62.6	48.0	123.2	79.3	91.7	69.0
16-Dec	82.0	72.2	75.9	61.3	46.0	117.6	78.4	88.7	64.2
23-Dec	81.0	72.9	74.9	60.5	41.0	118.3	77.1	89.2	64.9
31-Dec	81.0	72.2	75.8	62.3	49.0	117.6	77.9	92.4	69.5

HOMESTEAD AFB

FL

WMO No. 722026

Degree Days, Heating and Cooling
(Base 65°F)

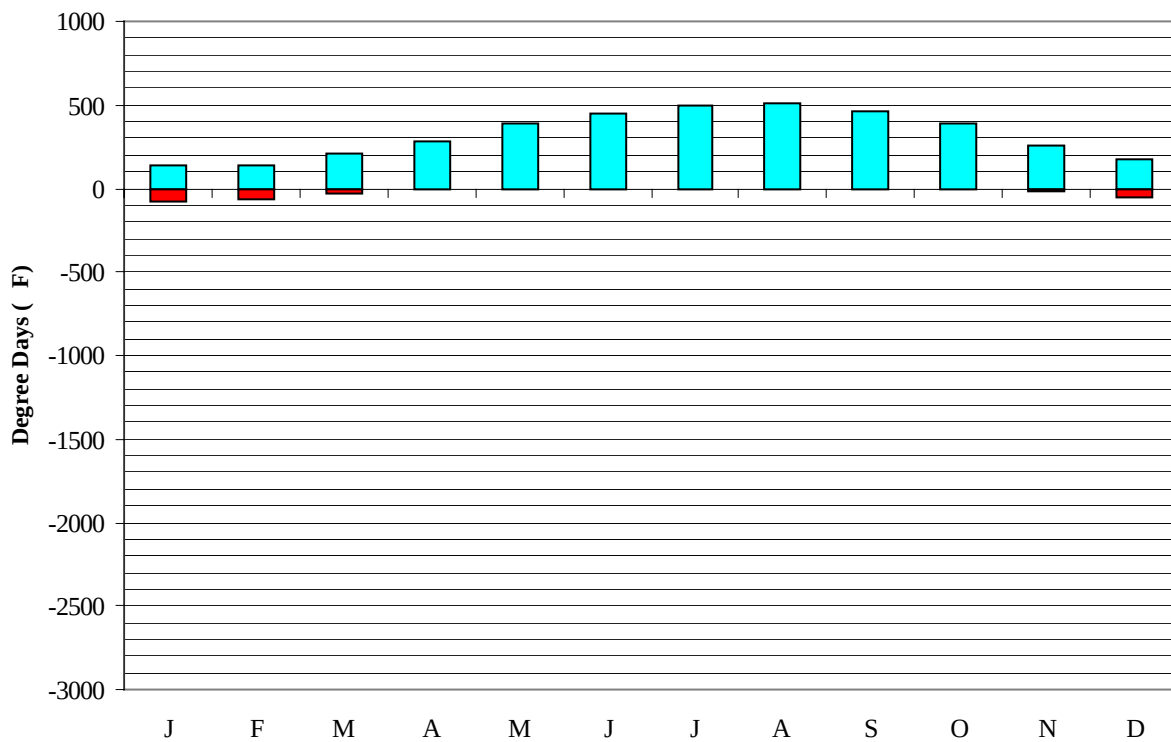

■ Mean Cooling Degree Days ■ Mean Heating Degree Days



	Mean Cooling Degree Days (°F)	Mean Heating Degree Days (°F)
JAN	140	75
FEB	133	61
MAR	214	29
APR	280	6
MAY	386	0
JUN	448	0
JUL	501	0
AUG	510	0
SEP	458	0
OCT	389	1
NOV	257	14
DEC	173	51
ANN	3888	237

HOMESTEAD AFB

FL

WMO No. 722026

Average Ventilation and Infiltration Loads
(Outside Air vs. 75°F, 60% RH summer; 68°F, 30% RH winter)

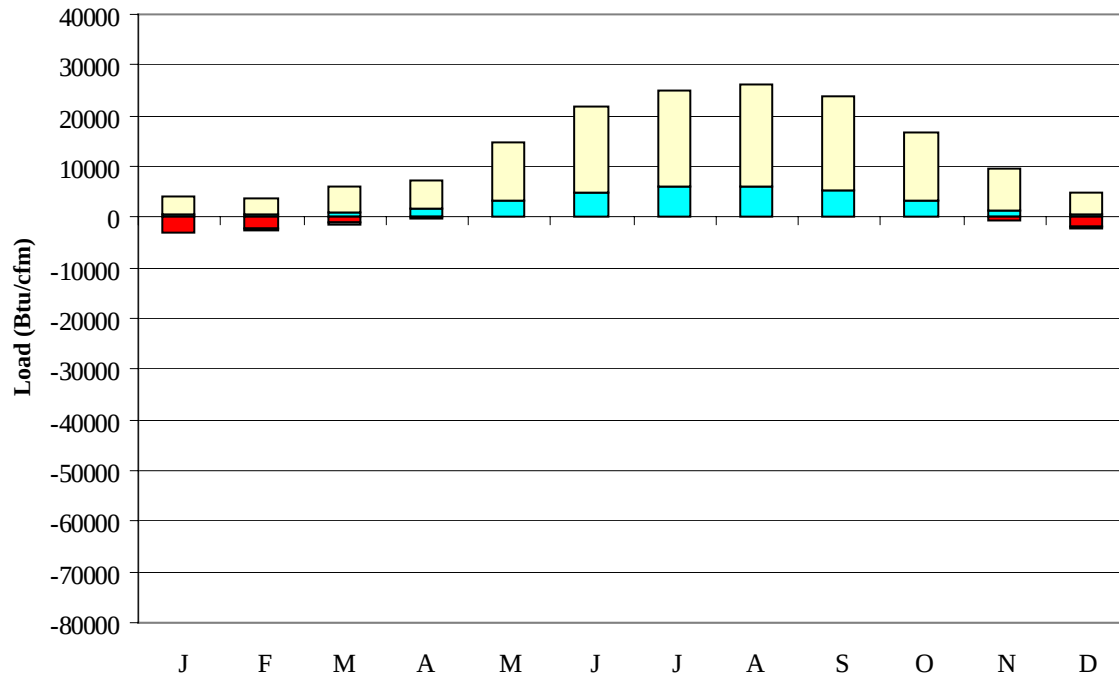

	Average Sensible Cooling Load (Btu/cfm)	Average Sensible Heating Load (Btu/cfm)	Average Latent Cooling Load (Btu/cfm)	Average Latent Heating Load (Btu/cfm)
JAN	401	-2857	3640	-111
FEB	425	-2424	3379	-73
MAR	911	-1242	5217	-20
APR	1640	-316	5656	-2
MAY	3250	-35	11522	0
JUN	4745	-1	16915	0
JUL	6044	0	18860	0
AUG	6207	0	20008	0
SEP	5108	0	18519	0
OCT	3358	-63	13344	0
NOV	1457	-675	8041	-1
DEC	601	-1996	4381	-71
ANN	34147	-9609	129482	-278

Average Annual Solar Radiation – Nearest Available Site

(Source: National Renewable Energy Laboratory, Golden CO, 1995)

City: MIAMI
 State: FL
 WBAN No: 12839
 Lat(N): 25.8
 Long(W): 80.27
 Elev(ft): 7

Stn Type: Primary
 SHADING GEOMETRY IN DIMENSIONLESS UNITS

Window: 1
 Overhang: 1.395
 Vert Gap: 0.2

AVERAGE INCIDENT SOLAR RADIATION (Btu/sq.ft./day), Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Global	1120	1340	1630	1900	1890	1770	1850	1770	1550	1380	1160	1040	1530
	Std Dev	70	94	106	129	130	111	138	89	107	88	76	76	48
	Minimum	990	1150	1410	1610	1610	1560	1500	1550	1300	1230	1010	900	1430
	Maximum	1270	1480	1820	2110	2180	1980	2100	1900	1780	1580	1280	1160	1620
	Diffuse	460	540	680	780	890	950	960	920	810	660	520	440	720
Clear Day	Global	1460	1750	2100	2380	2490	2510	2460	2340	2100	1780	1480	1350	2020
NORTH	Global	300	350	420	480	580	630	610	520	440	390	320	290	440
	Diffuse	300	350	410	470	510	540	540	500	440	390	320	290	420
Clear Day	Global	260	310	370	450	610	730	670	500	400	340	280	250	430
EAST	Global	690	800	940	1030	1020	960	990	960	880	810	710	650	870
	Diffuse	370	430	520	600	630	630	650	630	570	490	400	360	520
Clear Day	Global	930	1070	1210	1310	1310	1290	1260	1240	1170	1050	920	860	1130
SOUTH	Global	1320	1250	1080	810	590	520	550	680	860	1100	1240	1310	940
	Diffuse	490	520	560	550	520	510	520	550	570	570	520	480	530
Clear Day	Global	1990	1820	1440	930	600	500	540	770	1200	1620	1870	1960	1270
WEST	Global	670	780	920	1030	970	860	910	900	800	770	670	630	820
	Diffuse	380	430	530	590	620	610	630	610	550	490	400	360	520
Clear Day	Global	930	1070	1210	1310	1310	1290	1260	1240	1170	1050	920	860	1130

Average Annual Solar Heat and Illumination – Nearest Available Site


(Source: National Renewable Energy Laboratory, Golden CO, 1995)

AVERAGE TRANSMITTED SOLAR RADIATION (Btu/sq.ft./day) FOR DOUBLE GLAZING, Percentage Uncertainty = 9														
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ NORTH	Unshaded	780	950	1170	1390	1370	1280	1340	1280	1120	990	810	720	1100
	Unshaded	210	240	290	330	370	400	400	350	310	270	220	200	300
	Shaded	150	170	210	240	250	250	260	240	210	190	160	140	200
EAST	Unshaded	480	570	670	740	720	680	700	680	620	570	490	450	610
	Shaded	270	300	350	380	370	340	360	350	320	300	260	250	320
SOUTH	Unshaded	960	870	690	480	370	350	370	420	540	750	900	960	640
	Shaded	270	220	250	260	250	240	250	250	250	230	240	290	250
WEST	Unshaded	470	550	650	730	680	600	640	630	560	540	470	430	580
	Shaded	260	300	340	380	350	310	330	320	290	290	250	240	310

AVERAGE INCIDENT ILLUMINANCE (klux-hr) FOR MOSTLY CLEAR AND MOSTLY CLOUDY CONDITIONS, Percentage Uncertainty = 9											
		March					June				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	39	79	94	80	39	32	74	101	99	71
	M.Cloudy	28	60	71	59	28	24	58	74	69	45
NORTH	M.Clear	11	16	17	17	11	23	23	19	19	24
	M.Cloudy	11	18	19	18	11	16	21	19	19	19
EAST	M.Clear	70	64	18	17	11	55	69	40	19	18
	M.Cloudy	39	46	19	18	11	32	51	32	19	16
SOUTH	M.Clear	28	55	66	55	28	11	18	23	22	18
	M.Cloudy	18	41	49	40	18	10	18	22	21	16
WEST	M.Clear	11	16	18	64	70	11	18	19	47	73
	M.Cloudy	11	18	19	45	37	10	18	19	34	39
M.Clear	(% hrs)	48	35	32	37	43	36	23	21	20	21


		Sept					Dec				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	21	67	93	92	57	23	58	69	51	14
	M.Cloudy	17	53	72	67	40	16	42	50	37	10
NORTH	M.Clear	8	17	20	19	16	8	13	15	13	6
	M.Cloudy	7	17	20	20	15	7	14	16	13	5
EAST	M.Clear	43	70	39	19	16	50	49	15	13	6
	M.Cloudy	25	50	33	20	15	23	32	16	13	5
SOUTH	M.Clear	12	40	56	55	33	39	75	85	68	27
	M.Cloudy	9	31	44	40	23	19	46	52	39	12
WEST	M.Clear	8	17	20	51	70	8	13	20	54	38
	M.Cloudy	7	17	20	38	41	7	14	19	32	16
M.Clear	(% hrs)	37	22	16	16	20	50	43	37	41	46

Wind Summary - December, January, and February **Labels of Percent Frequency on North Axis**

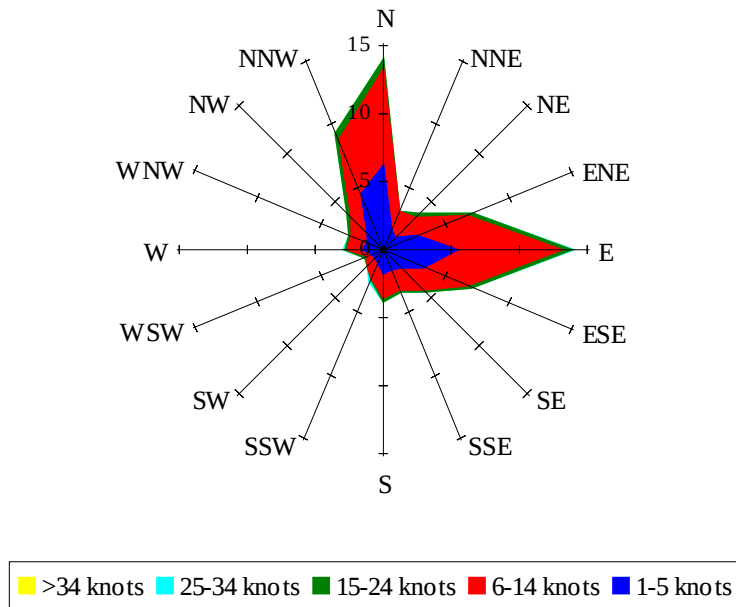

Percent Calm = 15.88


Wind Summary - March, April, and May **Labels of Percent Frequency on North Axis**

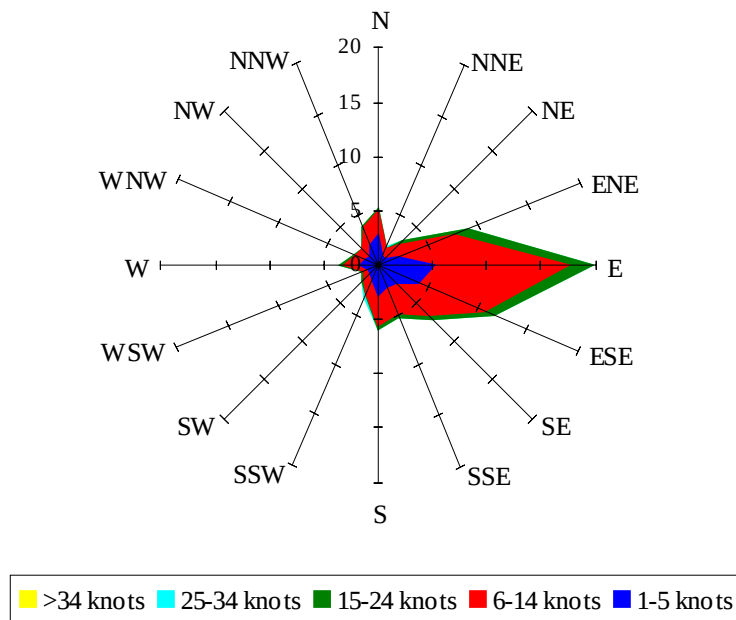

Percent Calm = 13.24

Wind Summary - June, July, and August


Labels of Percent Frequency on North Axis

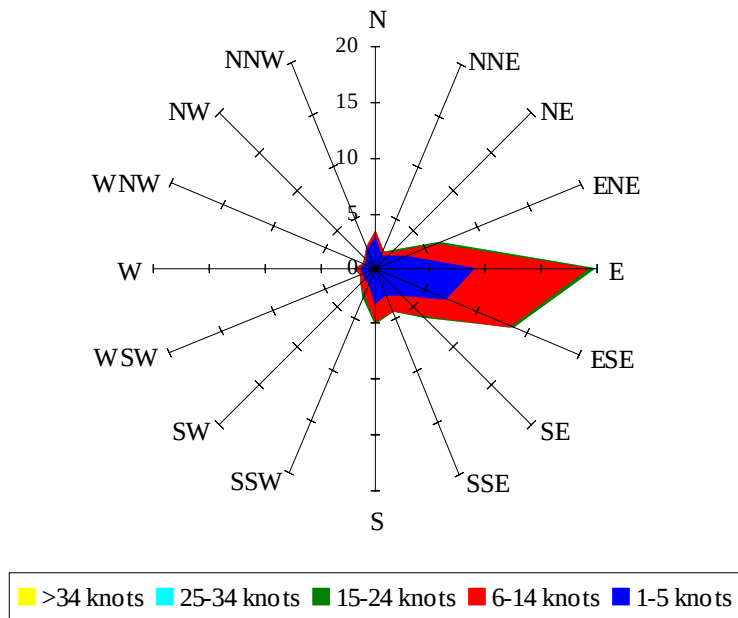

Percent Calm = 25.74

Wind Summary - September, October, and November

Labels of Percent Frequency on North Axis

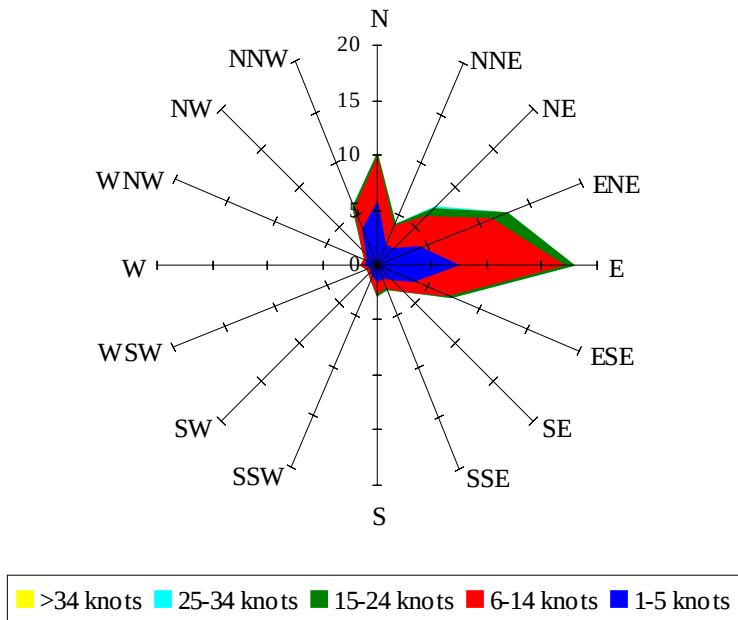

Percent Calm = 18.54