

RANDOLPH AFB TX	
Latitude = 29.53 N	WMO No. 722536
Longitude = 98.28 W	Elevation = 761 feet
Period of Record = 1967 to 1996	Average Pressure = 29.18 inches Hg

Design Criteria Data

	Design Value	Mean Coincident (Average) Values			
		Wet Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Dry Bulb Temperature (T)	(°F)				
Median of Extreme Highs	100	74	88	8.7	SSE
0.4% Occurrence	98	74	93	8.8	SSE
1.0% Occurrence	96	74	96	8.6	S
2.0% Occurrence	94	74	98	8.4	S
Mean Daily Range	21	-	-	-	-
97.5% Occurrence	36	33	22	6.7	N
99.0% Occurrence	31	28	17	7.1	N
99.6% Occurrence	27	24	13	7.0	N
Median of Extreme Lows	21	18	9	7.2	N
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Wet Bulb Temperature (T_{wb})	(°F)				
Median of Extreme Highs	81	92	141	9.6	S
0.4% Occurrence	78	89	127	9.1	S
1.0% Occurrence	77	87	123	8.6	S
2.0% Occurrence	77	87	123	8.6	S
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Vapor Pressure (in. Hg)	Wind Speed (mph)	Prevailing Direction (NSEW)
Humidity Ratio (HR)	(gr/lb)				
Median of Extreme Highs	151	84	0.97	8.4	S
0.4% Occurrence	137	82	0.88	8.4	SSE
1.0% Occurrence	134	81	0.88	7.0	S
2.0% Occurrence	130	80	0.85	6.8	S
Air Conditioning/ Humid Area Criteria	# of Hours	T ≥ 93°F	T ≥ 80°F	T _{wb} ≥ 73°F	T _{wb} ≥ 67°F
		286	1936	1759	3785

Other Site Data

Weather Region	Rain Rate 100 Year Recurrence (in./hr)	Basic Wind Speed 3 sec gust @ 33 ft 50 Year Recurrence (mph)	Ventilation Cooling Load Index (Ton-hr/cfm/yr) Base 75°F-RH 60% Latent + Sensible
10	4.3	90	5.5 + 2.2
Ground Water Temperature (°F) 50 Foot Depth *	Frost Depth 50 Year Recurrence (in.)	Ground Snow Load 50 Year Recurrence (lb/ft ²)	Average Annual Freeze-Thaw Cycles (#)
70.1	0	4	13


*Note: Temperatures at greater depths can be estimated by adding 1.5°F per 100 feet additional depth.

RANDOLPH AFB

TX

WMO No. 722536

Average Annual Climate

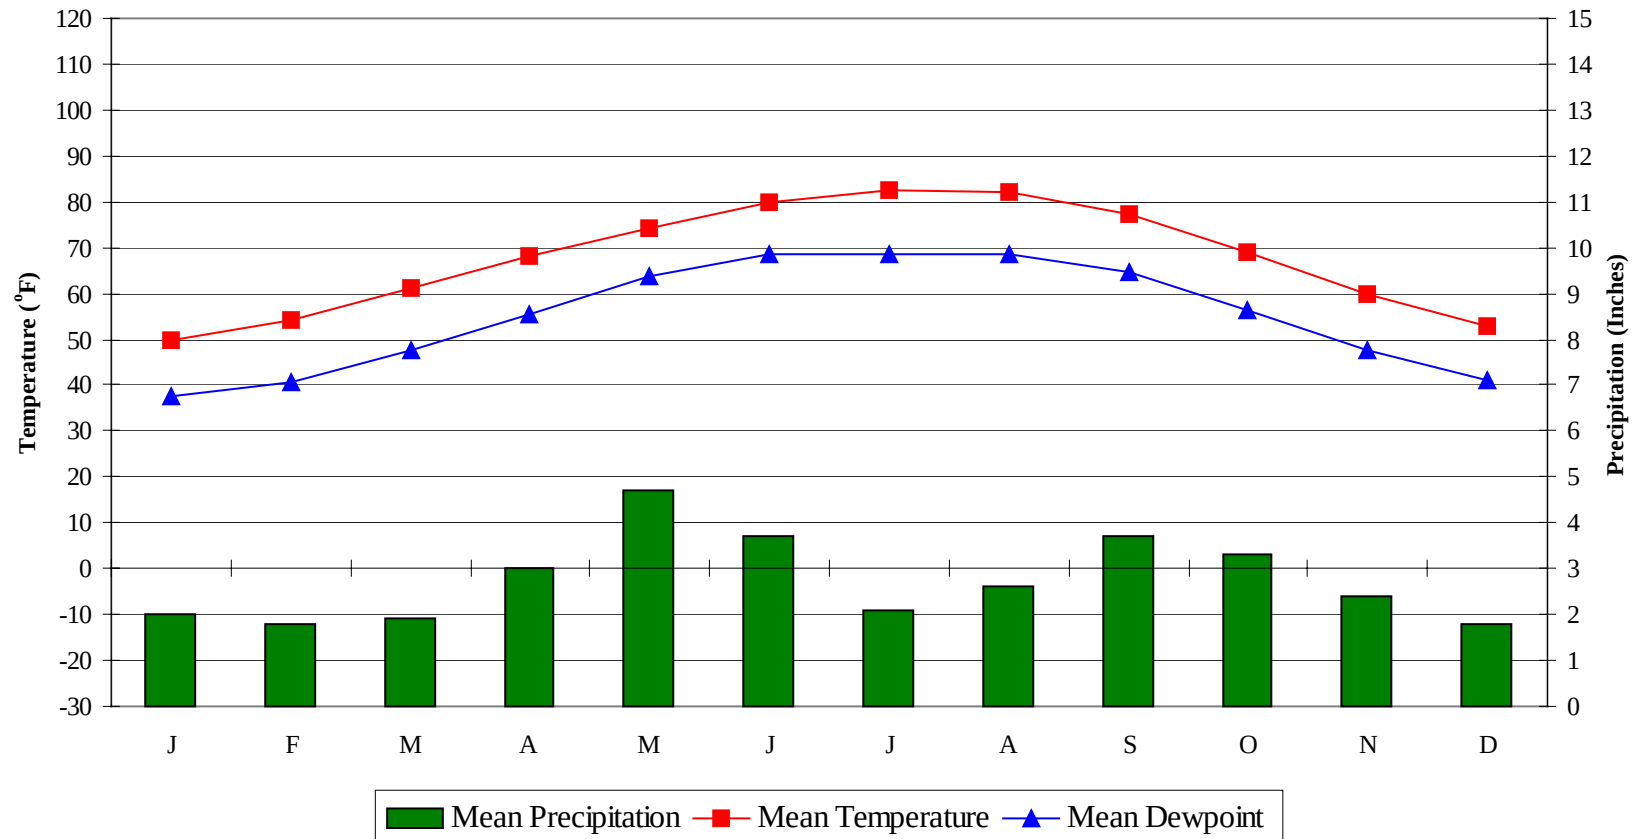


RANDOLPH AFB

TX

WMO No. 722536

Long Term Psychrometric Summary

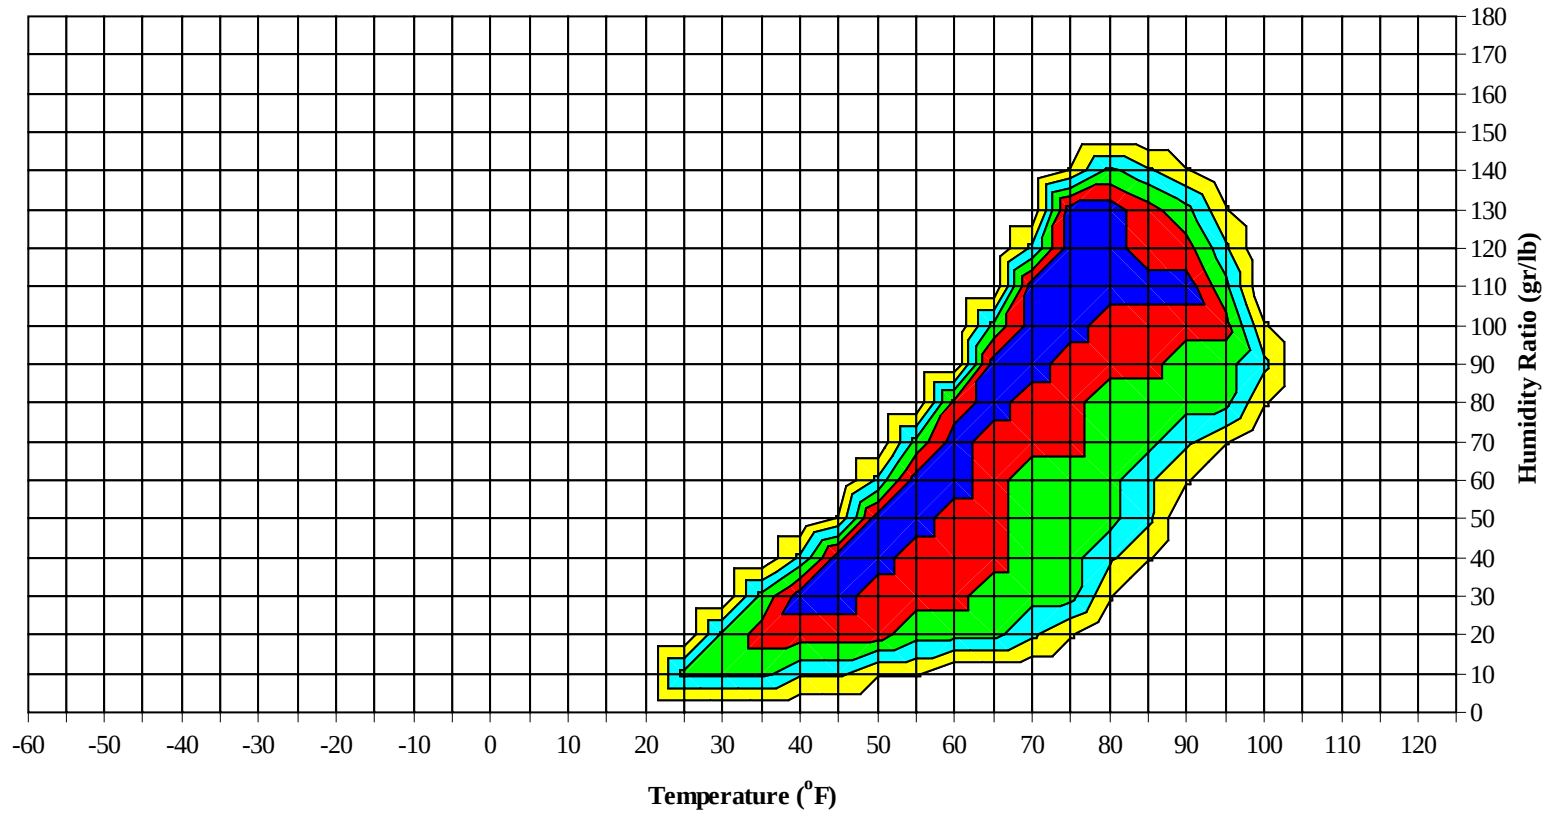


- 50% of all observations
- 80% of all observations
- 95% of all observations
- 97.5% of all observations
- 99% of all observations

RANDOLPH AFB

TX

WMO No. 722536

Psychrometric Summary of Peak Design Values

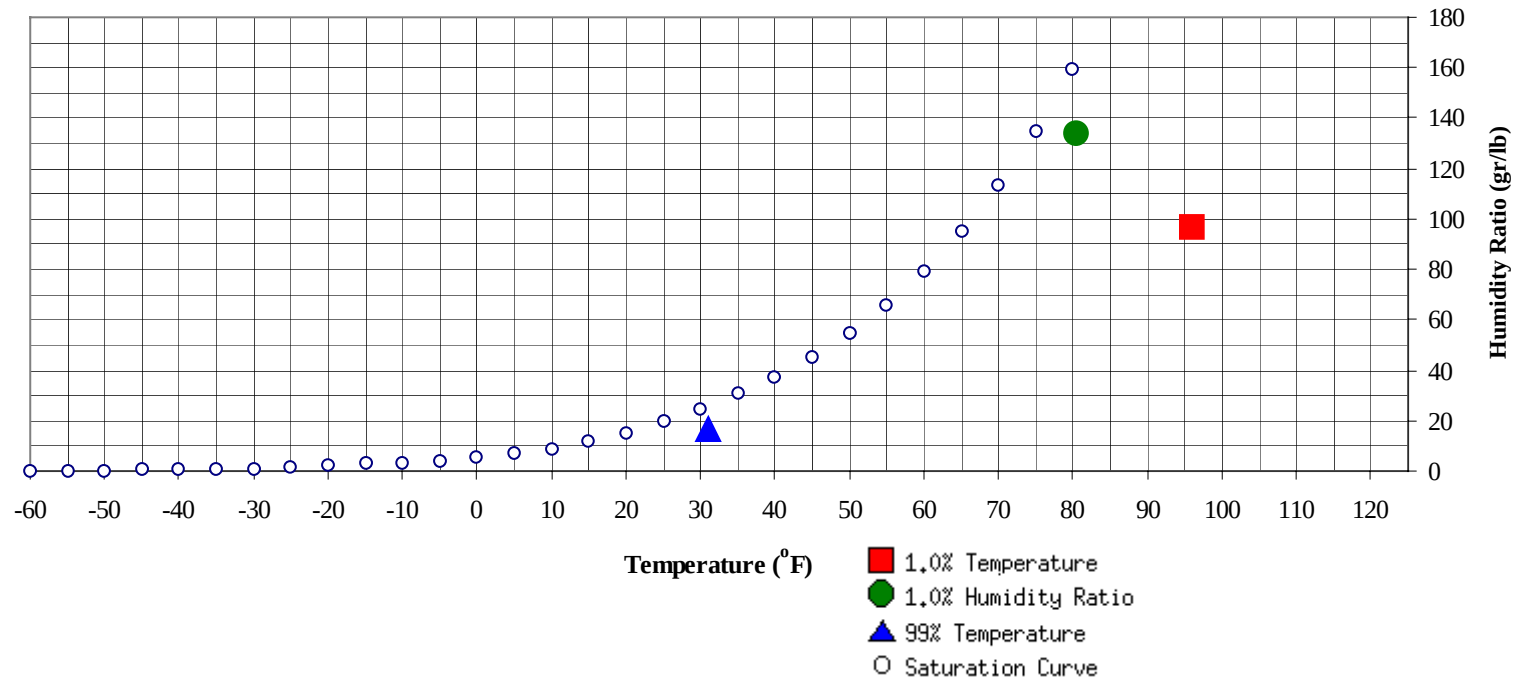

	(°F)	MCHR	Enthalpy	1.0% Humidity Ratio	(gr/lb)	MCDB	MCWB	MC Dewpt	Enthalpy
		(gr/lb)	(btu/lb)			(°F)	(°F)	(°F)	(btu/lb)
99% Dry Bulb	31	16.8	10.0		134.4	80.5	76.4	75	40.4

1.0% Dry Bulb	(°F)	MCHR	MCWB	Enthalpy
		(gr/lb)	(°F)	(btu/lb)
	96	96.7	74.5	38.3

RANDOLPH AFB

TX

WMO No. 722536

Dry-Bulb Temperature Hours For An Average Year (Sheet 1 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	January					February					March				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104															
95 / 99							0	0	0	62.4		0	0	0	62.6
90 / 94							1	0	1	62.9		1	1	2	65.9
85 / 89		0	0	0	59.6		1	0	1	61.9		4	2	6	64.8
80 / 84		1	0	1	62.6		5	2	7	61.2		16	6	22	65.4
75 / 79		8	2	10	61.9		14	6	20	60.7		32	16	48	63.6
70 / 74	0	18	8	26	60.5	1	24	14	39	59.6	10	49	37	96	62.6
65 / 69	10	27	18	55	59.5	12	34	27	73	58.7	37	49	50	137	60.3
60 / 64	14	33	27	74	54.9	23	34	35	92	55.3	41	38	45	125	56.0
55 / 59	20	37	36	93	50.6	27	32	36	95	50.9	39	24	36	99	51.2
50 / 54	30	36	40	106	46.5	34	29	36	99	46.4	42	17	25	84	46.9
45 / 49	40	32	39	111	42.3	40	23	30	93	42.3	32	9	16	57	42.6
40 / 44	45	28	37	110	37.7	38	14	20	72	38.1	26	6	8	40	38.2
35 / 39	43	18	25	86	33.7	28	7	10	45	33.7	13	2	3	18	33.6
30 / 34	30	7	12	49	28.8	14	4	5	23	29.3	6	0	1	7	29.0
25 / 29	11	3	4	18	24.5	5	1	2	8	24.2	2	0	0	2	24.5
20 / 24	4	0	1	5	19.8	2	0	1	3	20.3	0			0	19.9
15 / 19	1	0		1	14.8	0			0	14.8					
10 / 14															
5 / 9															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

RANDOLPH AFB

TX

WMO No. 722536

Dry-Bulb Temperature Hours For An Average Year (Sheet 2 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	April					May					June				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104		0	0	0	70.7							2	1	3	74.5
95 / 99		1	0	1	69.0		3	1	4	74.3		13	6	19	75.2
90 / 94		4	1	5	68.0		15	6	21	73.8		52	21	73	75.2
85 / 89		16	6	22	69.1		43	18	61	72.7	0	76	39	115	74.3
80 / 84	0	42	18	60	68.0	1	72	40	113	71.1	15	60	59	134	73.3
75 / 79	5	57	36	98	66.2	33	64	66	163	70.0	99	26	68	193	72.4
70 / 74	42	54	61	157	65.4	88	35	65	188	67.8	84	9	37	130	69.2
65 / 69	56	34	51	141	61.8	64	13	34	111	63.6	30	2	7	39	64.6
60 / 64	51	19	33	103	57.0	36	4	14	54	58.6	9	0	1	10	59.8
55 / 59	34	8	18	60	51.9	18	0	3	21	53.8	3		0	3	54.7
50 / 54	25	5	10	40	47.6	6	0	1	7	49.6	0			0	50.5
45 / 49	16	1	4	21	43.2	2		0	2	45.0					
40 / 44	8		1	9	38.7	0			0	39.0					
35 / 39	2		0	2	34.1										
30 / 34	0			0	30.0										
25 / 29															
20 / 24															
15 / 19															
10 / 14															
5 / 9															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

RANDOLPH AFB

TX

WMO No. 722536

Dry-Bulb Temperature Hours For An Average Year (Sheet 3 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	July					August					September				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104		5	3	8	73.6		4	1	5	74.4		0	0	0	73.3
95 / 99		36	17	53	74.4		41	16	57	74.5		10	3	13	74.2
90 / 94		74	36	110	74.4		76	34	110	74.0		42	13	55	73.4
85 / 89	0	70	46	116	74.1	0	65	44	109	73.7		64	26	90	72.7
80 / 84	23	46	67	136	73.5	20	46	69	135	73.4	6	60	47	113	71.7
75 / 79	135	12	60	206	72.5	123	13	61	197	72.6	69	37	70	176	71.2
70 / 74	81	4	19	104	69.7	89	3	22	114	69.7	83	17	50	150	68.1
65 / 69	9	0	1	10	64.7	15	0	1	16	64.9	38	7	17	62	62.5
60 / 64	0			0	57.4	1		0	1	59.4	22	3	9	34	57.0
55 / 59											15	0	4	19	52.9
50 / 54											6	0	1	7	48.7
45 / 49											1		0	1	44.9
40 / 44											0			0	39.5
35 / 39															
30 / 34															
25 / 29															
20 / 24															
15 / 19															
10 / 14															
5 / 9															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

RANDOLPH AFB

TX

WMO No. 722536

Dry-Bulb Temperature Hours For An Average Year (Sheet 4 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	October					November					December				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104															
95 / 99		1	0	1	68.1		0		0	63.0					
90 / 94		8	2	10	71.0		0		0	65.4					
85 / 89		31	8	39	70.3		3	0	3	68.5		0		0	65.4
80 / 84	1	53	22	76	68.7		17	3	20	67.8		3	0	3	65.0
75 / 79	16	55	45	117	67.8	2	35	14	51	66.1		12	3	15	64.5
70 / 74	43	44	58	146	65.3	21	42	35	97	64.7	5	29	14	48	62.9
65 / 69	49	28	45	122	61.2	25	37	35	97	60.3	19	34	26	79	60.4
60 / 64	47	15	32	94	56.8	32	36	40	108	55.8	18	38	31	87	55.3
55 / 59	37	7	18	62	52.4	36	30	38	104	51.2	29	39	40	108	50.9
50 / 54	29	3	12	44	48.4	37	19	32	88	46.9	33	35	42	110	46.3
45 / 49	16	1	4	21	44.3	33	12	23	68	42.4	41	26	38	105	42.2
40 / 44	7	0	2	9	39.8	25	5	13	43	38.4	40	19	28	87	37.9
35 / 39	2		0	2	34.7	18	2	6	26	34.2	33	8	15	56	33.4
30 / 34	0		0	0	30.6	9	0	2	11	30.0	20	3	6	29	28.8
25 / 29	0			0	25.7	3	0	0	3	25.7	7	1	2	10	24.1
20 / 24						1		0	1	20.9	3	1	1	5	18.9
15 / 19						0			0	19.0	1	0	0	1	15.0
10 / 14											0	0		0	9.5
5 / 9											0			0	6.0

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

RANDOLPH AFB

TX

WMO No. 722536

Dry-Bulb Temperature Hours For An Average Year (Sheet 5 of 5)

Period of Record = 1967 to 1996

Annual Totals					
Temperature Range (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00		
100 / 104		11	5	16	74.0
95 / 99		105	44	149	74.4
90 / 94		274	114	388	74.0
85 / 89	1	373	190	564	73.0
80 / 84	66	422	333	821	71.5
75 / 79	482	366	448	1296	70.1
70 / 74	546	326	420	1293	66.5
65 / 69	363	265	314	942	61.3
60 / 64	295	220	267	782	56.2
55 / 59	257	177	229	663	51.4
50 / 54	243	144	198	585	46.8
45 / 49	221	105	152	478	42.5
40 / 44	187	73	108	368	38.0
35 / 39	139	37	60	236	33.7
30 / 34	80	14	27	121	29.0
25 / 29	29	5	9	43	24.4
20 / 24	10	1	2	13	19.7
15 / 19	3	0	0	3	15.0
10 / 14	0	0		0	9.5
5 / 9	0			0	6.0


Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

RANDOLPH AFB

TX

WMO No. 722536

Annual Summary of Temperatures

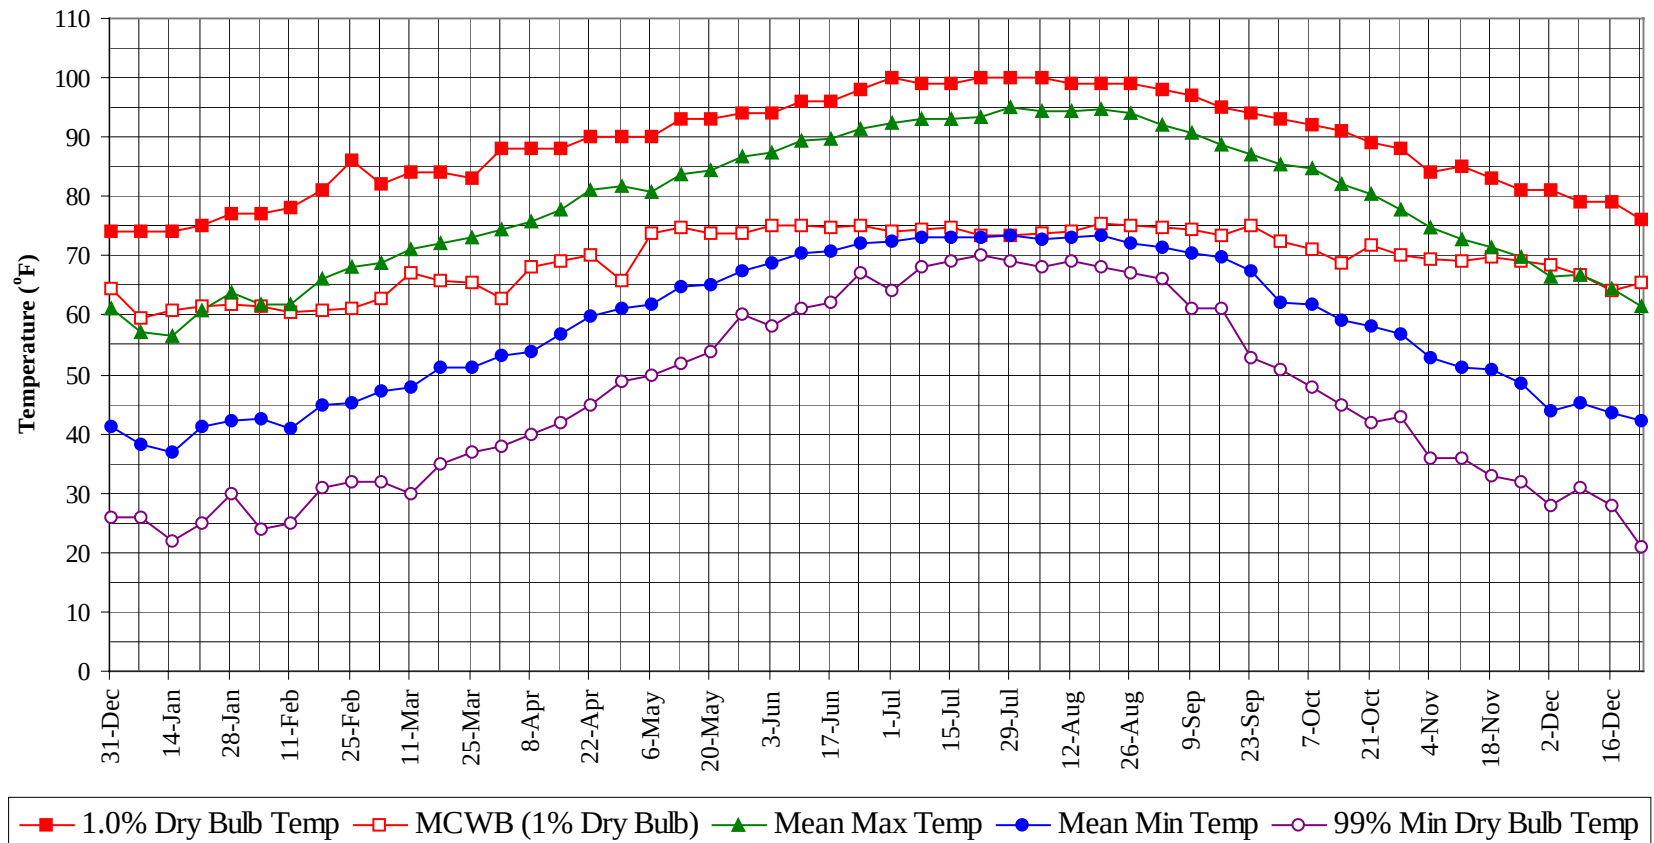


RANDOLPH AFB

TX

WMO No. 722536

Long Term Humidity and Dry Bulb Temperature Summary

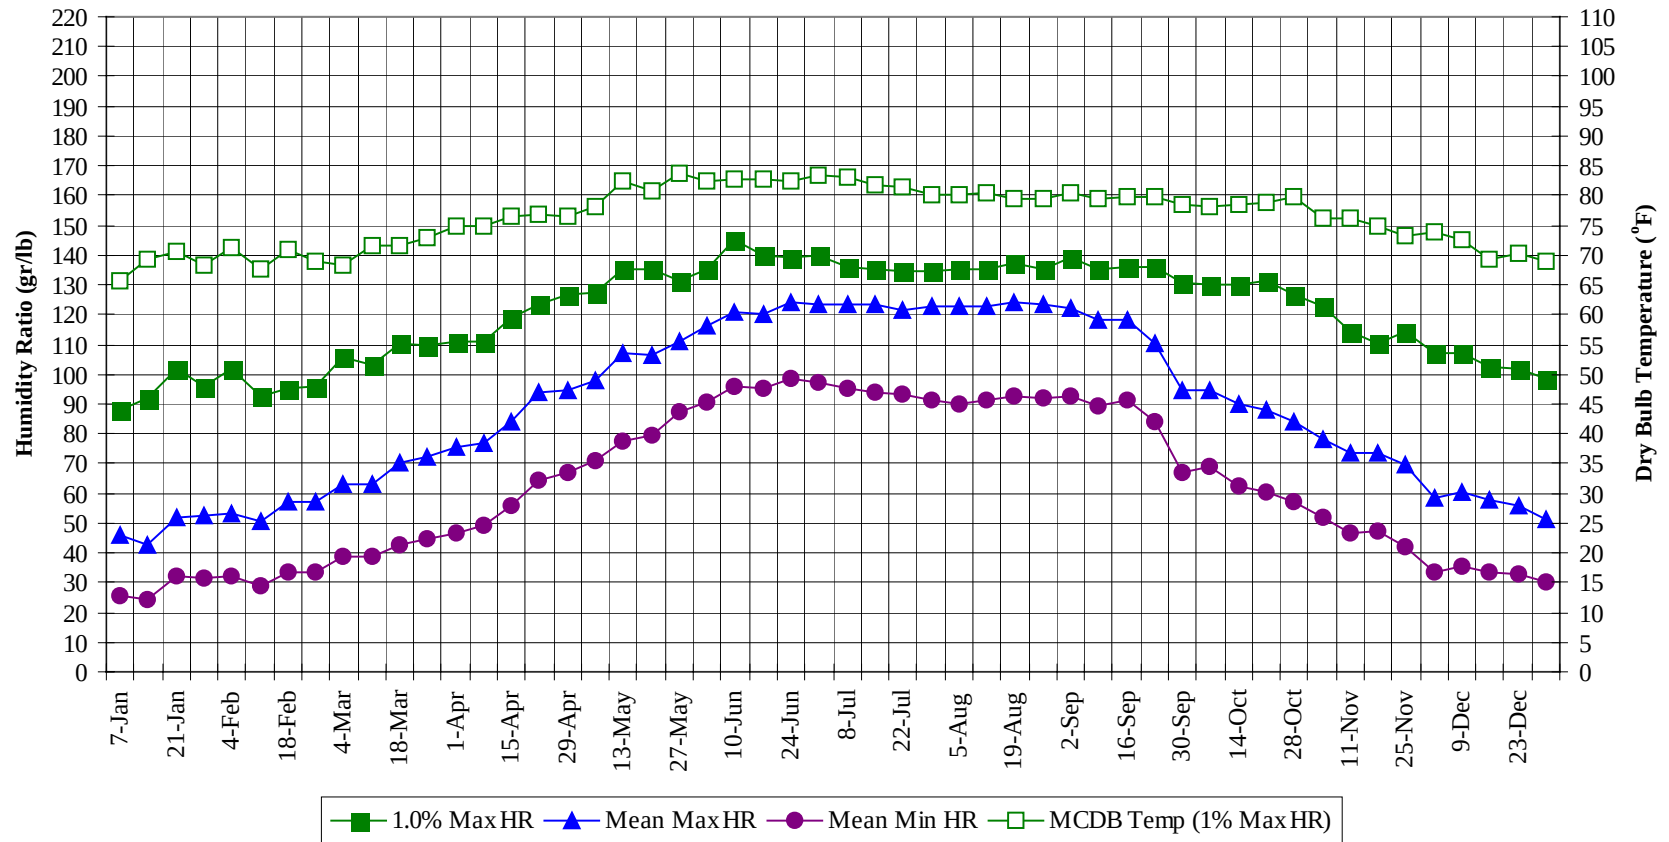

RANDOLPH AFB

TX

WMO No. 722536


Long Term Dry Bulb Temperature and Humidity Summary

Week Ending	1.0% Temp (°F)	MCWB @ 1% Temp (°F)	Mean Max Temp (°F)	Mean Min Temp (°F)	99% Temp (°F)	1.0% HR (gr/lb)	MCDB @ 1% HR (°F)	Mean Max HR (gr/lb)	Mean Min HR (gr/lb)
7-Jan	74.0	59.5	57.1	38.2	26.0	88.2	65.8	46.2	25.6
14-Jan	74.0	60.7	56.6	37.0	22.0	91.7	69.1	42.5	24.5
21-Jan	75.0	61.5	60.7	41.1	25.0	101.5	70.7	52.2	32.0
28-Jan	77.0	61.9	63.9	42.3	30.0	95.9	68.3	52.3	31.3
4-Feb	77.0	61.5	61.8	42.5	24.0	101.5	71.1	53.0	32.0
11-Feb	78.0	60.4	61.9	40.8	25.0	92.4	67.6	50.9	29.1
18-Feb	81.0	60.9	66.2	45.0	31.0	95.2	71.0	56.9	33.6
25-Feb	86.0	61.2	68.1	45.2	32.0	95.9	69.0	57.2	33.2
4-Mar	82.0	62.8	68.7	47.2	32.0	105.7	68.4	63.0	38.8
11-Mar	84.0	67.2	71.0	47.8	30.0	102.9	71.5	63.3	38.4
18-Mar	84.0	65.7	72.2	51.3	35.0	110.6	71.6	70.2	42.9
25-Mar	83.0	65.6	73.3	51.3	37.0	109.9	73.0	72.3	44.5
1-Apr	88.0	62.9	74.5	53.1	38.0	111.3	74.9	75.8	46.6
8-Apr	88.0	68.2	75.8	54.0	40.0	111.3	75.0	76.9	49.2
15-Apr	88.0	69.1	77.7	56.8	42.0	119.0	76.7	83.8	55.6
22-Apr	90.0	70.3	81.0	59.9	45.0	123.2	76.7	93.7	64.5
29-Apr	90.0	65.8	81.7	61.3	49.0	126.7	76.6	94.5	67.0
6-May	90.0	73.9	80.9	61.7	50.0	127.4	78.1	97.8	71.1
13-May	93.0	74.9	83.9	64.7	52.0	135.1	82.3	106.9	77.3
20-May	93.0	73.8	84.5	65.1	54.0	135.1	80.9	106.2	79.4
27-May	94.0	73.9	86.6	67.5	60.0	131.6	83.8	111.1	87.1
3-Jun	94.0	75.3	87.5	68.8	58.0	135.1	82.5	115.9	90.4
10-Jun	96.0	75.2	89.3	70.3	61.0	144.9	82.7	120.8	95.9
17-Jun	96.0	74.8	89.9	70.6	62.0	140.0	82.9	120.3	95.5
24-Jun	98.0	75.1	91.3	72.2	67.0	139.3	82.5	124.1	98.3
1-Jul	100.0	74.3	92.3	72.5	64.0	140.0	83.5	123.3	97.0
8-Jul	99.0	74.4	93.1	73.1	68.0	135.8	83.0	123.4	95.5
15-Jul	99.0	74.6	93.2	73.2	69.0	135.1	81.7	123.4	93.6
22-Jul	100.0	73.4	93.4	73.1	70.0	134.4	81.5	121.6	93.0
29-Jul	100.0	73.6	94.9	73.3	69.0	134.4	80.2	122.9	91.4
5-Aug	100.0	73.9	94.5	72.8	68.0	135.1	80.0	122.6	89.9
12-Aug	99.0	74.1	94.4	73.0	69.0	135.1	80.4	122.5	91.1
19-Aug	99.0	75.4	94.7	73.3	68.0	137.2	79.4	124.3	92.8
26-Aug	99.0	75.0	94.2	72.2	67.0	135.1	79.5	123.6	91.8
2-Sep	98.0	74.7	91.9	71.6	66.0	139.3	80.5	122.4	92.8
9-Sep	97.0	74.3	90.6	70.4	61.0	135.1	79.4	118.3	89.5
16-Sep	95.0	73.5	88.9	69.8	61.0	135.8	79.7	118.3	91.3
23-Sep	94.0	75.1	86.9	67.6	53.0	135.8	79.7	110.2	83.9
30-Sep	93.0	72.3	85.4	62.3	51.0	130.9	78.5	94.9	67.2
7-Oct	92.0	71.0	84.7	61.9	48.0	130.2	78.2	94.4	68.7
14-Oct	91.0	68.7	81.9	59.3	45.0	130.2	78.5	89.9	62.4
21-Oct	89.0	71.9	80.4	58.2	42.0	131.6	78.7	88.2	60.1
28-Oct	88.0	70.0	77.6	56.8	43.0	126.7	79.8	84.0	57.1
4-Nov	84.0	69.4	74.7	52.8	36.0	122.5	76.3	78.3	51.7
11-Nov	85.0	69.3	72.9	51.2	36.0	114.1	76.1	73.8	46.9
18-Nov	83.0	69.9	71.5	50.7	33.0	110.6	75.0	73.3	47.3
25-Nov	81.0	69.1	69.7	48.4	32.0	114.1	73.1	69.7	42.3
2-Dec	81.0	68.4	66.5	43.9	28.0	107.1	74.0	58.7	33.8
9-Dec	79.0	66.6	66.8	45.3	31.0	107.1	72.7	60.3	35.4
16-Dec	79.0	64.3	64.5	43.7	28.0	102.2	69.4	57.8	33.7
23-Dec	76.0	65.3	61.5	42.2	21.0	101.5	70.4	56.1	32.9
31-Dec	74.0	64.5	61.2	41.1	26.0	98.7	68.9	51.0	29.9

RANDOLPH AFB

TX

WMO No. 722536

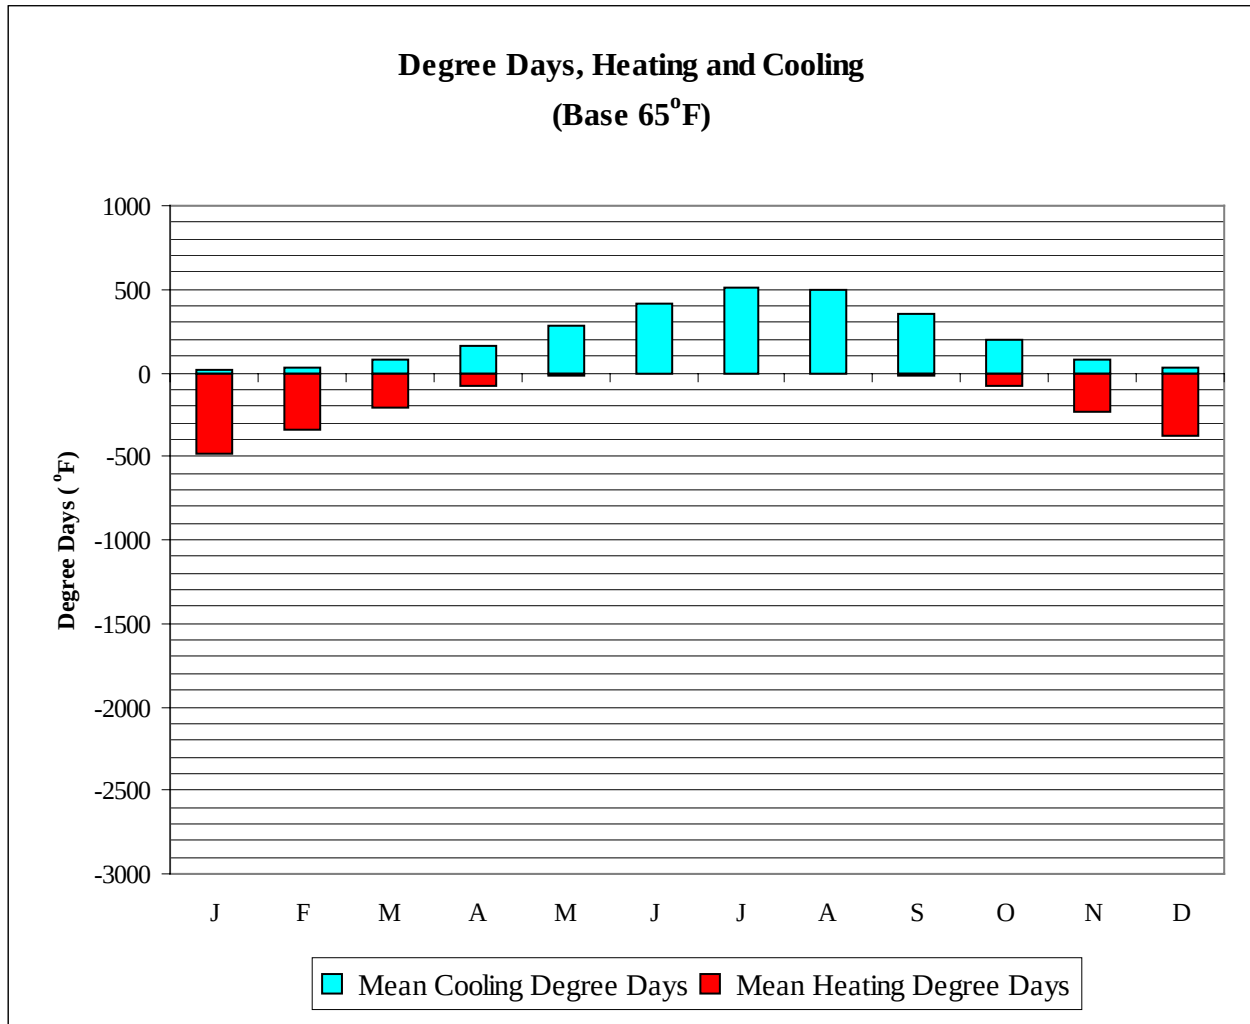


	Mean Cooling Degree Days (°F)	Mean Heating Degree Days (°F)
JAN	16	489
FEB	32	342
MAR	79	209
APR	161	81
MAY	287	18
JUN	419	2
JUL	507	0
AUG	500	0
SEP	352	15
OCT	196	83
NOV	73	238
DEC	27	383
ANN	2649	1860

RANDOLPH AFB

TX

WMO No. 722536

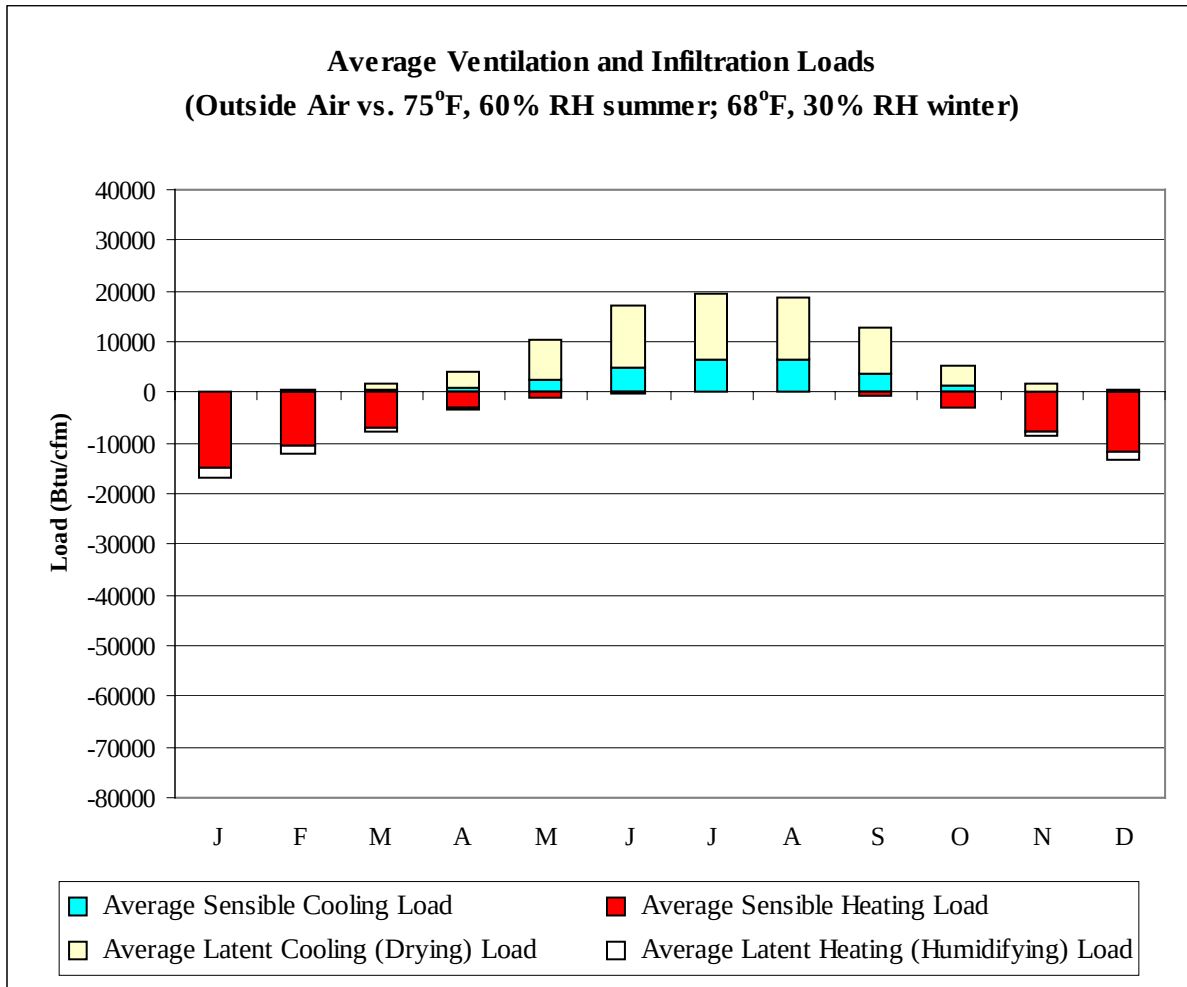

	Average Sensible Cooling Load	Average Sensible Heating Load	Average Latent Cooling Load	Average Latent Heating Load
	(Btu/cfm)	(Btu/cfm)	(Btu/cfm)	(Btu/cfm)
JAN	22	-14866	232	-2046
FEB	127	-10711	245	-1372
MAR	353	-6991	1258	-682
APR	1001	-3027	3033	-207
MAY	2363	-863	8010	-8
JUN	4708	-132	12547	0
JUL	6384	-7	12938	0
AUG	6295	-19	12387	0
SEP	3609	-639	9215	-4
OCT	1480	-3058	3937	-98
NOV	290	-7765	1546	-742
DEC	52	-11873	517	-1537
ANN	26684	-59951	65865	-6696

Average Annual Solar Radiation – Nearest Available Site

(Source: National Renewable Energy Laboratory, Golden CO, 1995)

City: SAN ANTONIO
 State: TX
 WBAN No: 12921
 Lat(N): 29.53
 Long(W): 98.47
 Elev(ft): 794

Stn Type: Primary
 SHADING GEOMETRY IN DIMENSIONLESS UNITS
 Window: 1
 Overhang: 0.858
 Vert Gap: 0.646

AVERAGE INCIDENT SOLAR RADIATION (Btu/sq.ft./day), Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Global	970	1230	1520	1740	1890	2120	2170	2040	1720	1420	1080	900	1570
	Std Dev	74	108	122	157	127	136	148	100	100	106	104	70	37
	Minimum	820	1040	1210	1380	1560	1790	1790	1780	1480	1140	850	780	1490
	Maximum	1120	1460	1820	2030	2060	2320	2430	2240	1950	1610	1310	1100	1640
	Diffuse	420	510	650	790	890	870	820	780	700	530	440	400	650
Clear Day	Global	1350	1660	2050	2380	2560	2610	2570	2410	2120	1740	1390	1240	2010
NORTH	Global	270	330	400	480	570	660	630	520	430	350	290	260	430
	Diffuse	270	330	400	470	520	540	530	490	430	350	290	260	410
Clear Day	Global	240	290	360	440	590	710	660	490	380	310	260	230	410
EAST	Global	580	700	810	860	900	1000	1080	1050	920	790	630	530	820
	Diffuse	330	390	480	560	610	640	630	610	540	430	350	310	490
Clear Day	Global	900	1050	1230	1340	1370	1380	1370	1330	1230	1070	910	830	1170
SOUTH	Global	1210	1220	1080	840	660	600	640	820	1050	1270	1270	1200	990
	Diffuse	430	470	530	540	540	530	530	550	560	510	450	410	510
Clear Day	Global	2050	1920	1570	1060	710	580	630	900	1340	1760	1980	2040	1380
WEST	Global	620	770	930	1020	1070	1170	1180	1120	1000	890	700	590	920
	Diffuse	330	400	500	580	630	650	640	620	550	450	360	310	500
Clear Day	Global	900	1050	1230	1340	1370	1380	1370	1330	1230	1070	910	830	1170

Average Annual Solar Heat and Illumination – Nearest Available Site



(Source: National Renewable Energy Laboratory, Golden CO, 1995)

AVERAGE TRANSMITTED SOLAR RADIATION (Btu/sq.ft./day) FOR DOUBLE GLAZING, Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Unshaded	670	870	1090	1260	1380	1550	1590	1490	1240	1010	750	610	1130
NORTH	Unshaded	190	230	280	320	370	420	400	340	300	250	200	180	290
	Shaded	170	200	240	290	320	360	350	310	270	220	180	160	250
EAST	Unshaded	400	490	570	610	630	700	760	750	650	550	440	370	580
	Shaded	340	410	480	500	520	570	620	610	550	470	380	320	480
SOUTH	Unshaded	890	860	710	520	410	380	390	480	660	880	930	890	670
	Shaded	840	700	420	330	330	330	330	340	360	620	850	860	520
WEST	Unshaded	440	540	660	730	760	840	840	800	710	630	490	410	650
	Shaded	380	470	560	600	630	690	690	660	600	540	420	360	550

AVERAGE INCIDENT ILLUMINANCE (klux-hr) FOR MOSTLY CLEAR AND MOSTLY CLOUDY CONDITIONS, Percentage Uncertainty = 9		March					June				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	35	77	95	84	45	33	76	103	104	78
	M.Cloudy	18	46	62	54	30	21	57	81	85	62
NORTH	M.Clear	9	15	16	15	11	24	19	18	18	18
	M.Cloudy	8	17	20	18	11	14	19	20	19	19
EAST	M.Clear	76	70	22	15	11	64	78	45	18	17
	M.Cloudy	19	34	22	18	11	27	51	38	19	18
SOUTH	M.Clear	28	59	73	64	35	10	17	28	28	17
	M.Cloudy	11	31	44	38	20	9	18	27	27	18
WEST	M.Clear	9	15	16	62	80	10	17	18	42	75
	M.Cloudy	8	17	20	37	37	9	18	20	37	56
M.Clear	(% hrs)	31	34	38	41	42	21	30	38	44	53
		Sept					Dec				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	19	66	93	92	63	17	53	67	53	17
	M.Cloudy	13	46	69	72	49	9	31	40	32	11
NORTH	M.Clear	7	15	17	17	15	6	11	13	11	6
	M.Cloudy	6	16	19	20	16	4	12	15	12	5
EAST	M.Clear	52	78	44	17	15	51	54	13	11	6
	M.Cloudy	19	46	35	20	16	11	23	15	12	5
SOUTH	M.Clear	11	42	62	61	41	38	80	93	80	37
	M.Cloudy	7	29	45	48	30	9	30	40	33	12
WEST	M.Clear	7	15	17	44	76	6	11	14	55	49
	M.Cloudy	6	16	19	37	50	4	12	15	25	15
M.Clear	(% hrs)	34	37	41	43	48	33	35	38	39	42

Wind Summary - December, January, and February



Labels of Percent Frequency on North Axis

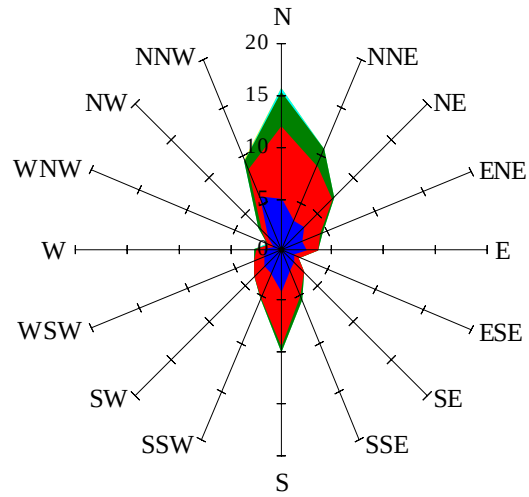

Percent Calm = 11.57

Wind Summary - March, April, and May


Labels of Percent Frequency on North Axis

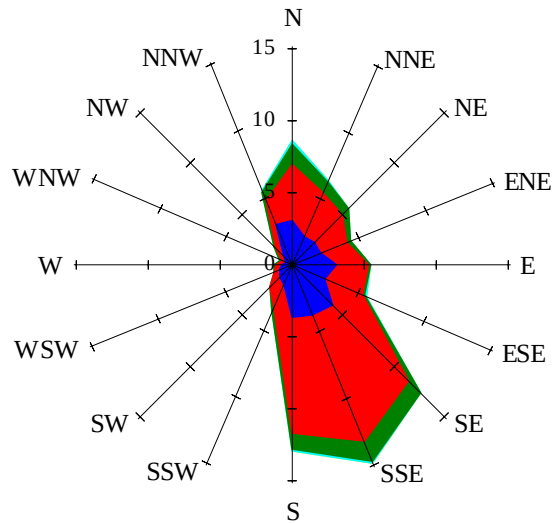

Percent Calm = 8.39

Wind Summary - June, July, and August


Labels of Percent Frequency on North Axis

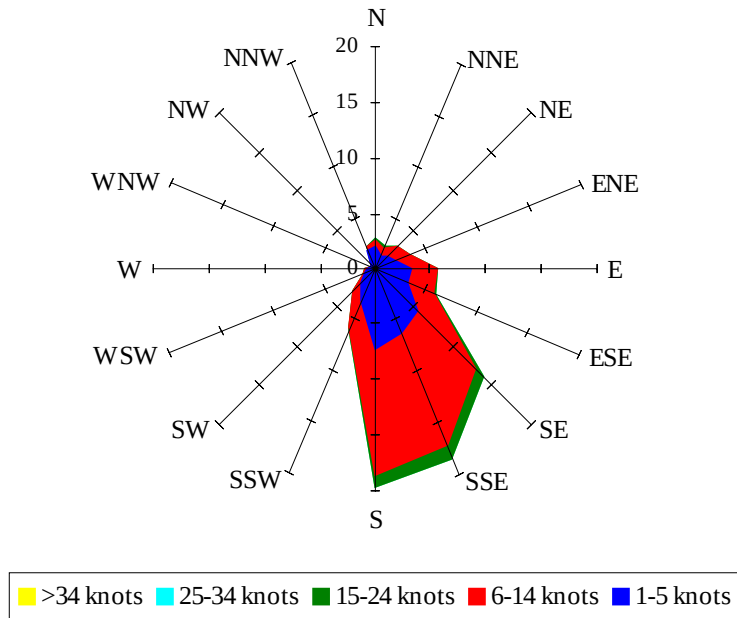

Percent Calm = 12.02

Wind Summary - September, October, and November

Labels of Percent Frequency on North Axis

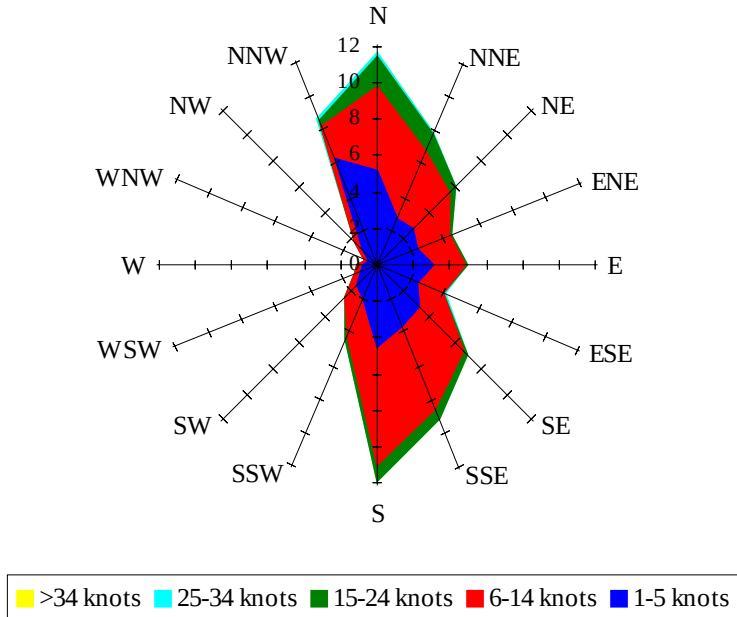

Percent Calm = 13.18