

SHREVEPORT LA

Latitude = 32.47 N

Longitude = 93.82 W

Period of Record = 1973 to 1996

WMO No. 722480

Elevation = 259 feet

Average Pressure = 29.73 inches Hg

Design Criteria Data

	Design Value	Mean Coincident (Average) Values			
		Wet Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Dry Bulb Temperature (T)	(°F)				
Median of Extreme Highs	99	77	107	7.4	S
0.4% Occurrence	97	77	111	7.7	S
1.0% Occurrence	95	77	113	7.9	S
2.0% Occurrence	93	77	114	8.2	S
Mean Daily Range	21	-	-	-	-
97.5% Occurrence	31	29	20	6.5	N
99.0% Occurrence	26	24	15	6.8	N
99.6% Occurrence	22	20	12	7.5	N
Median of Extreme Lows	16	14	9	8.6	N
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Wet Bulb Temperature (T_{wb})	(°F)				
Median of Extreme Highs	81	92	137	7.8	S
0.4% Occurrence	80	91	133	7.8	S
1.0% Occurrence	79	90	129	8.0	S
2.0% Occurrence	78	88	127	8.0	S
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Vapor Pressure (in. Hg)	Wind Speed (mph)	Prevailing Direction (NSEW)
Humidity Ratio (HR)	(gr/lb)				
Median of Extreme Highs	152	85	1.00	7.1	S
0.4% Occurrence	141	84	0.94	6.7	S
1.0% Occurrence	137	84	0.90	7.2	S
2.0% Occurrence	133	83	0.88	7.2	S
Air Conditioning/ Humid Area Criteria	# of Hours	T ≥ 93°F	T ≥ 80°F	T _{wb} ≥ 73°F	T _{wb} ≥ 67°F
		187	1639	1839	3365


Other Site Data

Weather Region	Rain Rate 100 Year Recurrence (in./hr)	Basic Wind Speed 3 sec gust @ 33 ft 50 Year Recurrence (mph)	Ventilation Cooling Load Index (Ton-hr/cfm/yr) Base 75°F-RH 60% Latent + Sensible
11	4.5	90	6.3 + 1.8
Ground Water Temperature (°F) 50 Foot Depth *	Frost Depth 50 Year Recurrence (in.)	Ground Snow Load 50 Year Recurrence (lb/ft ²)	Average Annual Freeze-Thaw Cycles (#)
67.0	7	3	25

*Note: Temperatures at greater depths can be estimated by adding 1.5°F per 100 feet additional depth.

SHREVEPORT LA


WMO No. 722480

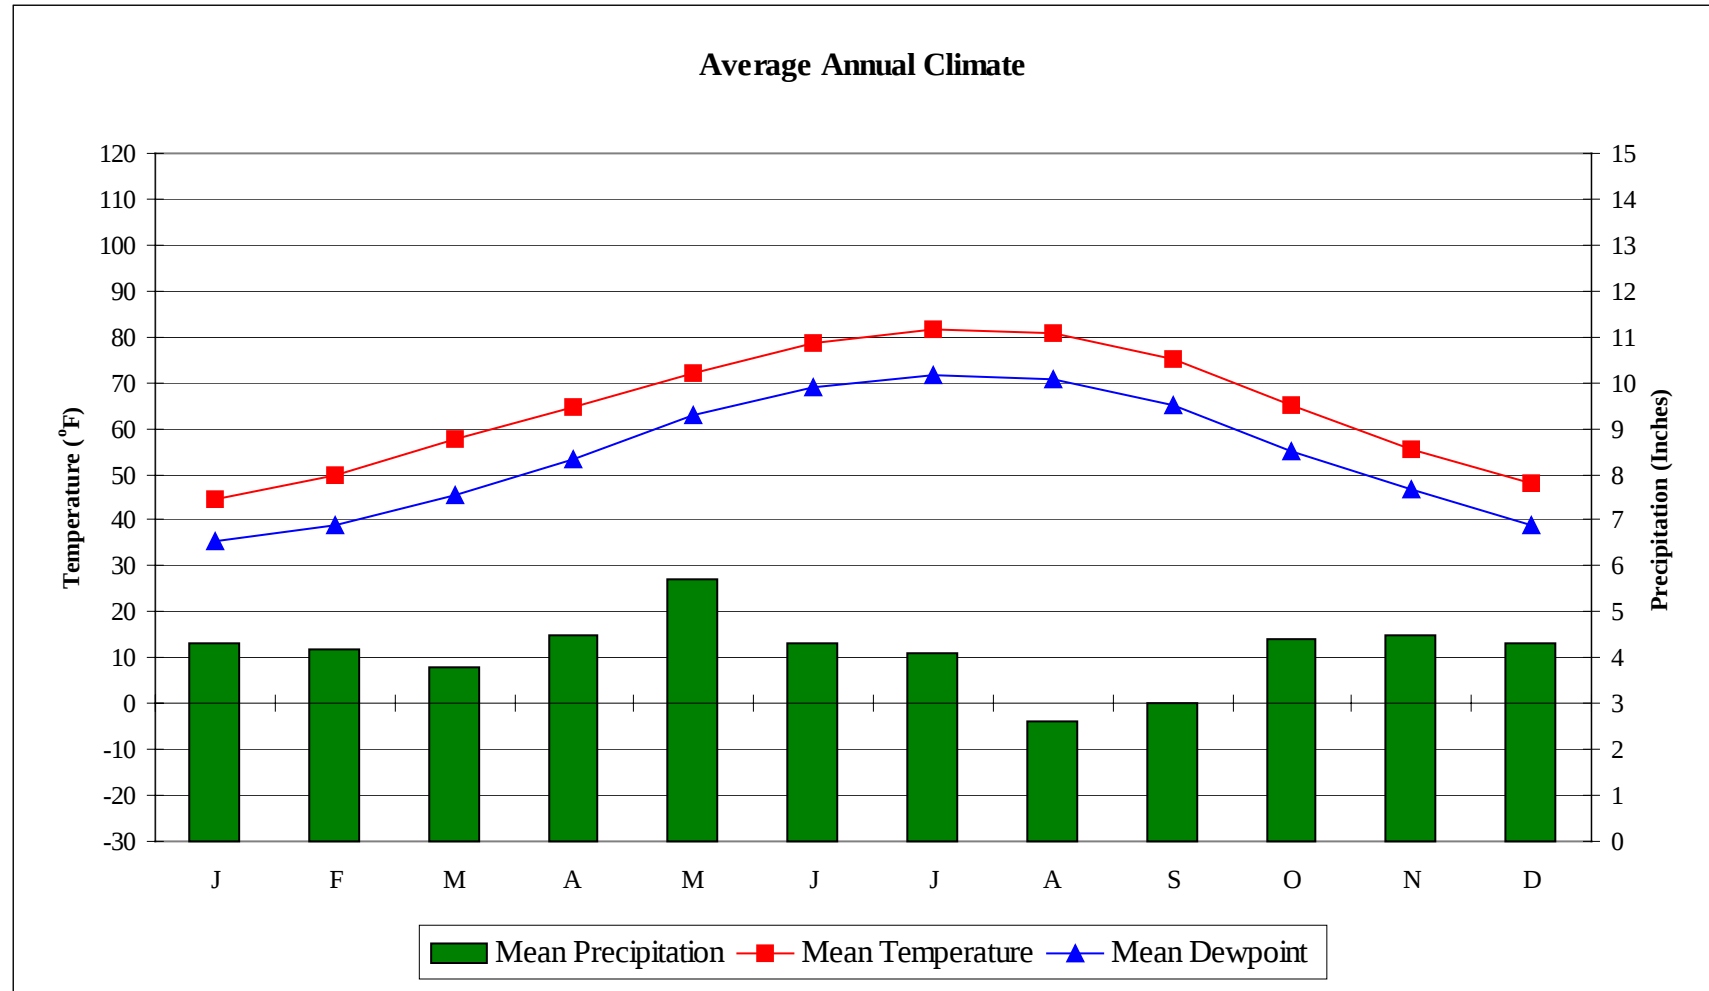

SHREVEPORT LA

WMO No. 722480

Long Term Psychrometric Summary

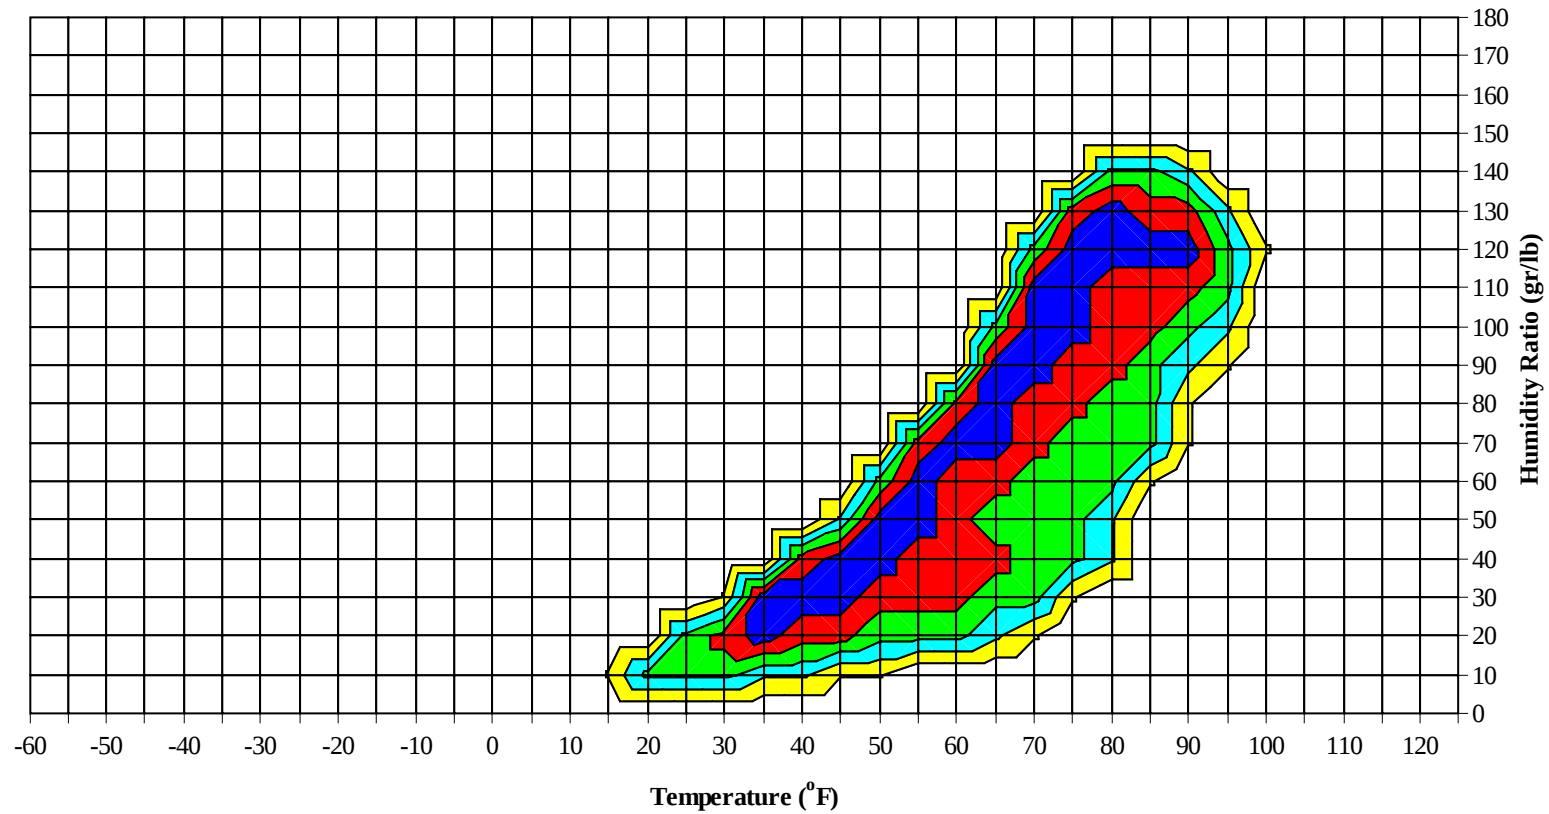


- 50% of all observations
- 80% of all observations
- 95% of all observations
- 97.5% of all observations
- 99% of all observations

SHREVEPORT LA

WMO No. 722480

Psychrometric Summary of Peak Design Values

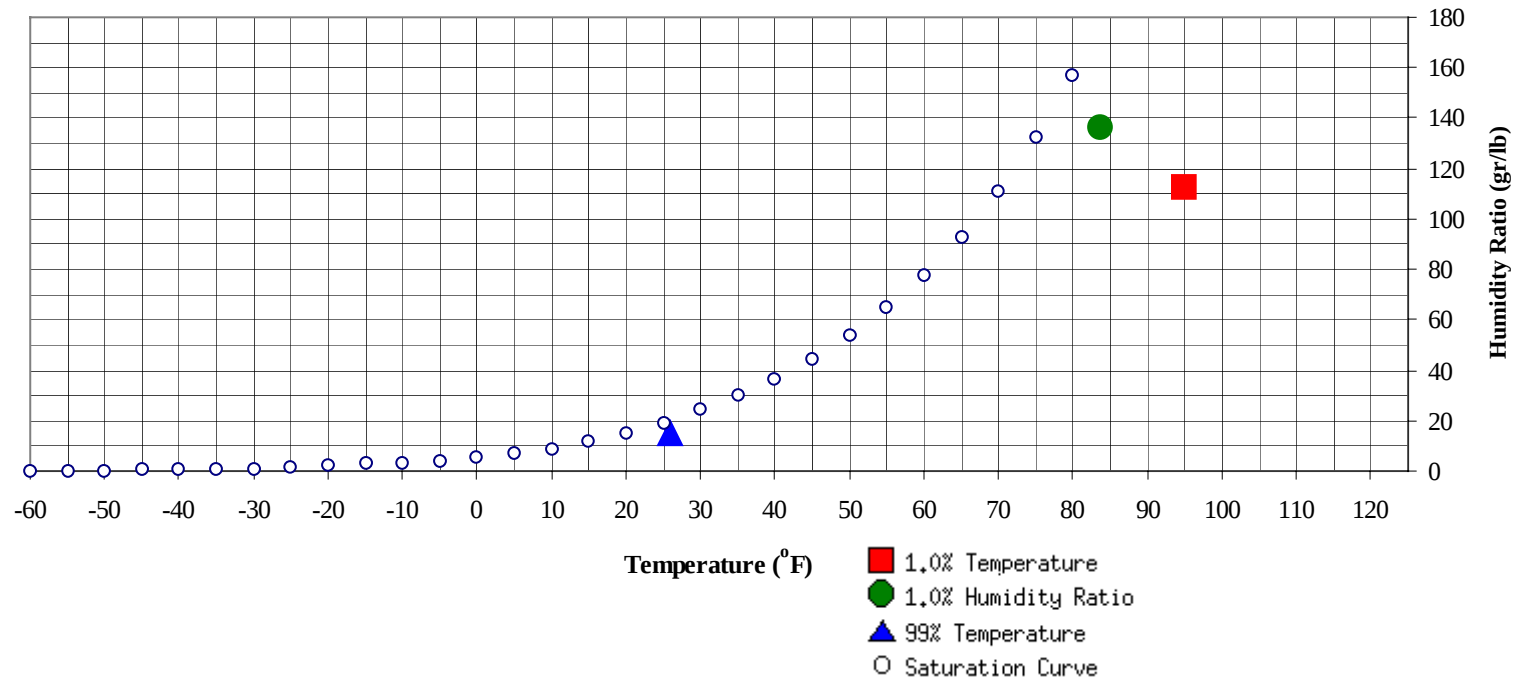

99% Dry Bulb	(°F)	MCHR (gr/lb)	Enthalpy (btu/lb)	1.0% Humidity Ratio	(gr/lb)	MCDB (°F)	MCWB (°F)	MC Dewpt (°F)	Enthalpy (btu/lb)
	26	14.8	8.5		136.5	83.6	78	75.9	41.5

1.0% Dry Bulb	(°F)	MCHR (gr/lb)	MCWB (°F)	Enthalpy (btu/lb)
	95	112.9	77.3	40.6

SHREVEPORT LA

WMO No. 722480

Dry-Bulb Temperature Hours For An Average Year (Sheet 1 of 5)

Period of Record = 1973 to 1996

Temperature Range (°F)	January					February					March				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104															
95 / 99															
90 / 94															
85 / 89							1	0	1	63.8		0		0	70.0
80 / 84		0		0	66.3		3	1	4	63.1		2	0	2	66.8
75 / 79	0	4	0	4	63.2		9	2	11	61.9		13	3	16	64.8
70 / 74	0	10	3	13	61.0						0	29	11	40	63.1
65 / 69	5	17	11	33	59.4	1	21	10	32	60.3	9	38	27	74	62.2
60 / 64	11	24	19	54	56.0	7	25	18	50	58.8	20	37	37	94	59.3
55 / 59	11	29	23	63	51.3	14	29	26	69	55.1	29	42	43	114	55.4
50 / 54	19	33	30	82	46.9	22	29	31	82	51.3	36	33	41	110	51.5
45 / 49	30	35	39	104	42.9	29	29	34	92	47.1	44	25	36	105	47.3
40 / 44	40	37	43	120	38.5	32	26	35	93	42.8	39	12	25	76	43.2
35 / 39	47	29	37	113	34.3	35	20	25	80	38.3	35	10	15	60	39.1
30 / 34	43	18	27	88	29.7	33	16	22	71	34.0	21	5	6	32	34.7
25 / 29	26	8	12	46	25.5	29	9	13	51	29.9	10	2	3	15	30.1
20 / 24	11	2	5	18	20.6	15	5	5	25	25.2	3	0	1	4	24.9
15 / 19	5	1	1	7	16.2	6	2	3	11	21.0	1		0	1	21.3
10 / 14	1	0	0	1	11.0	2	0	0	2	16.3					
5 / 9	0	0		0	5.5	0	0		0	12.8					

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

SHREVEPORT LA

WMO No. 722480

Dry-Bulb Temperature Hours For An Average Year (Sheet 2 of 5)

Period of Record = 1973 to 1996

Temperature Range (°F)	April					May					June				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104															
95 / 99							0		0	75.0		6	2	8	78.2
90 / 94		1	0	1	66.9		6	1	7	75.8	0	49	15	64	76.5
85 / 89		7	1	8	69.0		42	12	54	73.4	1	84	32	116	75.1
80 / 84		37	11	48	67.6	1	70	31	102	71.1	15	60	52	126	73.7
75 / 79	1	52	25	78	65.5	16	57	49	122	69.3	65	28	69	162	72.6
70 / 74	18	53	46	117	63.7	58	41	69	168	67.3	101	12	55	167	69.9
65 / 69	43	38	51	132	61.3	78	19	51	148	64.1	40	2	13	55	65.1
60 / 64	47	24	44	115	57.4	52	9	23	84	59.5	14	0	3	17	60.2
55 / 59	47	15	30	92	52.8	27	2	10	39	54.8	4	0	0	4	55.9
50 / 54	40	7	19	66	48.4	13	1	2	16	50.6	0			0	53.0
45 / 49	26	3	9	38	44.2	3		0	3	46.6					
40 / 44	13	1	3	17	40.3										
35 / 39	5	0	1	6	35.7										
30 / 34	1		0	1	32.2										
25 / 29															
20 / 24															
15 / 19															
10 / 14															
5 / 9															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

SHREVEPORT LA

WMO No. 722480

Dry-Bulb Temperature Hours For An Average Year (Sheet 3 of 5)

Period of Record = 1973 to 1996

Temperature Range (°F)	July					August					September				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104		3	1	4	78.0		2	0	2	76.8		1	0	1	74.8
95 / 99	0	24	7	31	77.9		30	8	38	77.4		8	2	10	75.3
90 / 94	0	86	29	115	77.3	0	77	22	99	76.9		36	6	42	75.2
85 / 89	2	77	38	117	76.4	1	73	36	110	75.7	0	59	19	78	73.9
80 / 84	28	40	69	137	75.4	21	45	66	131	74.5	4	54	38	96	72.2
75 / 79	111	14	75	200	73.7	100	17	73	190	73.3	39	38	63	140	71.0
70 / 74	95	4	27	126	70.8	98	4	38	140	70.6	87	26	60	173	68.6
65 / 69	11	0	2	13	66.2	23	0	5	28	65.4	48	10	27	85	63.6
60 / 64	1			1	61.8	5		0	5	60.9	30	6	17	53	58.8
55 / 59						1		0	1	55.0	21	1	8	30	54.5
50 / 54						0			0	53.0	9	0	1	10	50.1
45 / 49											2		0	2	46.4
40 / 44											0			0	43.0
35 / 39															
30 / 34															
25 / 29															
20 / 24															
15 / 19															
10 / 14															
5 / 9															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

SHREVEPORT LA

WMO No. 722480

Dry-Bulb Temperature Hours For An Average Year (Sheet 4 of 5)

Period of Record = 1973 to 1996

Temperature Range (°F)	October					November					December				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
100 / 104															
95 / 99															
90 / 94		3	0	3	72.8										
85 / 89		19	2	21	70.8		0		0	71.0					
80 / 84	0	43	10	53	68.9		10	0	10	68.3		0		0	68.3
75 / 79	6	49	25	80	66.9	1	24	5	30	67.3	0	7	1	8	66.4
70 / 74	21	50	43	114	64.9	12	34	19	65	64.9	3	18	7	28	64.6
65 / 69	39	37	52	128	61.9	19	32	27	78	61.5	12	22	17	51	61.6
60 / 64	50	23	45	118	58.1	25	36	38	99	57.0	15	32	22	69	56.3
55 / 59	43	13	33	89	53.8	27	35	35	97	52.3	19	32	24	75	51.7
50 / 54	41	7	23	71	49.5	36	32	42	110	48.0	22	38	35	95	47.4
45 / 49	29	2	11	42	45.2	37	19	36	92	43.7	28	35	39	102	42.8
40 / 44	14	0	3	17	41.1	36	9	22	67	39.3	41	31	47	119	39.0
35 / 39	4	0	1	5	36.5	27	5	13	45	35.1	41	16	29	86	34.5
30 / 34	1		0	1	31.5	16	1	4	21	30.8	37	9	16	62	30.1
25 / 29	0			0	27.5	4	0	1	5	26.3	17	4	8	29	25.2
20 / 24						1		0	1	22.5	7	2	3	12	20.3
15 / 19						0			0	16.5	3	1	1	5	15.6
10 / 14											1	0	1	2	10.7
5 / 9											1	0	0	1	6.4

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

SHREVEPORT LA

WMO No. 722480


Dry-Bulb Temperature Hours For An Average Year (Sheet 5 of 5)

Period of Record = 1973 to 1996


Annual Totals					
Temperature Range (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00		
100 / 104		7	1	8	77.0
95 / 99	0	68	18	86	77.4
90 / 94	0	257	73	330	76.6
85 / 89	3	362	141	505	74.8
80 / 84	68	374	278	720	72.5
75 / 79	337	328	397	1062	70.7
70 / 74	501	312	401	1214	67.3
65 / 69	344	240	309	893	62.1
60 / 64	291	228	279	799	57.2
55 / 59	256	191	234	682	52.4
50 / 54	254	174	223	652	47.8
45 / 49	227	134	195	556	43.3
40 / 44	213	110	159	482	38.9
35 / 39	180	72	110	362	34.5
30 / 34	137	38	63	238	30.0
25 / 29	67	17	27	111	25.4
20 / 24	26	6	10	42	20.7
15 / 19	11	2	2	15	16.0
10 / 14	3	0	1	4	11.0
5 / 9	1	0	0	1	6.2

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Annual Summary of Temperatures

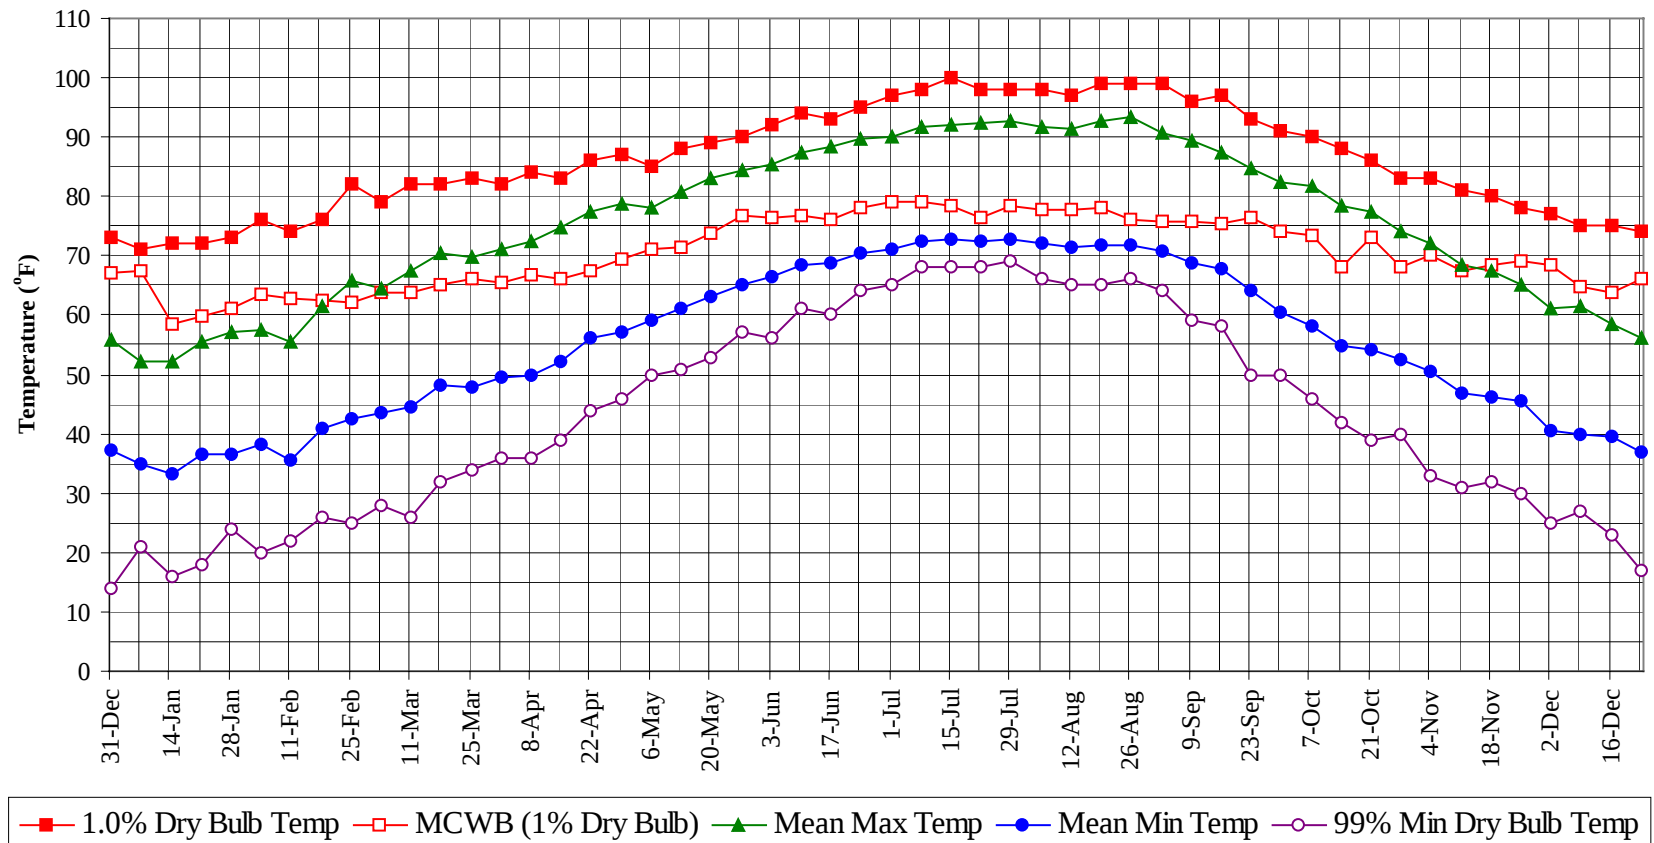

Long Term Humidity and Dry Bulb Temperature Summary

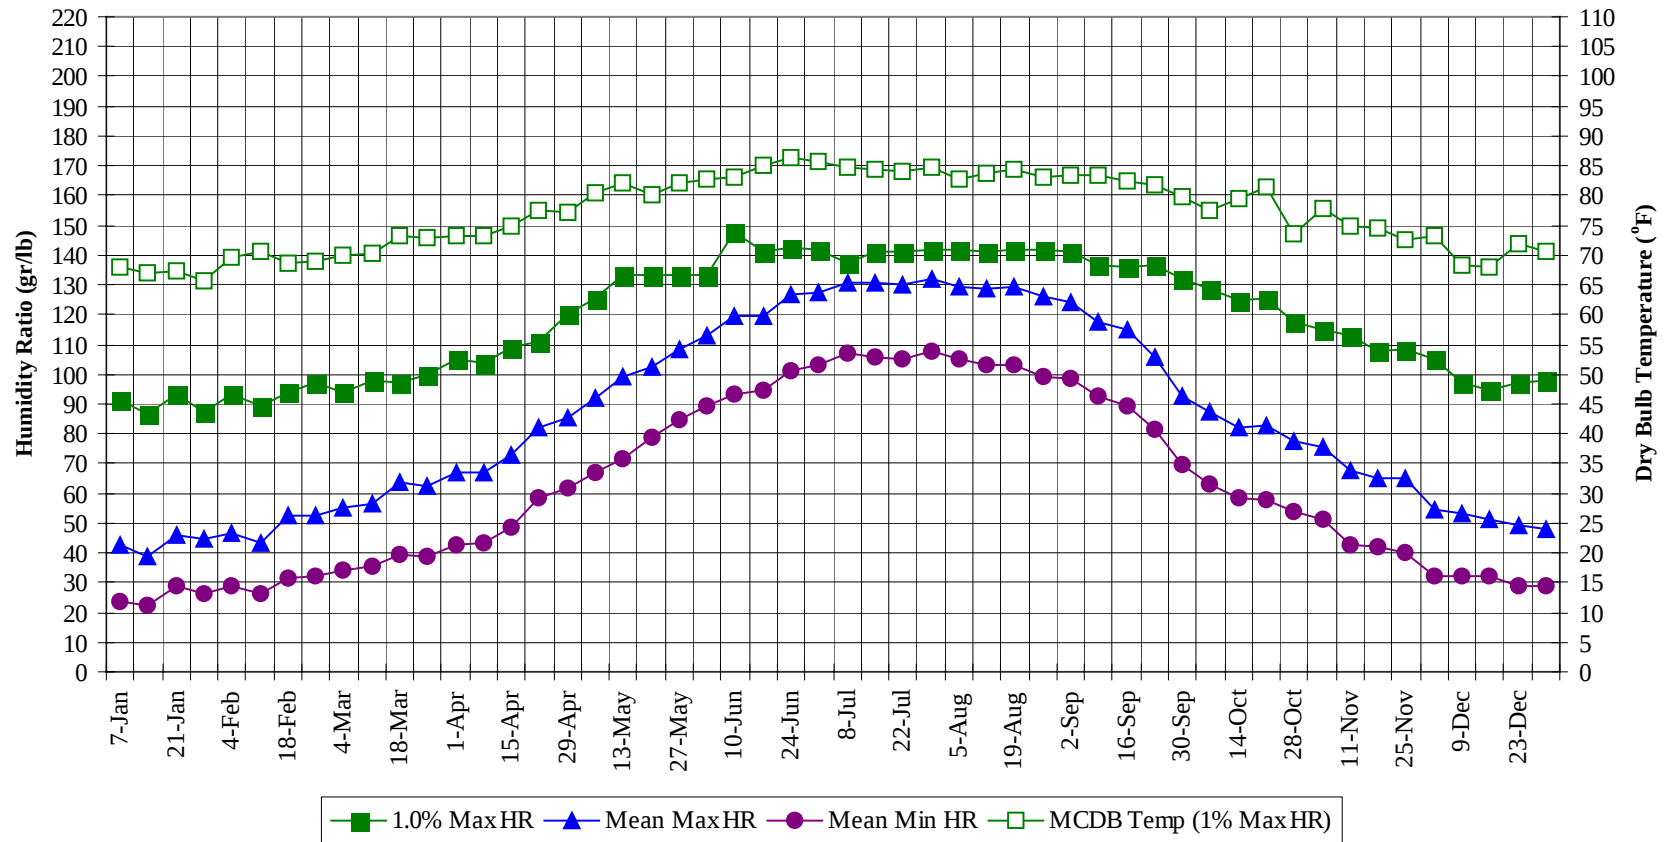

SHREVEPORT LA


WMO No. 722480

Long Term Dry Bulb Temperature and Humidity Summary

Week Ending	1.0% Temp (°F)	MCWB @ 1% Temp (°F)	Mean Max Temp (°F)	Mean Min Temp (°F)	99% Temp (°F)	1.0% HR (gr/lb)	MCDB @ 1% HR (°F)	Mean Max HR (gr/lb)	Mean Min HR (gr/lb)
7-Jan	71.0	67.5	52.3	35.0	21.0	91.0	68.0	42.5	23.8
14-Jan	72.0	58.4	52.3	33.3	16.0	86.8	67.0	38.9	22.3
21-Jan	72.0	59.9	55.4	36.7	18.0	93.1	67.2	46.3	29.1
28-Jan	73.0	61.0	57.2	36.7	24.0	87.5	65.7	44.8	26.3
4-Feb	76.0	63.4	57.5	38.1	20.0	93.1	69.5	46.5	28.8
11-Feb	74.0	62.8	55.5	35.7	22.0	89.6	70.8	43.1	26.2
18-Feb	76.0	62.5	61.5	40.8	26.0	93.8	68.8	52.5	31.8
25-Feb	82.0	62.0	65.9	42.7	25.0	97.3	69.1	52.7	32.4
4-Mar	79.0	63.7	64.6	43.4	28.0	93.8	70.0	55.1	34.2
11-Mar	82.0	63.9	67.4	44.4	26.0	98.0	70.3	56.6	35.7
18-Mar	82.0	65.2	70.6	48.1	32.0	97.3	73.3	63.5	39.6
25-Mar	83.0	66.1	69.8	47.8	34.0	100.1	72.9	62.2	38.6
1-Apr	82.0	65.6	71.1	49.4	36.0	105.0	73.2	67.3	42.8
8-Apr	84.0	66.9	72.5	49.8	36.0	103.6	73.1	67.1	43.1
15-Apr	83.0	66.2	74.9	52.1	39.0	109.2	75.0	73.0	48.8
22-Apr	86.0	67.3	77.5	56.3	44.0	111.3	77.5	82.0	58.7
29-Apr	87.0	69.5	78.8	57.2	46.0	120.4	77.1	85.6	61.4
6-May	85.0	71.2	78.1	59.3	50.0	125.3	80.4	92.1	67.0
13-May	88.0	71.4	80.9	61.0	51.0	133.0	81.9	98.8	71.7
20-May	89.0	73.8	82.9	63.2	53.0	133.0	80.2	102.5	78.7
27-May	90.0	76.8	84.4	65.1	57.0	133.0	81.9	108.1	84.6
3-Jun	92.0	76.4	85.4	66.3	56.0	133.0	82.6	112.9	89.1
10-Jun	94.0	76.7	87.4	68.6	61.0	147.7	83.0	119.3	93.5
17-Jun	93.0	76.2	88.3	68.7	60.0	141.4	85.2	119.8	94.8
24-Jun	95.0	78.0	89.7	70.6	64.0	142.8	86.5	126.8	101.1
1-Jul	97.0	79.2	90.2	71.2	65.0	142.1	85.6	127.2	103.2
8-Jul	98.0	79.2	91.6	72.6	68.0	137.2	84.6	130.7	106.9
15-Jul	100.0	78.6	92.2	72.7	68.0	141.4	84.5	130.4	105.6
22-Jul	98.0	76.4	92.6	72.5	68.0	141.4	84.2	129.8	105.3
29-Jul	98.0	78.4	92.6	72.8	69.0	142.1	84.6	132.0	107.8
5-Aug	98.0	77.9	91.8	72.3	66.0	142.1	82.9	129.4	105.0
12-Aug	97.0	77.6	91.5	71.6	65.0	141.4	83.7	128.7	103.4
19-Aug	99.0	78.0	92.6	71.9	65.0	142.1	84.5	129.1	103.0
26-Aug	99.0	76.1	93.3	71.7	66.0	142.1	83.2	126.1	99.3
2-Sep	99.0	75.9	90.8	70.8	64.0	141.4	83.2	124.0	98.3
9-Sep	96.0	75.8	89.2	68.9	59.0	136.5	83.3	117.6	92.5
16-Sep	97.0	75.4	87.4	67.8	58.0	135.8	82.3	115.2	89.4
23-Sep	93.0	76.4	84.9	64.2	50.0	136.5	81.6	105.8	81.1
30-Sep	91.0	74.1	82.4	60.4	50.0	132.3	80.0	92.7	69.7
7-Oct	90.0	73.4	81.7	58.1	46.0	128.8	77.5	87.7	63.0
14-Oct	88.0	68.2	78.3	54.9	42.0	124.6	79.5	82.2	58.1
21-Oct	86.0	73.0	77.4	54.3	39.0	125.3	81.5	83.1	57.7
28-Oct	83.0	68.1	74.3	52.5	40.0	117.6	73.7	77.8	53.6
4-Nov	83.0	70.2	72.1	50.4	33.0	114.8	78.0	75.4	51.3
11-Nov	81.0	67.4	68.5	46.9	31.0	112.7	74.9	67.8	42.7
18-Nov	80.0	68.5	67.5	46.2	32.0	107.8	74.5	64.9	42.0
25-Nov	78.0	69.1	65.3	45.5	30.0	108.5	72.7	64.9	39.8
2-Dec	77.0	68.6	61.2	40.6	25.0	105.0	73.1	54.4	32.3
9-Dec	75.0	64.9	61.4	40.0	27.0	97.3	68.3	53.2	32.2
16-Dec	75.0	63.8	58.6	39.7	23.0	94.5	68.1	51.4	32.1
23-Dec	74.0	66.3	56.2	36.9	17.0	97.3	71.9	49.4	28.6
31-Dec	73.0	67.1	55.8	37.3	14.0	98.0	70.4	48.1	29.1


SHREVEPORT LA

WMO No. 722480

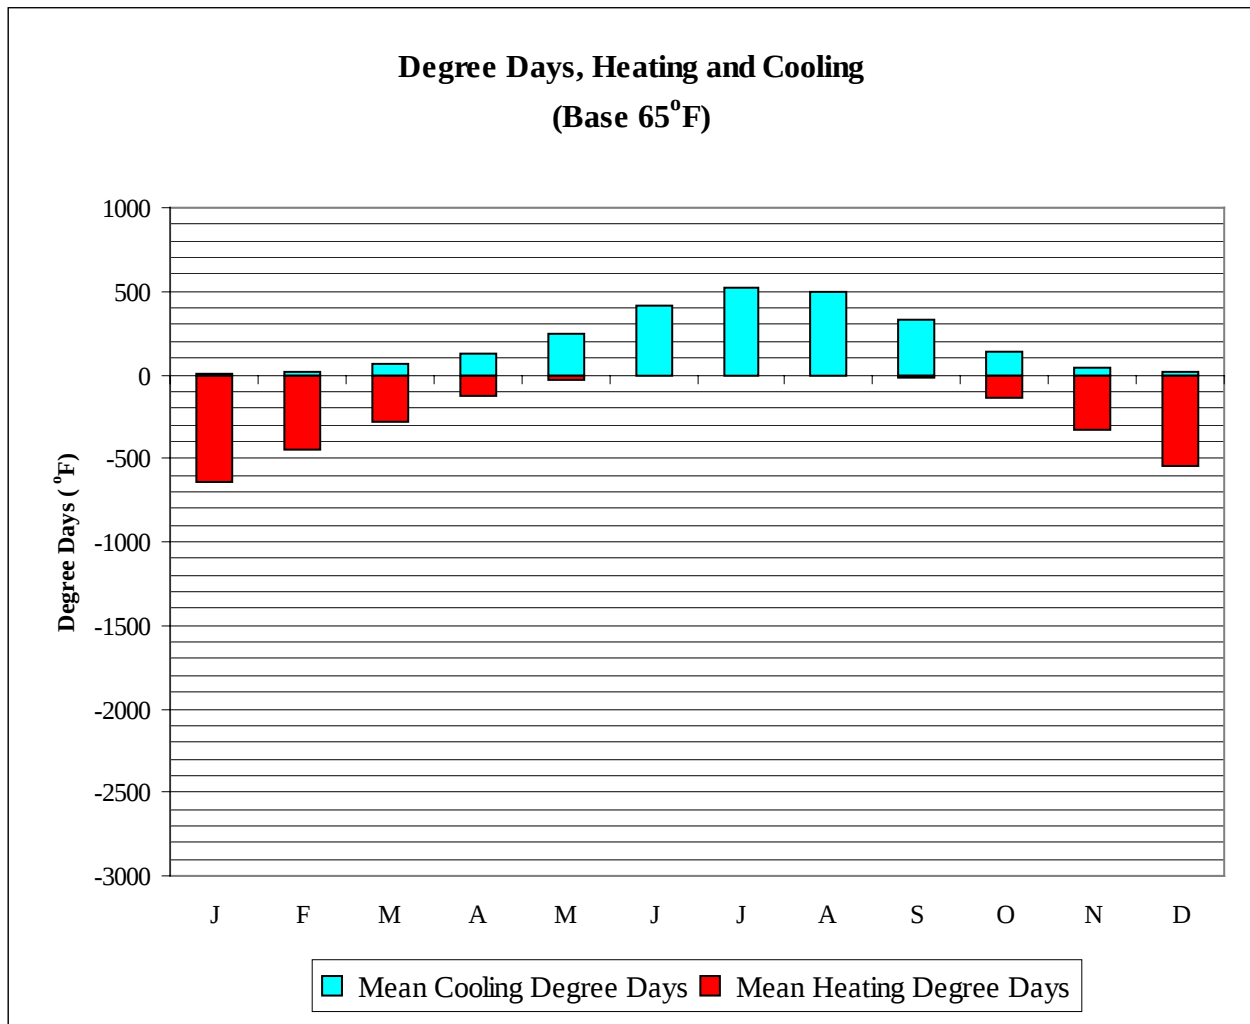

	Mean Cooling Degree Days (°F)	Mean Heating Degree Days (°F)
JAN	8	636
FEB	21	451
MAR	60	287
APR	122	130
MAY	251	31
JUN	410	3
JUL	516	0
AUG	498	1
SEP	327	23
OCT	141	134
NOV	45	327
DEC	15	545
ANN	2415	2568

Average Ventilation and Infiltration Loads
(Outside Air vs. 75°F, 60% RH summer; 68°F, 30% RH winter)

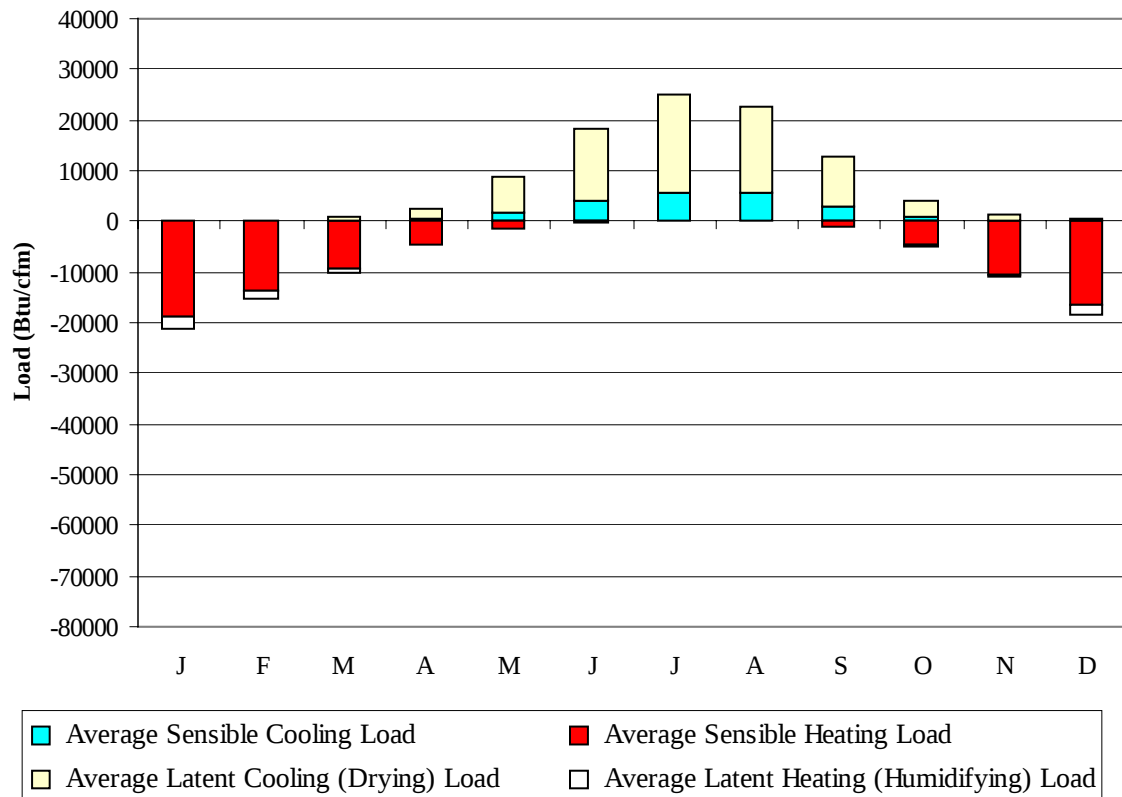

	Average Sensible Cooling Load	Average Sensible Heating Load	Average Latent Cooling Load	Average Latent Heating Load
	(Btu/cfm)	(Btu/cfm)	(Btu/cfm)	(Btu/cfm)
JAN	7	-18780	120	-2600
FEB	53	-13649	184	-1794
MAR	208	-9245	643	-733
APR	590	-4637	1990	-123
MAY	1781	-1430	7018	-2
JUN	3992	-183	14268	0
JUL	5793	-12	19081	0
AUG	5536	-64	17032	0
SEP	2961	-986	9951	-1
OCT	849	-4763	3186	-54
NOV	120	-10340	1241	-737
DEC	11	-16332	412	-1960
ANN	21901	-80421	75126	-8004

Average Annual Solar Radiation – Nearest Available Site

(Source: National Renewable Energy Laboratory, Golden CO, 1995)

City: SHREVEPORT
 State: LA
 WBAN No: 13957
 Lat(N): 32.47
 Long(W): 93.82
 Elev(ft): 259

Stn Type: Secondary
 SHADING GEOMETRY IN DIMENSIONLESS UNITS
 Window: 1
 Overhang: 0.976
 Vert Gap: 0.659

AVERAGE INCIDENT SOLAR RADIATION (Btu/sq.ft./day), Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Global	840	1090	1400	1700	1910	2040	2040	1910	1580	1310	940	780	1460
	Std Dev	75	75	117	141	140	121	118	95	95	122	78	58	36
	Minimum	710	960	1200	1440	1660	1710	1850	1690	1270	1050	720	670	1400
	Maximum	980	1230	1710	2080	2230	2230	2340	2050	1740	1520	1070	880	1540
	Diffuse	400	480	610	730	840	870	850	780	670	500	400	360	620
Clear Day	Global	1210	1530	1950	2320	2530	2590	2520	2330	2010	1610	1250	1090	1910
NORTH	Global	250	300	380	460	560	640	610	500	410	330	260	230	410
	Diffuse	250	300	380	450	510	530	520	480	410	330	260	230	390
Clear Day	Global	230	280	350	440	590	690	640	490	390	310	240	210	410
EAST	Global	510	640	790	910	990	1050	1090	1060	890	770	570	480	810
	Diffuse	300	360	460	540	610	640	630	600	520	410	320	270	470
Clear Day	Global	820	990	1180	1330	1380	1380	1350	1290	1180	1010	830	760	1130
SOUTH	Global	1090	1140	1050	880	720	640	680	850	1040	1250	1170	1100	970
	Diffuse	390	450	500	540	550	540	550	560	550	490	420	370	490
Clear Day	Global	2000	1920	1630	1170	820	690	740	1000	1410	1760	1910	1950	1410
WEST	Global	550	690	840	980	1070	1110	1080	1030	920	810	610	510	850
	Diffuse	300	370	460	560	620	650	640	610	520	420	320	280	480
Clear Day	Global	820	990	1180	1330	1380	1380	1350	1290	1180	1010	830	760	1130

Average Annual Solar Heat and Illumination – Nearest Available Site


(Source: National Renewable Energy Laboratory, Golden CO, 1995)

AVERAGE TRANSMITTED SOLAR RADIATION (Btu/sq.ft./day) FOR DOUBLE GLAZING, Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Unshaded	570	760	1000	1230	1390	1490	1490	1390	1140	930	650	520	1050
NORTH	Unshaded	170	210	260	310	370	410	390	340	290	230	180	160	280
	Shaded	150	180	230	270	310	350	330	300	250	200	160	130	240
EAST	Unshaded	350	450	560	650	700	750	770	750	630	540	390	330	570
	Shaded	300	380	450	520	560	590	620	610	510	440	330	280	470
SOUTH	Unshaded	810	820	710	550	430	400	410	520	670	880	860	820	660
	Shaded	750	650	390	310	330	330	330	340	340	600	780	790	490
WEST	Unshaded	380	490	600	700	760	790	770	730	650	570	420	350	600
	Shaded	320	410	490	560	600	630	610	590	540	470	350	300	490

AVERAGE INCIDENT ILLUMINANCE (klux-hr) FOR MOSTLY CLEAR AND MOSTLY CLOUDY CONDITIONS, Percentage Uncertainty = 9		March					June				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	40	78	91	75	36	40	81	103	99	71
	M.Cloudy	21	46	56	45	22	26	58	78	77	53
NORTH	M.Clear	10	14	16	14	9	23	17	17	18	17
	M.Cloudy	9	17	19	16	9	15	18	19	19	17
EAST	M.Clear	78	63	16	14	9	70	75	37	18	16
	M.Cloudy	23	32	19	16	9	32	49	32	19	17
SOUTH	M.Clear	34	66	76	63	30	12	21	34	32	17
	M.Cloudy	14	32	41	33	15	11	20	30	29	17
WEST	M.Clear	10	14	18	66	75	12	17	17	49	76
	M.Cloudy	9	17	20	34	28	11	18	19	40	51
M.Clear	(% hrs)	34	35	35	37	38	39	37	32	37	45
		Sept					Dec				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	25	69	91	85	54	19	52	61	43	8
	M.Cloudy	16	45	64	63	38	10	29	36	24	5
NORTH	M.Clear	8	15	17	17	14	6	11	12	10	4
	M.Cloudy	7	16	19	19	14	5	11	13	10	3
EAST	M.Clear	58	74	35	17	14	50	47	12	10	4
	M.Cloudy	20	40	28	19	14	12	20	13	10	3
SOUTH	M.Clear	16	49	67	62	38	42	83	92	72	20
	M.Cloudy	9	29	44	43	24	10	29	37	25	6
WEST	M.Clear	8	15	17	50	74	6	11	20	55	29
	M.Cloudy	7	16	19	37	41	5	11	15	21	8
M.Clear	(% hrs)	44	42	38	40	47	35	34	35	39	40

Wind Summary - December, January, and February


Labels of Percent Frequency on North Axis

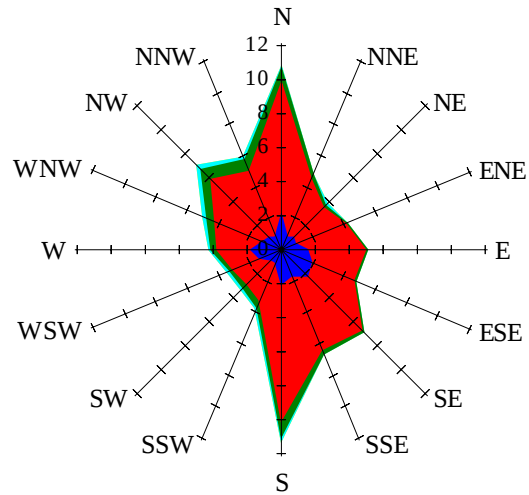

Percent Calm = 10.70

Wind Summary - March, April, and May


Labels of Percent Frequency on North Axis

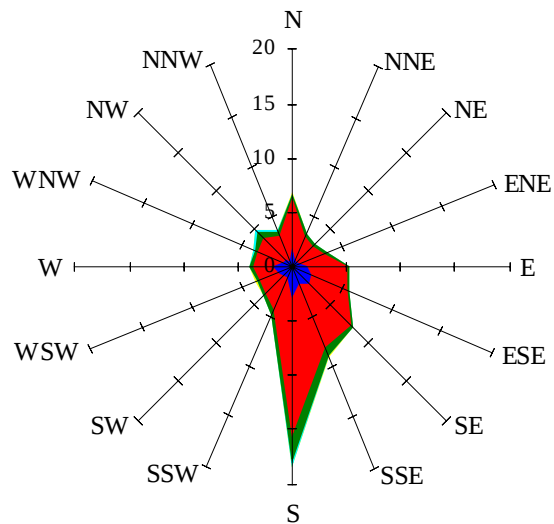

Percent Calm = 11.49

Wind Summary - June, July, and August


Labels of Percent Frequency on North Axis

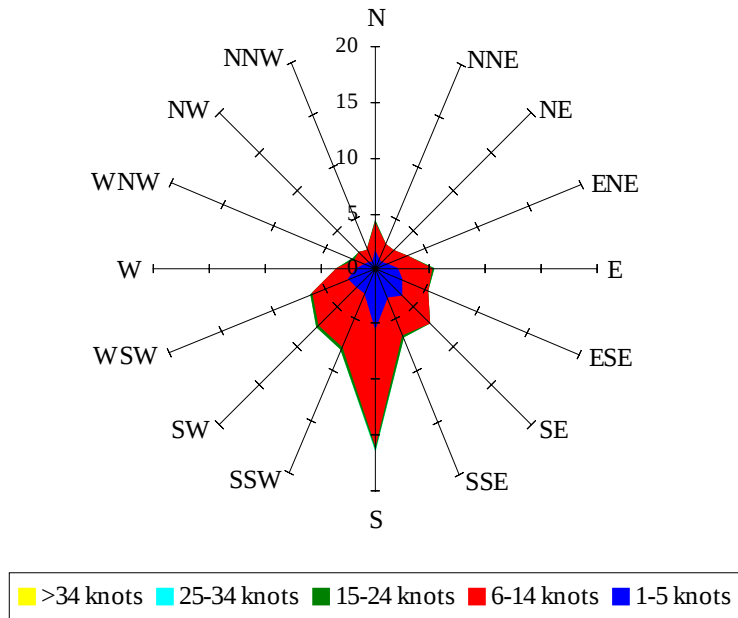

Percent Calm = 17.55

Wind Summary - September, October, and November

Labels of Percent Frequency on North Axis

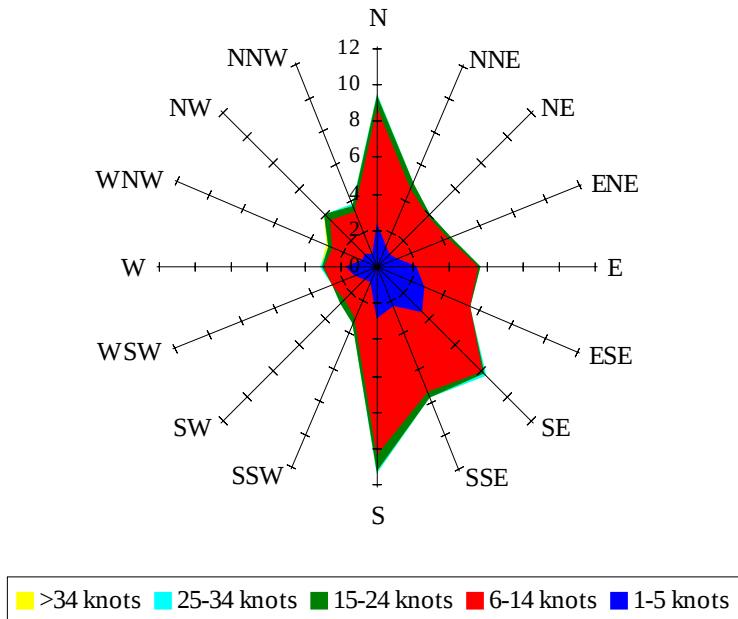

Percent Calm = 17.30