

TRAVIS AFB/FAIRFIELD CA

Latitude = 38.27 N

WMO No. 745160

Longitude = 121.90 W

Elevation = 62 feet

Period of Record = 1967 to 1996

Average Pressure = 29.89 inches Hg

Design Criteria Data

	Design Value	Mean Coincident (Average) Values			
		Wet Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Dry Bulb Temperature (T)	(°F)				
Median of Extreme Highs	105	70	54	8.5	NNE
0.4% Occurrence	98	68	54	8.9	WSW
1.0% Occurrence	95	68	57	9.7	WSW
2.0% Occurrence	91	66	56	11.0	WSW
Mean Daily Range	22	-	-	-	-
97.5% Occurrence	37	35	27	3.7	NNE
99.0% Occurrence	34	32	24	3.4	NNE
99.6% Occurrence	32	30	22	2.9	NNE
Median of Extreme Lows	27	25	16	3.2	NNE
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Humidity Ratio (gr/lb)	Wind Speed (mph)	Prevailing Direction (NSEW)
Wet Bulb Temperature (T_{wb})	(°F)				
Median of Extreme Highs	73	95	86	10.8	WSW
0.4% Occurrence	70	93	73	10.2	WSW
1.0% Occurrence	69	92	69	10.8	WSW
2.0% Occurrence	67	88	65	11.8	WSW
	Design Value	Mean Coincident (Average) Values			
		Dry Bulb Temperature (°F)	Vapor Pressure (in. Hg)	Wind Speed (mph)	Prevailing Direction (NSEW)
Humidity Ratio (HR)	(gr/lb)				
Median of Extreme Highs	92	77	0.62	10.7	WSW
0.4% Occurrence	83	75	0.56	11.5	WSW
1.0% Occurrence	78	74	0.52	11.1	WSW
2.0% Occurrence	75	74	0.50	12.3	WSW
Air Conditioning/ Humid Area Criteria	# of Hours	T ≥ 93°F	T ≥ 80°F	T _{wb} ≥ 73°F	T _{wb} ≥ 67°F
		130	760	9	238

Other Site Data


Weather Region	Rain Rate 100 Year Recurrence (in./hr)	Basic Wind Speed 3 sec gust @ 33 ft 50 Year Recurrence (mph)	Ventilation Cooling Load Index (Ton-hr/cfm/yr) Base 75°F-RH 60% Latent + Sensible
8	1.5	85	0.0 + 0.9
Ground Water Temperature (°F) 50 Foot Depth *	Frost Depth 50 Year Recurrence (in.)	Ground Snow Load 50 Year Recurrence (lb/ft ²)	Average Annual Freeze-Thaw Cycles (#)
62.0	0	0	10

*Note: Temperatures at greater depths can be estimated by adding 1.5°F per 100 feet additional depth.

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160


Average Annual Climate

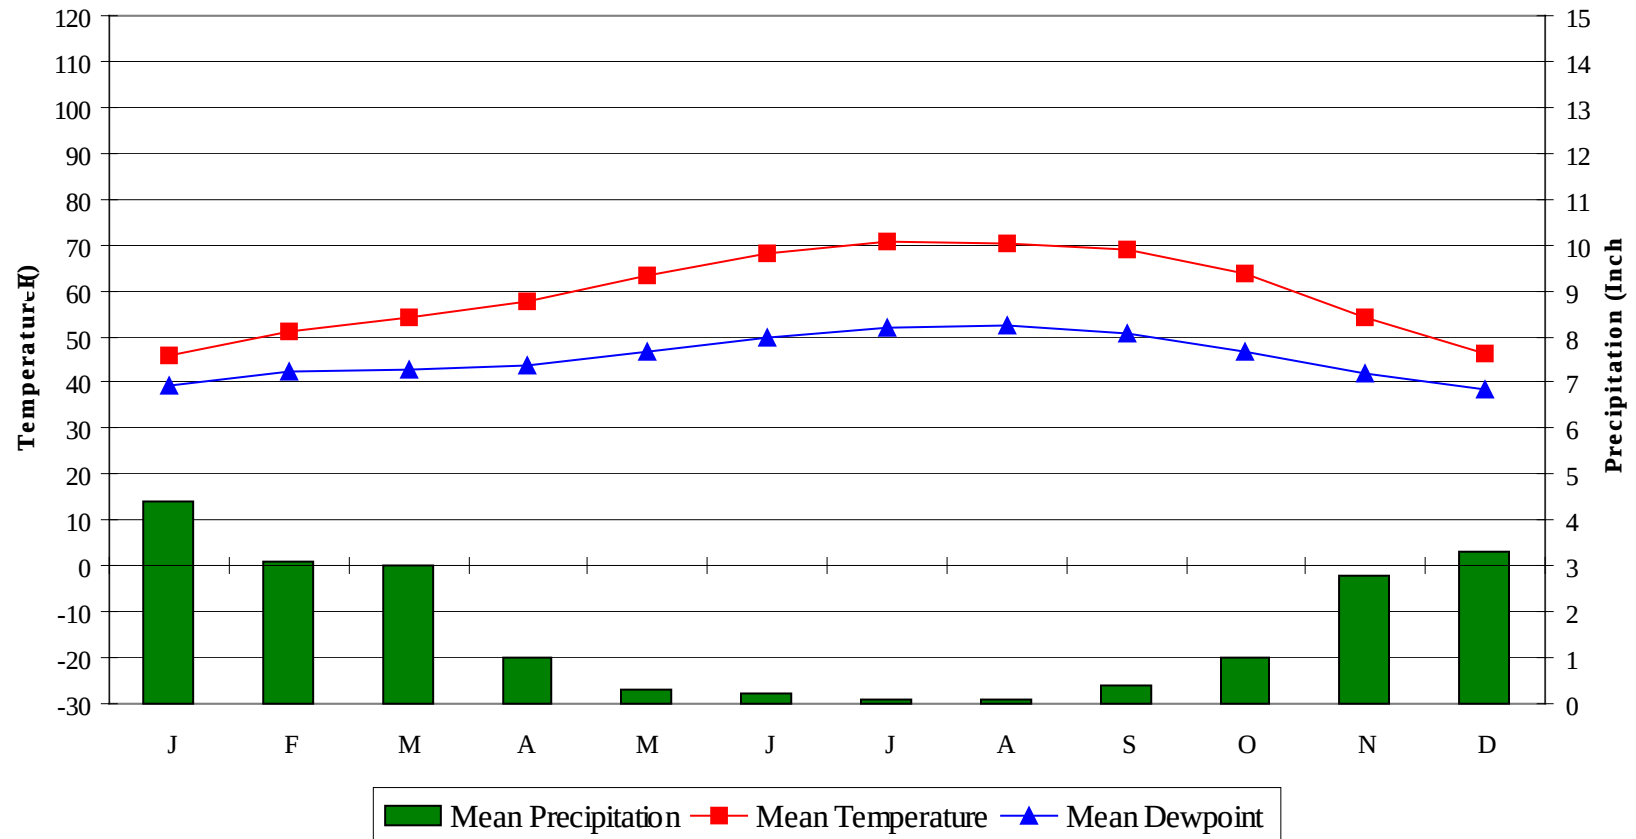

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Long Term Psychrometric Summary

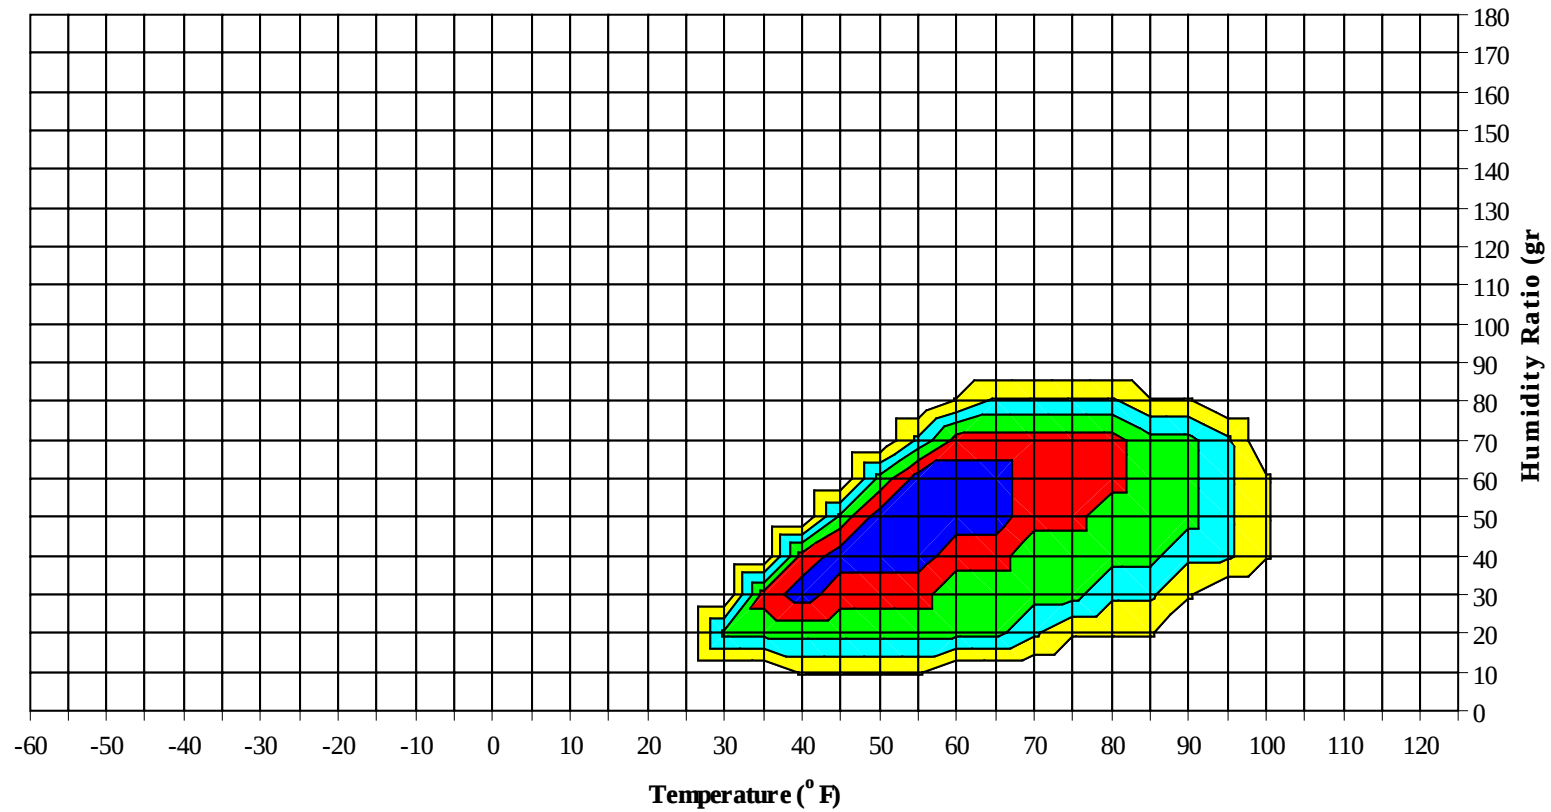


- 50% of all observations
- 80% of all observations
- 95% of all observations
- 97.5% of all observations
- 99% of all observations

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Psychrometric Summary of Peak Design Values

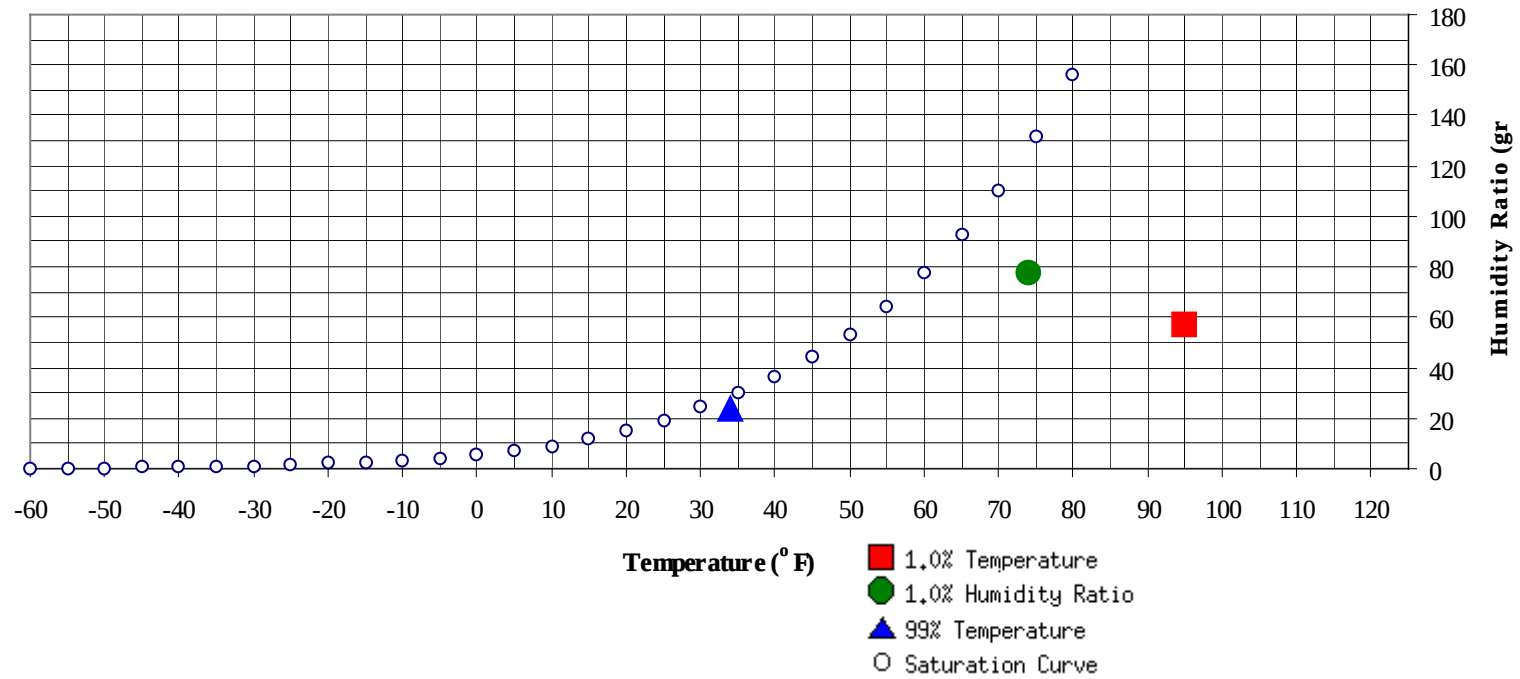

	(°F)	MCHR (gr/lb)	Enthalpy (btu/lb)	1.0% Humidity Ratio	(gr/lb)	MCDB (°F)	MCWB (°F)	MC Dewpt (°F)	Enthalpy (btu/lb)
99% Dry Bulb	34	23.8	11.8		77.7	74.1	64.9	60	29.9

	(°F)	MCHR (gr/lb)	MCWB (°F)	Enthalpy (btu/lb)
1.0% Dry Bulb	95	57.3	67.6	31.8

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Dry-Bulb Temperature Hours For An Average Year (Sheet 1 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	January					February					March				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
110 / 114															
105 / 109															
100 / 104															
95 / 99															
90 / 94															
85 / 89											0064.5				
80 / 84											00064.6				
75 / 79						058.1					51560.1				
70 / 74	051.3					558.4					1842258.1				
65 / 69	0	4	0	4	52.5	0	16	4	20	56.4	0	35	12	47	55.6
60 / 64	1	18	3	22	53.3	2	41	14	57	53.8	3	65	28	95	53.0
55 / 59	9	46	21	75	51.4	13	66	45	124	51.3	28	70	63	161	50.8
50 / 54	28	67	52	146	48.0	47	58	72	176	48.2	80	41	80	200	47.9
45 / 49	45	56	70	171	43.9	68	28	58	154	44.2	79	12	46	138	44.0
40 / 44	69	39	66	174	39.9	60	8	25	92	39.9	46	2	14	62	39.7
35 / 39	64	16	30	110	35.7	28	1	5	34	35.2	11		1	13	35.5
30 / 34	26	3	5	34	31.2	6	0	1	7	29.9	1			1	31.6
25 / 29	5	0	1	6	26.4	0		0	0	25.0	0			0	26.0
20 / 24	0			0	22.8										
15 / 19															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Dry-Bulb Temperature Hours For An Average Year (Sheet 2 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	April					May					June				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
110 / 114															
105 / 109												1	0	1	70.1
100 / 104												5	1	6	69.2
95 / 99							3	1	3	66.1		11	3	14	67.9
90 / 94		1	0	1	67.3		9	1	10	65.3	0	19	5	24	66.0
85 / 89		3	0	4	65.0	0	17	4	21	64.0	1	25	7	33	65.0
80 / 84			11	2	61.9	1	26	7	34	62.7	3	35	13	51	63.1
75 / 79	0	20	6	27	59.5	3	38	11	52	60.7	5	47	21	73	61.2
70 / 74	1	37	10	48	57.6	5	54	20	79	58.4	9	47	31	87	59.3
65 / 69	3	52	21	76	55.3	11	52	36	99	56.1	22	34	42	97	57.2
60 / 64	13	58	38	108	53.0	33	36	53	121	54.1	56	14	56	125	55.2
55 / 59	44	41	64	149	50.7	76	12	67	155	51.5	104	2	52	158	52.7
50 / 54	86	14	64	164	47.7	88	1	42	131	48.2	39	0	8	47	49.3
45 / 49	62	3	28	93	44.0	28	0	6	33	44.3	3		0	3	45.1
40 / 44	26	0	7	33	40.0	4		0	4	40.0	0			0	39.0
35 / 39	5		0	6	35.4	0		0	0	36.7					
30 / 34	0			0	32.2										
25 / 29															
20 / 24															
15 / 19															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Dry-Bulb Temperature Hours For An Average Year (Sheet 3 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	July					August					September				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
110 / 114		0		0	72.0										
105 / 109		1	0	1	72.3		0	0	1	70.4					
100 / 104		7	1	8	69.7		6	1	6	69.3		1	0	1	68.5
95 / 99		15	3	18	68.7		13	3	16	67.8		9	1	11	66.9
90 / 94	0	27	6	33	67.3		26	5	31	66.8		22	5	26	65.2
85 / 89	0	41	11	53	65.9	0	36	9	44	65.7	0	33	7	40	63.9
80 / 84	1	51	21	73	64.3	0	49	18	67	64.2	0	44	12	56	63.0
75 / 79	4	45	31	79	62.2	3	50	28	81	62.5	2	49	22	74	61.4
70 / 74	12	35	39	86	60.0	9	38	40	86	60.4	8	42	36	85	59.6
65 / 69	33	21	50	104	58.1	30	24	54	107	58.5	26	29	54	109	58.0
60 / 64	84	5	60	148	56.0	94	6	68	168	56.3	78	11	70	158	56.1
55 / 59	102	0	26	128	53.4	104	0	23	127	53.9	104	1	32	137	53.4
50 / 54	11		1	12	50.9	8		1	8	51.2	21		1	23	49.7
45 / 49											1		0	1	44.7
40 / 44															
35 / 39															
30 / 34															
25 / 29															
20 / 24															
15 / 19															

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Dry-Bulb Temperature Hours For An Average Year (Sheet 4 of 5)

Period of Record = 1967 to 1996

Temperature Range (°F)	October					November					December				
	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00			01 To 08	09 To 16	17 To 00		
110 / 114															
105 / 109															
100 / 104		0		0	66.6										
95 / 99		2	0	2	65.7										
90 / 94		6	1	7	64.9										
85 / 89		15	2	17	63.1		0		0	60.5					
80 / 84	0	28	5	33	61.2		2	0	2	58.9					
75 / 79	1	44	11	56	59.7		9	1	9	58.4					
70 / 74	2	51	23	76	58.0		22	2	24	56.8		1		1	52.4
65 / 69	10	52	43	104	56.3	1	37	9	47	55.0	0	5	0	5	53.6
60 / 64	44	37	70	151	54.7	5	55	31	91	53.5	2	25	4	31	52.9
55 / 59	94	12	66	172	52.2	32	59	64	155	50.9	10	49	20	80	50.7
50 / 54	70	1	24	95	48.5	68	35	68	171	47.5	28	64	52	144	47.4
45 / 49	23	0	3	27	44.0	66	16	45	127	43.6	50	53	71	174	43.9
40 / 44	4		0	4	39.6	44	4	17	65	39.3	67	34	62	163	39.6
35 / 39						19	1	3	23	35.2	57	15	31	103	35.3
30 / 34						4	0	0	5	31.0	27	3	6	36	30.7
25 / 29						0			0	27.9	5	0	1	6	25.6
20 / 24											1		0	1	20.2
15 / 19											0			0	17.0

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

TRAVIS AFB/FAIRFIELD CA


WMO No. 745160

Dry-Bulb Temperature Hours For An Average Year (Sheet 5 of 5)
Period of Record = 1967 to 1996


Annual Totals					
Temperature Range (°F)	Hour Group (LST)			Total Obs	M C W B (°F)
	01 To 08	09 To 16	17 To 00		
110 / 114		0		0	72.0
105 / 109		2	0	2	71.2
100 / 104		19	2	21	69.3
95 / 99		54	10	65	67.8
90 / 94	0	109	22	132	66.3
85 / 89	1	171	41	212	64.9
80 / 84	6	245	77	328	63.3
75 / 79	17	306	133	456	61.2
70 / 74	45	349	206	600	59.0
65 / 69	137	357	323	817	56.9
60 / 64	411	370	492	1274	54.8
55 / 59	719	360	542	1620	51.9
50 / 54	573	282	465	1320	48.0
45 / 49	427	169	328	923	43.9
40 / 44	321	87	192	600	39.7
35 / 39	185	33	72	290	35.4
30 / 34	65	6	12	83	30.8
25 / 29	11	0	2	13	26.1
20 / 24	1		0	2	20.8
15 / 19	0			0	17.0

Caution: This summary reflects the typical distribution of temperature in a typical year. It does not reflect the typical moisture distribution. Because wet bulb temperatures are averaged, this summary understates the annual moisture load. For accurate moisture load data, see the long-term humidity summary and the ventilation and infiltration load pages in this manual.

Annual Summary of Temperatures

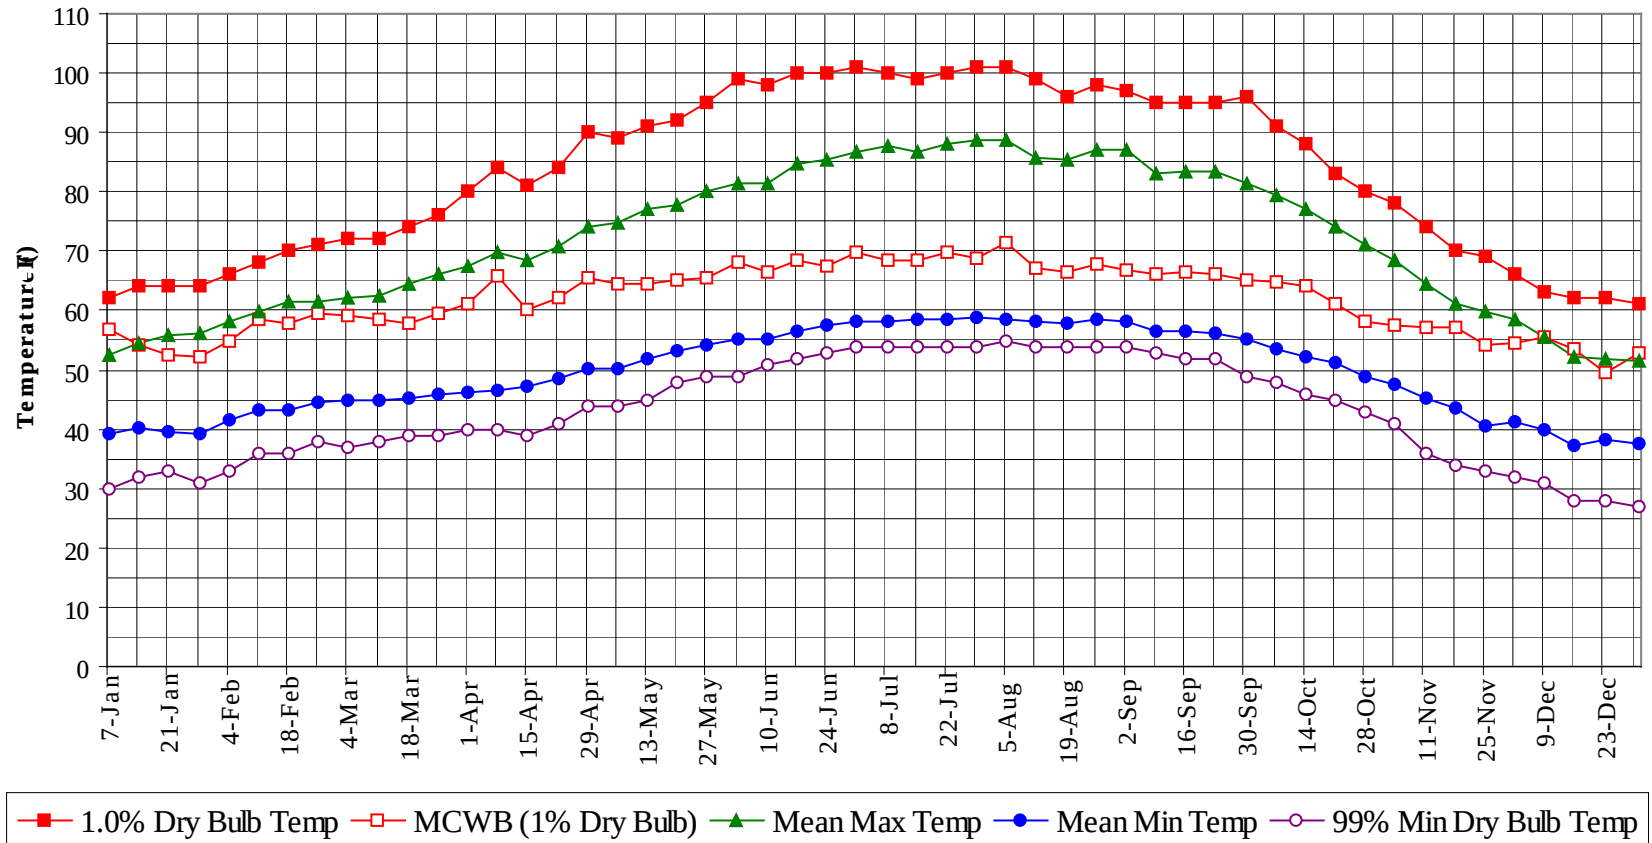

Long Term Humidity and Dry Bulb Temperature Summary

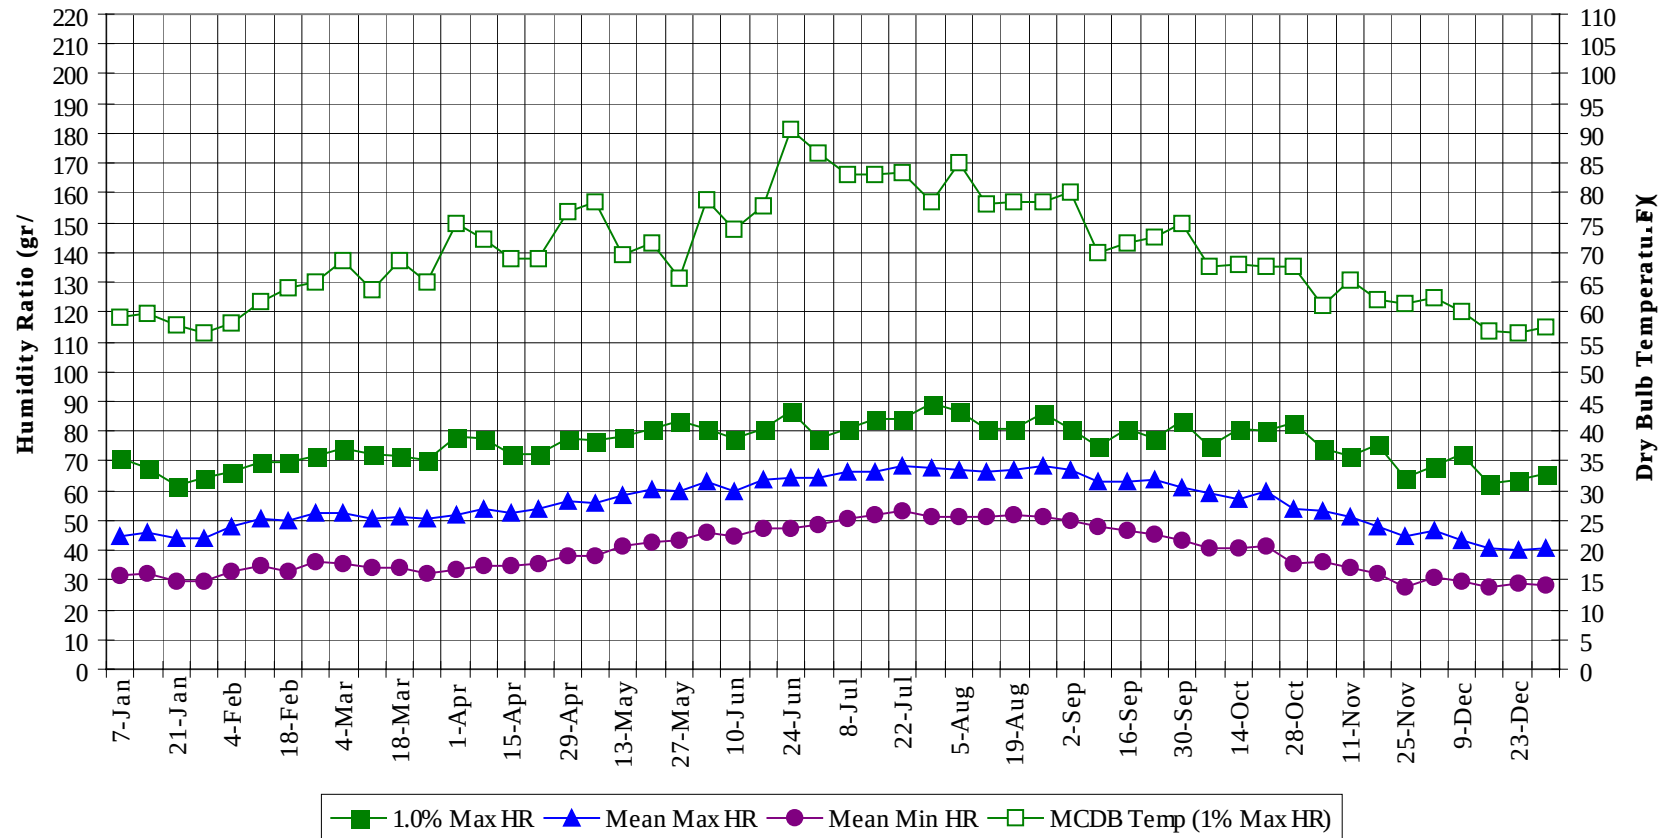


TRAVIS AFB/FAIRFIELD CA

WMO No. 745160

Long Term Dry Bulb Temperature and Humidity Summary

Week Ending	1.0% Temp (°F)	MCWB @ 1% Temp (°F)	Mean Max Temp (°F)	Mean Min Temp (°F)	99% Temp (°F)	1.0% HR (gr/lb)	MCDB @ 1% HR (°F)	Mean Max HR (gr/lb)	Mean Min HR (gr/lb)
7-Jan	62.0	56.7	52.7	39.3	30.0	70.7	59.2	44.4	31.3
14-Jan	64.0	54.3	54.6	40.2	32.0	67.9	59.6	45.8	31.9
21-Jan	64.0	52.4	55.9	39.4	33.0	61.6	57.8	44.2	29.4
28-Jan	64.0	52.2	56.1	39.2	31.0	64.4	56.5	43.8	29.6
4-Feb	66.0	54.8	58.1	41.7	33.0	66.5	58.1	47.8	32.8
11-Feb	68.0	58.6	59.8	43.2	36.0	69.3	61.9	50.3	34.8
18-Feb	70.0	57.7	61.4	43.3	36.0	69.3	64.2	49.8	33.1
25-Feb	71.0	59.5	61.5	44.7	38.0	71.4	65.1	52.6	35.8
4-Mar	72.0	59.0	62.2	44.8	37.0	74.2	68.7	52.2	35.6
11-Mar	72.0	58.5	62.5	44.8	38.0	72.1	63.7	50.5	33.9
18-Mar	74.0	57.9	64.4	45.3	39.0	71.4	68.5	51.1	33.9
25-Mar	76.0	59.3	66.1	46.0	39.0	70.0	65.1	50.4	32.1
1-Apr	80.0	61.2	67.5	46.1	40.0	78.4	74.9	51.8	33.5
8-Apr	84.0	65.8	69.7	46.5	40.0	77.7	72.2	54.2	34.8
15-Apr	81.0	60.1	68.4	47.2	39.0	72.1	68.9	52.3	34.9
22-Apr	84.0	62.2	70.7	48.4	41.0	72.1	69.1	53.5	35.8
29-Apr	90.0	65.6	74.0	50.2	44.0	77.7	76.8	56.5	38.0
6-May	89.0	64.6	74.6	50.3	44.0	77.0	78.6	55.9	38.0
13-May	91.0	64.5	77.0	52.0	45.0	78.4	69.6	58.2	41.3
20-May	92.0	65.1	77.9	53.1	48.0	80.5	71.6	60.5	42.9
27-May	95.0	65.4	80.1	54.3	49.0	83.3	65.6	59.7	43.5
3-Jun	99.0	68.1	81.4	55.2	49.0	80.5	78.9	63.3	45.7
10-Jun	98.0	66.5	81.4	55.3	51.0	77.7	73.8	59.9	44.9
17-Jun	100.0	68.4	84.6	56.6	52.0	80.5	77.9	63.4	47.5
24-Jun	100.0	67.5	85.4	57.7	53.0	86.8	90.7	64.3	47.5
1-Jul	101.0	69.8	86.8	58.0	54.0	77.7	86.6	64.4	48.4
8-Jul	100.0	68.6	87.9	58.1	54.0	80.5	83.0	66.3	50.7
15-Jul	99.0	68.5	86.8	58.4	54.0	84.0	82.9	66.4	51.6
22-Jul	100.0	69.8	88.2	58.4	54.0	84.0	83.3	68.1	53.3
29-Jul	101.0	68.8	88.8	58.7	54.0	89.6	78.4	67.8	51.6
5-Aug	101.0	71.4	88.6	58.4	55.0	86.8	85.0	66.9	51.6
12-Aug	99.0	67.2	85.7	58.2	54.0	80.5	78.0	66.1	51.5
19-Aug	96.0	66.6	85.3	57.7	54.0	80.5	78.4	67.3	52.0
26-Aug	98.0	67.9	86.9	58.5	54.0	86.1	78.4	68.5	51.4
2-Sep	97.0	66.9	87.2	58.2	54.0	80.5	80.2	66.7	49.6
9-Sep	95.0	66.1	83.2	56.6	53.0	74.9	70.0	63.1	47.8
16-Sep	95.0	66.5	83.4	56.4	52.0	80.5	71.4	63.1	46.7
23-Sep	95.0	66.2	83.5	56.1	52.0	77.7	72.7	63.5	45.6
30-Sep	96.0	65.0	81.4	55.1	49.0	83.3	75.0	61.3	43.6
7-Oct	91.0	64.9	79.5	53.4	48.0	74.9	67.5	58.9	40.7
14-Oct	88.0	64.1	77.1	52.1	46.0	80.5	67.9	57.5	40.8
21-Oct	83.0	61.2	74.1	51.1	45.0	79.8	67.5	59.7	41.3
28-Oct	80.0	58.0	71.1	49.0	43.0	82.6	67.7	53.6	35.4
4-Nov	78.0	57.4	68.5	47.5	41.0	74.2	60.9	53.2	35.9
11-Nov	74.0	57.0	64.5	45.1	36.0	71.4	65.4	51.4	34.3
18-Nov	70.0	57.0	61.1	43.4	34.0	75.6	62.1	47.8	32.2
25-Nov	69.0	54.3	59.9	40.4	33.0	64.4	61.3	44.4	27.6
2-Dec	66.0	54.5	58.6	41.1	32.0	68.6	62.3	46.4	30.7
9-Dec	63.0	55.4	55.4	39.8	31.0	72.1	60.2	43.6	29.5
16-Dec	62.0	53.4	52.1	37.2	28.0	62.3	56.9	40.8	27.5
23-Dec	62.0	49.6	51.8	38.1	28.0	63.7	56.6	39.8	28.6
31-Dec	61.0	52.8	51.6	37.5	27.0	65.8	57.4	41.0	28.5


Degree Days, Heating and Cooling
(Base 65°F)

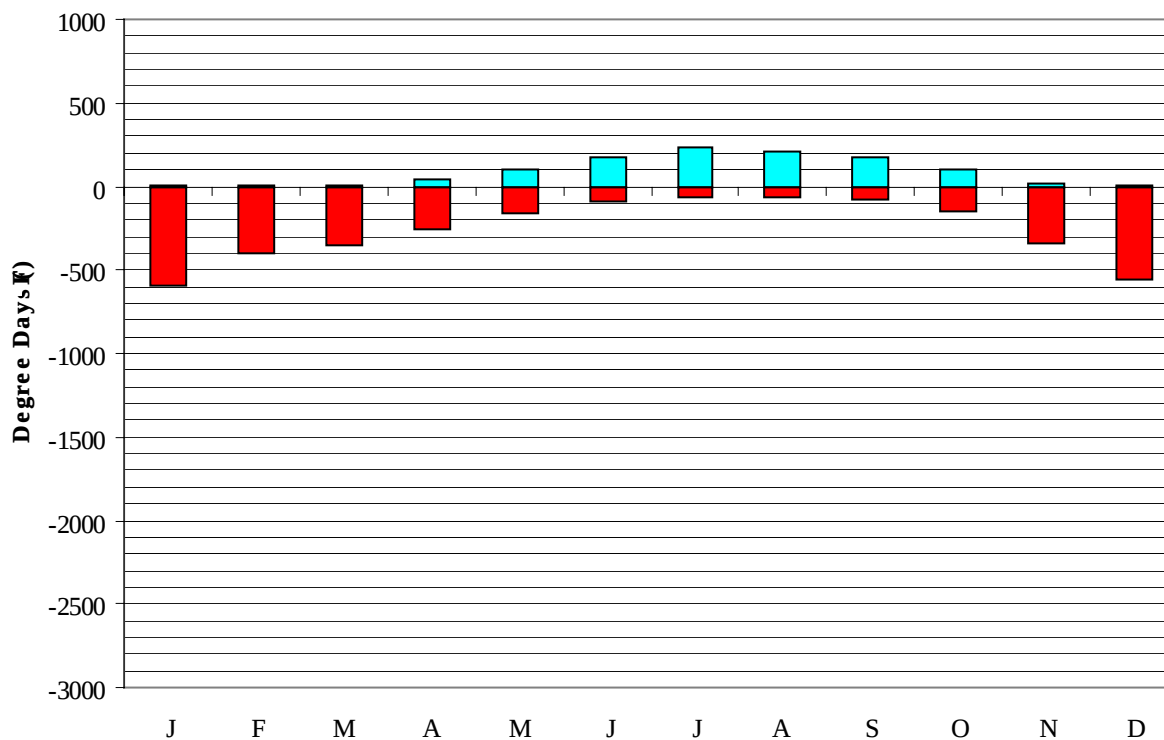

■ Mean Cooling Degree Days ■ Mean Heating Degree Days

	Mean Cooling Degree Days (°F)	Mean Heating Degree Days (°F)
JAN	0	589
FEB	3	402
MAR	11	352
APR	42	259
MAY	106	166
JUN	178	94
JUL	230	65
AUG	213	65
SEP	177	76
OCT	96	145
NOV	15	346
DEC	0	559
ANN	1071	3118

Average Ventilation and Infiltration Loads
(Outside Air vs. 75°F, 60% RH summer; 68°F, 30% RH winter)

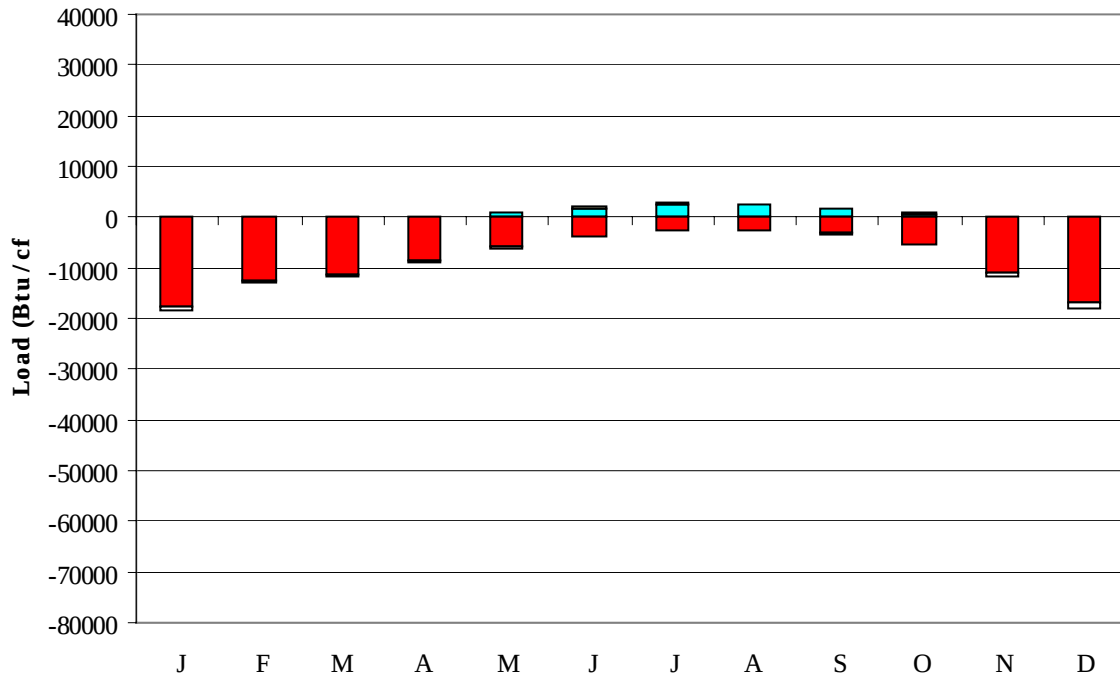

	Average Sensible Cooling Load (Btu/cfm)	Average Sensible Heating Load (Btu/cfm)	Average Latent Cooling Load (Btu/cfm)	Average Latent Heating Load (Btu/cfm)
JAN	0	-17660	0	-822
FEB	0	-12563	0	-505
MAR	12	-11378	2	-469
APR	196	-8616	15	-348
MAY	863	-5887	28	-121
JUN	1890	-3658	44	-54
JUL	2662	-2770	53	-3
AUG	2371	-2813	84	-2
SEP	1829	-3148	26	-80
OCT	718	-5295	25	-242
NOV	30	-11098	11	-621
DEC	0	-16806	1	-1045
ANN	10571	-101692	289	-4312

Average Annual Solar Radiation – Nearest Available Site

(Source: National Renewable Energy Laboratory, Golden CO, 1995)

City: SACRAMENTO
 State: CA
 WBAN No: 23232
 Lat(N): 38.52
 Long(W): 121.5
 Elev(ft): 26

Stn Type: Secondary
 SHADING GEOMETRY IN DIMENSIONLESS UNITS

Window: 1
 Overhang: 0.491
 Vert Gap: 0.313

AVERAGE INCIDENT SOLAR RADIATION (Btu/sq.ft./day), Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Global	610	940	1370	1870	2280	2490	2520	2230	1810	1280	760	550	1560
	Std Dev	64	114	138	167	134	96	56	82	80	70	100	73	36
	Minimum	490	730	1070	1460	1970	2210	2330	2010	1610	1110	590	440	1460
	Maximum	750	1200	1690	2070	2460	2660	2600	2350	1920	1370	950	730	1620
	Diffuse	360	450	570	650	650	610	540	520	460	410	360	320	490
Clear Day	Global	890	1240	1740	2240	2560	2690	2620	2340	1900	1390	960	790	1780
NORTH	Global	210	280	360	460	580	680	640	490	380	310	230	190	400
	Diffuse	210	280	360	440	500	510	490	440	370	310	230	190	360
Clear Day	Global	210	270	350	430	590	690	640	480	370	290	220	190	400
EAST	Global	370	570	830	1110	1300	1380	1410	1300	1110	810	480	340	920
	Diffuse	250	340	450	560	610	610	600	560	480	390	280	230	450
Clear Day	Global	620	830	1100	1340	1470	1500	1470	1380	1180	910	670	570	1090
SOUTH	Global	850	1130	1220	1140	960	850	910	1140	1430	1470	1080	820	1080
	Diffuse	360	450	530	560	550	530	520	520	510	490	400	330	480
Clear Day	Global	1690	1810	1730	1390	1050	890	940	1220	1590	1790	1720	1630	1450
WEST	Global	410	600	840	1100	1300	1380	1420	1310	1120	820	510	370	930
	Diffuse	260	350	460	560	610	610	590	560	480	390	290	230	450
Clear Day	Global	620	830	1100	1340	1470	1500	1470	1380	1180	910	670	570	1090


Average Annual Solar Heat and Illumination – Nearest Available Site

(Source: National Renewable Energy Laboratory, Golden CO, 1995)

AVERAGE TRANSMITTED SOLAR RADIATION (Btu/sq.ft./day) FOR DOUBLE GLAZING, Percentage Uncertainty = 9		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
HORIZ	Unshaded	410	650	970	1360	1670	1830	1850	1630	1310	890	510	360	1120
NORTH	Unshaded	140	190	250	310	370	420	400	320	260	210	160	130	260
	Shaded	130	170	230	280	340	390	370	300	240	200	140	120	240
EAST	Unshaded	250	400	590	790	930	980	1010	930	790	570	330	230	650
	Shaded	220	360	520	700	810	850	880	810	700	510	300	200	570
SOUTH	Unshaded	640	820	840	730	560	480	520	690	950	1060	800	620	720
	Shaded	610	760	670	480	360	340	340	400	680	940	780	600	580
WEST	Unshaded	280	420	590	780	930	990	1010	930	800	580	350	250	660
	Shaded	250	370	530	690	800	850	880	820	710	520	310	230	580


AVERAGE INCIDENT ILLUMINANCE (klux-hr) FOR MOSTLY CLEAR AND MOSTLY CLOUDY CONDITIONS, Percentage Uncertainty = 9		March					June				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	39	73	83	66	28	48	86	105	100	72
	M.Cloudy	24	48	56	45	18	35	62	84	80	56
NORTH	M.Clear	10	15	16	14	8	20	16	16	16	14
	M.Cloudy	9	16	17	15	7	16	17	18	18	16
EAST	M.Clear	72	57	16	14	8	81	75	32	16	14
	M.Cloudy	30	35	17	15	7	49	51	30	18	16
SOUTH	M.Clear	37	71	81	64	26	11	30	45	41	20
	M.Cloudy	19	41	49	38	14	12	25	39	36	19
WEST	M.Clear	10	15	22	66	63	11	16	16	52	83
	M.Cloudy	9	16	20	38	27	12	17	18	44	59
M.Clear	(% hrs)	43	41	39	40	43	77	78	76	76	76
		Sept					Dec				
		9am	11am	1pm	3pm	5pm	9am	11am	1pm	3pm	5pm
HORIZ.	M.Clear	28	69	89	82	51	13	40	46	29	3
	M.Cloudy	19	47	65	61	36	8	23	26	18	2
NORTH	M.Clear	8	14	16	15	12	5	10	11	9	2
	M.Cloudy	8	15	17	17	12	4	10	11	8	1
EAST	M.Clear	65	72	30	15	12	32	37	11	9	2
	M.Cloudy	32	44	26	17	12	8	16	11	8	1
SOUTH	M.Clear	20	56	76	69	40	29	73	82	56	5
	M.Cloudy	13	37	55	50	27	7	24	27	19	2
WEST	M.Clear	8	14	16	54	79	5	10	21	43	7
	M.Cloudy	8	15	17	40	47	4	10	13	16	2
M.Clear	(% hrs)	80	81	80	80	78	27	29	32	35	37

Wind Summary - December, January, and February **Labels of Percent Frequency on North Axis**

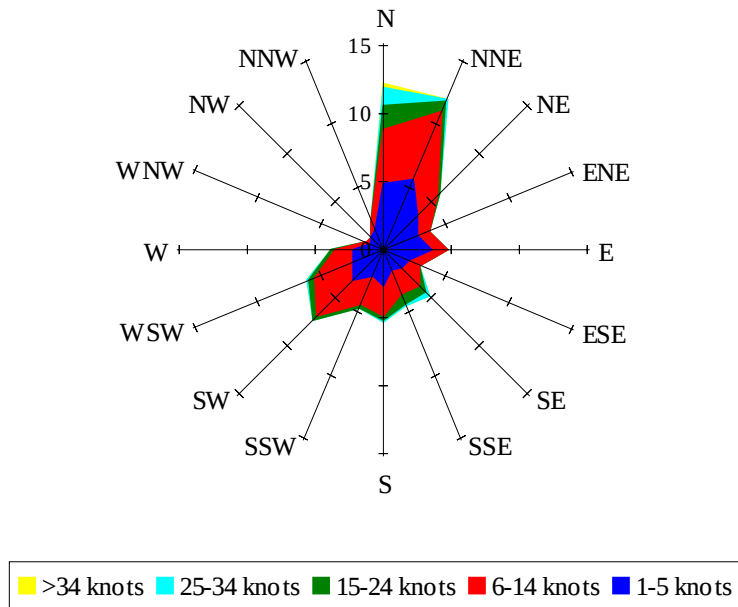

Percent Calm = 18.18


Wind Summary - March, April, and May **Labels of Percent Frequency on North Axis**

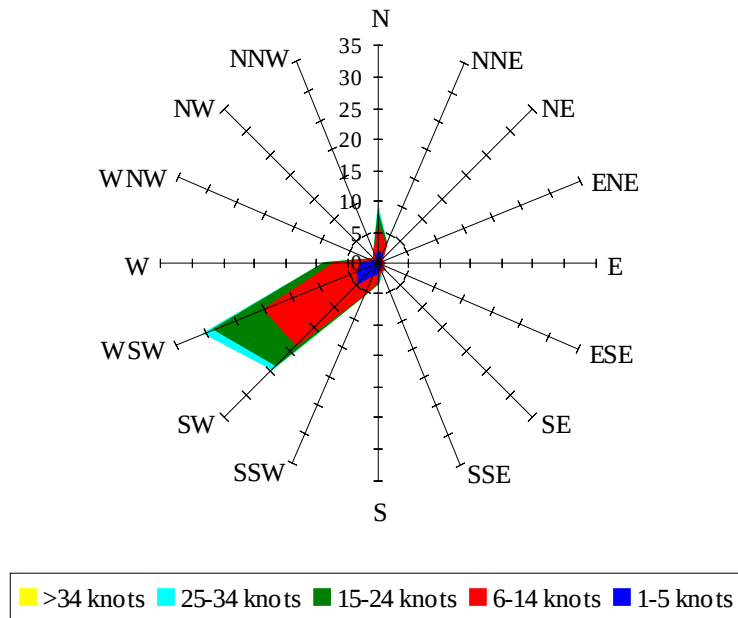

Percent Calm = 5.94

Wind Summary - June, July, and August


Labels of Percent Frequency on North Axis

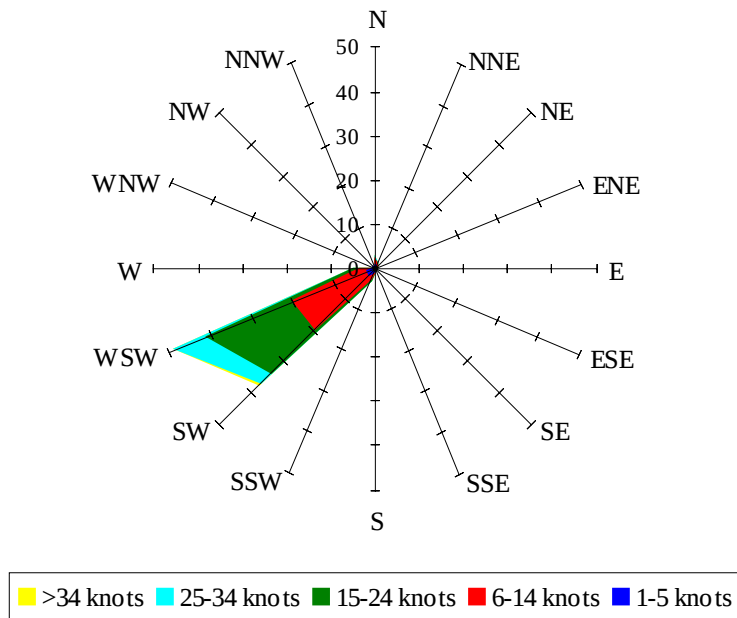

Percent Calm = 1.14

Wind Summary - September, October, and November

Labels of Percent Frequency on North Axis

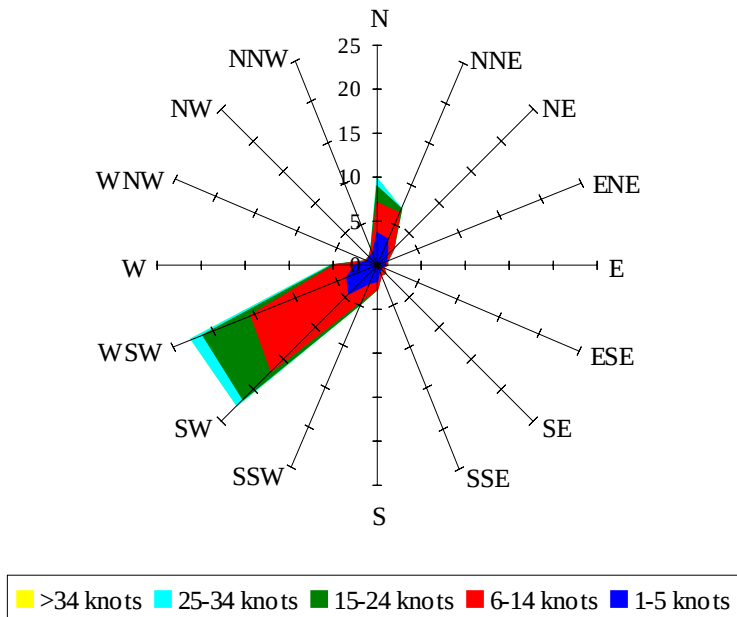

Percent Calm = 12.49